**Electrical network protection** 

## Sepam series 20 Sepam series 40 Sepam series 80



Catalogue **2007** 





Sepam series 20 Sepam series 40 Sepam series 80

## General content

Introduction	1
Sepam series 20 and Sepam series 40	2
Sepam series 80	3
Additional modules and accessories	4
Order form	5

## The Guiding System, the new way to create your electrical installations

A comprehensive offer of products with consistent design

The Guiding System is first and foremost a Merlin Gerin product offer covering all electrical distribution needs. However, what makes all the difference is that these products have been designed to operate togheter: mechanical and electrical compatibility, interoperability, modularity, communication.

Thus the electrical installation is both optimised and more efficient: better continuity of supply, enhanced safety for people and equipment, guaranteed upgradeability, effective monitoring and control.

#### Tools to simplify design and implementation

With the Guiding System, you have a comprehensive range of tools - the Guiding Tools - that will help you increase your product knowledge and product utilisation. Of course this is in compliance with current standards and procedures. These tools include technical booklets and guides, design aid software, training courses, etc. and are regularly updated.

## The Guiding System, combined with the know-how and creativity, allows optimised, reliable, open-ended and standard compliant installations

#### For a genuine partnership with you

Because each electrical installation is unique, there is no standard solution. With the Guiding System, the variety of combinations allows for genuine customisation solutions. You can create and implement electrical installations to meet your creative requirements and design knowledge.

You and Merlin Gerin's Guiding System form a genuine partnership.

For more details on the Guiding System, consult www.merlin-gerin.com

## A consistent design of offers from Medium Voltage to Low Voltage



Discrimination guarantees co-ordination between the operating characteristics of serial-connected circuit-breakers. Should a fault occurs downstream, only the circuit-breaker placed immediately upstream from the fault will trip.

## Mechanical consistency:

distribution blocks and enclosures.

consistency rules.

**Electrical consistency:** 

Each product adopts dimensional standards simplifying and optimising its use within the system.

All Merlin Gerin offers are designed according

to electrical, mechanical and communication

overall design and shared ergonomics.

(discrimination) or economic optimisation (cascading).

The products express this consistency by their

Each product complies with or enhances system performance at co-ordination level: breaking capacity, lsc, temperature rise, etc. for more safety, continuity of supply

The leading edge technologies employed in Merlin Gerin's Guiding System ensure high performance levels in discrimination and cascading of protection devices, electrodynamic withstand of switches and current distributors, heat loss of devices,

Likewise, inter-product ElectroMagnetic Compatibility (EMC) is guaranteed.

It shares the same accessories and auxiliaries and complies with global ergonomic choices (utilisation mode, operating mode, setting and configuration devices, tools, etc.) making its installation and operation within the system a simpler process.

Direct connection of the Canalis KT busbar trunking on the Masterpact 3200 A circuit breaker.

## Ready

Thanks to the use of standard Web technologies, you can offer your customers intelligent Merlin Gerin switchboards allowing easy access to information: follow-up of currents, voltages, powers, consumption history, etc.

#### Communication consistency:

Each product complies with global choices in terms of communication protocols (Modbus, Ethernet, etc.) for simplified integration in the management, supervision and monitoring systems.

Guiding Tools for more efficient design and implementation of your installations.

## SM6

Medium voltage switchboard system from 1 to 36 kV

## Sepam

**Protection relays** 

### **Masterpact**

**Protection switchgear** from 100 to 6300 A









from 160 to 5000 kVA



Evolis MV vacuum switchgear and components from 1 to 24 kV.

### The Technical guide

These technical guides help you comply with installation standards and rules i.e.: The electrical installation guide, the protection guide, the switchboard implementation guide, the technical booklets and the co-ordination tables all form genuine reference tools for the design of highperformance electrical installations. For example, the LV protection co-ordination guide - discrimination and cascading - optimises choice of protection and connection devices while also increasing markedly continuity of supply in the installations.



#### CAD software and tools

The CAD software and tools enhance productivity and safety. They help you create your installations by simplifying product choice through easy browsing in the Guiding System offers.

Last but not least, they optimise use of our products while also complying with standards and proper procedures.



### Compact


Protection switchgear system from 100 to 630 A

### Multi 9

Modular protection switchgear system up to 125 A

## **Prisma Plus**

Functional system for electrical distribution switchboards up to 3200 A

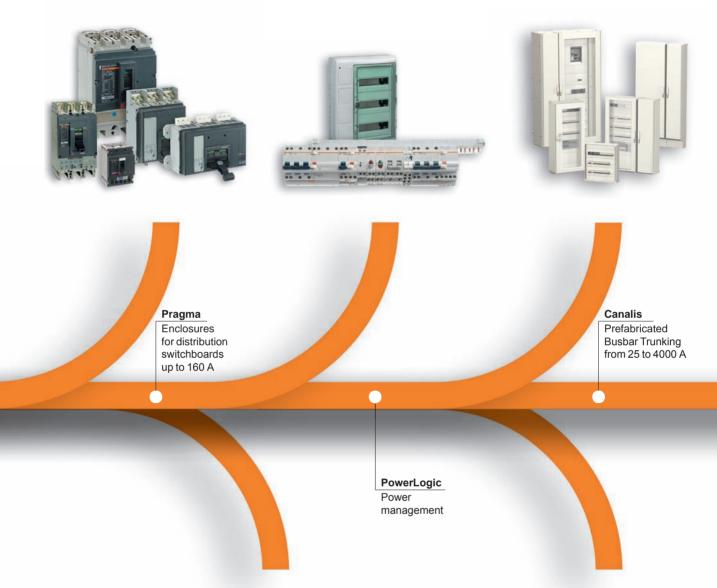

#### Training

Training allows you to acquire the Merlin Gerin expertise (installation design, work with power on, etc.) for increased efficiency and a guarantee of improved customer service.

The training catalogue includes beginner's courses in electrical distribution, knowledge of MV and LV switchgear, operation and maintenance of installations, design of LV installations to give but a few examples.





#### merlin-gerin.com

This international site allows you to access all the Merlin Gerin products in just 2 clicks via comprehensive range data-sheets, with direct links to:

■ complete library: technical documents, catalogs, FAQs, brochures...

■ selection guides from the e-catalog

product discovery sites and their Flash animations.

You will also find illustrated overviews, news to which you can subscribe, the list of country contacts...



# Guiding

## merlin-gerin.com

This international site allows you to access all the Merlin Gerin products in just 2 clicks via comprehensive range data-sheets, with direct links to: complete library: technical documents, catalogs, FAQs, brochures... selection guides from the e-catalog. product discovery sites and their Flash

animations.

You will also find illustrated overviews, news to which you can subscribe, the list of country contacts...



## The technical guide

These technical guides help you comply with installation standards and rules i.e.: the electrical installation guide, the protection guide, the switchboard implementation guide, the technical booklets and the co-ordination tables all form genuine reference tools for the design of high performance electrical installations. For example, the LV protection co-ordination guide - discrimination and cascading - optimises choice of protection and connection devices while also increasing markedly continuity of supply in the installations.



C

## Sepam series 20 Sepam series 40 Sepam series 80

## Introduction

Sepam for greater simplicity	8
Sepam network protection for your peace of mind	9
Sepam offers flexibility to match your needs	10
Sepam to boost productivity	11
Panorama of Sepam applications	12
Selection guide for all applications	13
Substation applications	14
Feeder protection	14
Incomer protection	15
Busbar applications	16
Transformer applications	18
Transformer feeder protection	19
Transformer incomer protection	21
Motor applications	24
Generator applications	28
Capacitor applications	32
Communication networks and protocols	34
Implementation	36
Examples of architectures	37
Available Sepam data	40
Selection table	40
Description	41
Sepam series 20 and Sepam series 40	47
Sepam series 80	85
Additional modules and accessories	139
Order form	217

## Sepam for greater simplicity



## A consistent range of protection relays

The Sepam range of protection relays is designed for all protection applications on medium-voltage public and industrial distribution networks.

It is made up of three series of relays, with increasing performance levels:

- Sepam series 20 for usual applications
- Sepam series 40 for demanding applications
- Sepam series 80 for custom applications.

Sepam, a consistent range of protection relays.




## A multi-functional range of digital relays

Each Sepam series offers all the functions required for the intended application:

- effective protection of life and property
- accurate measurements and detailed diagnosis
- integral equipment control
- local or remote indications and operation.

Integral equipment control by Sepam.



## A Sepam solution for every application

For each electrotechnical application, Sepam offers the relay suited to the protection needs of your network.

The Sepam range covers the following applications:

- substations (incomer or feeder type)
- transformers
- motors
- generators
- busbars
- capacitors.

A Sepam solution for every application.

# Sepam network protection for your peace of mind



Schneider Electric, by your side in over 130 countries.

## Schneider Electric, a global offer

### World leader in Power & Control

The future will call increasingly on electricity with growing needs, new modes of production and new applications. The world leader in electric distribution and automation & control. Schneider Electric

makes electricity safe, as well as facilitating and improving its use.

#### Worldwide presence

With sites on every continent, Schneider Electric contributes to customer performance through its unique selection of products, solutions and services, as well as its dynamic policy of innovation.

#### Continuous, worldwide availability

With over 5000 points of sale in 130 countries, you can be sure of finding the range of products meeting your needs and complying perfectly with local standards.

#### Technical assistance around the globe

Our technicians are always on hand to provide solutions tailored to your needs. Schneider Electric provides all the technical assistance you require, wherever you may be.

Visit the www.merlin-gerin.com site to find contact information for Schneider Electric in your country.

## Schneider Electric, a manufacturer of protection relays

#### Sepam, over 25 years of experience

Breaking new ground back in 1982, Merlin Gerin marketed the first multi-functional digital protection relay, the Sepam 10.

Today, with the Sepam range, you benefit from more than 25 years of experience on the part of our R&D teams.

#### **Installed base**

- 200 000 Sepam relays in over 90 countries
- presence in every sector of activity:
- □ energy: production and distribution
- infrastructures: airports, tunnels, public transport, water treatment
- $\hfill\square$  industry: automobiles, mines, semi-conductors, metallurgy, petrochemicals
- □ commercial sector: shopping centres, hospitals.

## Sepam, guaranteed quality

Protection relays must be totally reliable. That level of reliability is obtained by total quality at every step, from design on through to operation.

 design based on dependability studies and complying with the functional-safety requirements of standard IEC 61508

- development and production certified ISO 9001
- environment-friendly production, certified ISO 14001
- service quality ensured by decentralized logistics and support
   compliance with interactional standards and logal contification
- compliance with international standards and local certification.





Base unit

optional modules

Temperature sensors Low-level analog output Synchro-check module

Software tools

Parameter and protection settings saved on

42 logic inputs and 23 relay outputs with 3

Connection to communication networks

removable memory cartridge

# Sepam offers flexibility to match your needs


1

# Enhancement through the addition of optional modules to keep pace with your ever-changing installation

To adapt to as many situations as possible and allow for future installation upgrades, optional modules may be added to Sepam at any time for new functions.

- plug & play modules, easy to install and connect
- complete setup using software.

50483

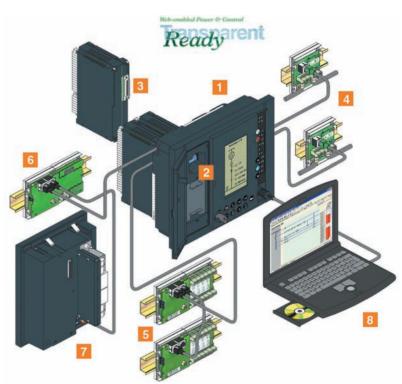

Sepam series 80 and its optional modules.


## A choice of user-machine interfaces (UMI) to meet your operating needs

- advanced UMI for all Sepam relays:
- □ on front panel
- □ or remote UMI installed in the most convenient location for the facility manager
- mimic-based UMI for Sepam series 80, offering local switchgear control.

## A software tool for all Sepam relays

The SFT2841 software is the setting and operating tool for Sepam series 20, series 40 and series 80.

- the ergonomics are designed to guide you in setting up Sepam
- future compatibility is ensured with all Sepam versions.



SFT2841: a single software tool for all Sepam relays

## Sepam to boost productivity



Customized Chinese advanced UMI

## Easy operation


To ensure fast and effective servicing, thereby reducing the operating and maintenance costs of your electric installation, all operating and maintenance information is available:

- locally and remotely
- in your language.

#### Local operation

All the data required for local equipment operation are clearly displayed on the LCD screen of the UMI (User-Machine Interface).

- UMI screens can be translated to your language
- alarms and operating messages can be personalized.



Sepam connection to two communication networks.

#### **Remote operation**

All Sepam relays can be connected to two types of communication networks:
 an S-LAN (supervisory local area network) to remotely control and monitor
 Sepam relays connected to a supervision system (SCADA or RTU)
 an E-LAN (engineering local area network), reserved for Sepam remote
 parameter setting and centralized installation diagnosis using the SFT2841 software.

## Improved continuity of service

With Sepam, all data is available for optimum management and use of the electric installation.

- The clear and complete information supplied by Sepam following a fault trip enables the operator to restore power as quickly as possible.
- Preventive maintenance of switchgear is made easier by the diagnosis functions provided by Sepam.

The predictive information supplied by the motor-protection functions optimises process control.



## **Reduced maintenance costs**

The Sepam range is designed to reduce maintenance time and cost for your protection system.

- Sepam modules and connectors may be removed without any particular precautions.
- The optional modules are the same for the entire Sepam range, thus reducing the stock of replacement parts.
- Sepam series 80 has a removable memory cartridge to simplify maintenance operations.

Sepam series 80 memory cartridge.

## **Panorama of Sepam applications**


The selection guide proposes the Sepam types suited to your protection needs, based on the characteristics of your application.

The most typical applications are presented with the corresponding Sepam and each application example is described by: a single-line diagram indicating: equipment to be protected network configuration position of measurement sensors standard and specific Sepam functions to be implemented to protect the application.

The list of functions is given for information purposes.

Earthing, whether direct or via an impedance, is represented by the same pictogram, i.e. the pictogram corresponding to a direct connection.

## Sepam series 20

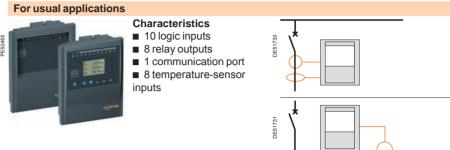

## Sepam series 40


For demanding applications



### Characteristics

- 10 logic inputs8 relay outputs
- logical equation editor
- 1 communication port
- 16 temperature-sensor

inputs




## Sepam series 80


For custom applications


### Characteristics

- 42 logic inputs23 relay outputs
- Iogical equation editor
- 2 communication
   ports for multi-master or redundant architectures
   16 temperature-sensor
- rotemperature-senso inputs
   removable memory cartridge with parameter
- cartridge with parameter and protection settings for fast return to service following replacement
- battery backup to save historical and disturbancerecording data
- mimic-based UMI for local device control under safe conditions

 optional Logipam programming software to program specific functions









## Selection guide for all applications

Protection funct	ions Applications			Applications						
Basic	Specific	Substation	Busbar	Transformer	Motor	Generator	Capacitor			
		600		<b>T</b> 20	MOO					
current protection		S20		T20	M20					
	Breaker failure	S23		T23						
voltage and			B21							
requency protection										
	disconnection by "rate of change of		B22							
	frequency"									
current, voltage and		S40		T40		G40				
requency protection										
	directional earth fault	S41			M41					
	directional earth	640		<b>T</b> 40						
	fault and phase	S42		T42						
	overcurrent									
current, voltage and requency protection		S80	B80							
	directional earth fault	S81		T81	M81					
	directional earth	S82		T82		G82				
	fault and phase overcurrent									
	disconnection by "rate of change of	S84								
	frequency"				1400					
current, voltage and requency protection	transformer-			T87	M88	G88				
	machine unit differential									
	machine differential			_	1407	G87				
	machine unerentiar				M87	607				
current, voltage and	voltage and		B83							
requency protection	frequency protection for two sets of									
	busbars									
current, voltage and	capacitor-bank						C86			
requency protection	unbalance									

## Substation applications

Feeder protection

Protection functions	ANSI code	S20	S23	B22	S40	S41	S42	S80	S81	S82	S84
Phase overcurrent <sup>(1)</sup>	50/51	4	4		4	4	4	8	8	8	8
Earth fault / Sensitive earth fault <sup>(1)</sup>	50N/51N 50G/51G	4	4		4	4	4	8	8	8	8
Breaker failure	50BF		1		1	1	1	1	1	1	1
Negative sequence / unbalance	46	1	1		2	2	2	2	2	2	2
Thermal overload for cables	49RMS								2	2	2
Directional phase overcurrent <sup>(1)</sup>	67						2			2	2
Directional earth fault <sup>(1)</sup>	67N/67NC					2	2		2	2	2
Directional active overpower	32P					1	1		2	2	2
Directional active underpower	37P										2
Positive sequence undervoltage	27D			2				2	2	2	2
Remanent undervoltage	27R			1				2	2	2	2
Undervoltage (L-L or L-N)	27			2/1 (4)	2	2	2	4	4	4	4
Overvoltage (L-L or L-N)	59			2	2	2	2	4	4	4	4
Neutral voltage displacement	59N			2	2	2	2	2	2	2	2
Negative sequence overvoltage	47				1	1	1	2	2	2	2
Overfrequency	81H			1	2	2	2	2	2	2	2
Underfrequency	81L			2	4	4	4	4	4	4	4
Rate of change of frequency	81R			1							2
Recloser (4 cycles) <sup>(2)</sup>	79										
Synchro-check <sup>(3)</sup>	25					1					

The figures indicate the number of units available for each protection function

■ standard, □ options.

(1) Protection functions with 2 groups of settings.


(2) According to parameter setting and optional input/output modules.


(3) With optional MCS025 synchro-check module.


(4) 2 undervoltage (L-L) and 1 undervoltage (L-N).

#### **Feeder protection**


feeder short-circuit and overload protection.



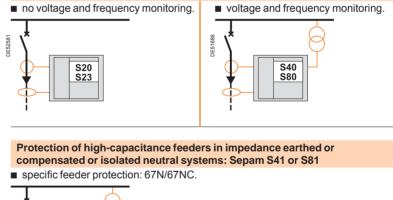



## Substation applications Incomer protection

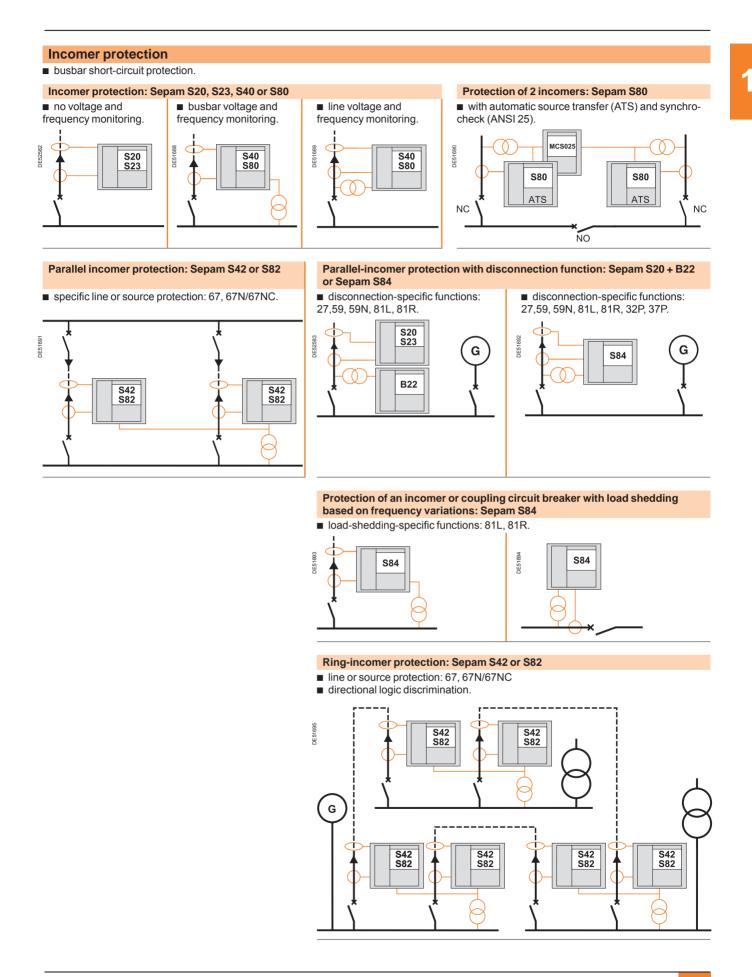


## **Busbar applications**

Protection functions	ANSI code	B21	B22	B80	B83
Phase overcurrent <sup>(1)</sup>	50/51			8	8
Earth fault / Sensitive earth fault <sup>(1)</sup>	50N/51N 50G/51G			8	8
Breaker failure	50BF			1	1
Negative sequence / unbalance	46			2	2
Positive sequence undervoltage	27D	2	2	2	2
Remanent undervoltage	27R	1	1	2	2
Undervoltage (L-L or L-N)	27	2/1 <sup>(3)</sup>	2/1 <sup>(3)</sup>	4	4
Overvoltage (L-L or L-N)	59	2	2	4	4
Neutral voltage displacement	59N	2	2	2	2
Negative sequence overvoltage	47			2	2
Overfrequency	81H	1	1	2	2
Underfrequency	81L	2	2	4	4
Rate of change of frequency	81R		1		
Synchro-check <sup>(2)</sup>	25				

The figures indicate the number of units available for each protection function

a standard, □ options.
(1) Protection functions with 2 groups of settings.
(2) With optional MCS025 synchro-check module.
(3) 2 undervoltage (L-L) and 1 undervoltage (L-N).

## **Busbar applications**

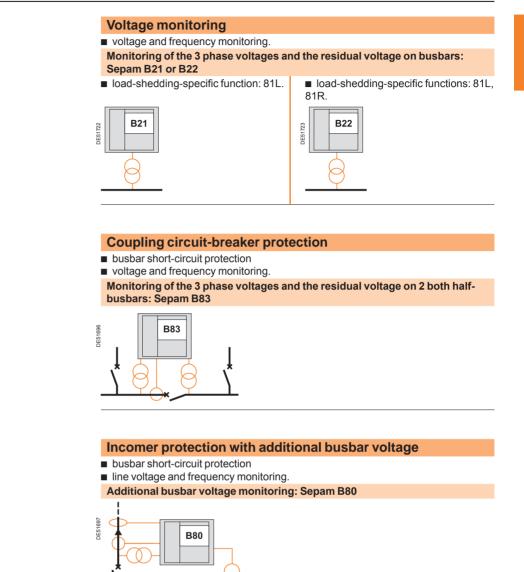

## **Transformer applications**

Standard transformer application diagrams do not take voltage levels into account: the transformer primary winding is always at the top

■ the transformer secondary winding is always at the bottom.

The transformer primary and secondary windings need to be protected. The Sepam proposed can be installed on either the primary or secondary winding of the transformer.

The other winding can be protected by an incomer or feeder type substation application Sepam.

Protection functions	ANSI	T20	T23	T40	T42	T81	T82	T87
	code							
Phase overcurrent <sup>(1)</sup>	50/51	4	4	4	4	8	8	8
Earth fault / Sensitive earth fault <sup>(1)</sup>	50N/51N 50G/51G	4	4	4	4	8	8	8
Breaker failure	50BF		1	1	1	1	1	1
Negative sequence / unbalance	46	1	1	2	2	2	2	2
Thermal overload for machines <sup>(1)</sup>	49RMS	2	2	2	2	2	2	2
Restricted earth fault differential	64REF					2	2	2
Two-winding transformer differential	87T							1
Directional phase overcurrent <sup>(1)</sup>	67				2		2	2
Directional earth fault <sup>(1)</sup>	67N/67NC				2	2	2	2
Directional active overpower	32P					2	2	2
Overfluxing (V / Hz)	24							2
Positive sequence undervoltage	27D					2	2	2
Remanent undervoltage	27R					2	2	2
Undervoltage (L-L or L-N)	27			2	2	4	4	4
Overvoltage (L-L or L-N)	59			2	2	4	4	4
Neutral voltage displacement	59N			2	2	2	2	2
Negative sequence overvoltage	47			1	1	2	2	2
Overfrequency	81H			2	2	2	2	2
Underfrequency	81L			4	4	4	4	4
Thermostat / Buchholz <sup>(2)</sup>	26/63							
Temperature monitoring (16 RTDs) <sup>(3)</sup>	38/49T	□ 8 RTDs	□ 8 RTDs	□ 16 RTDs	□ 16 RTDs	□ 16 RTDs	□ 16 RTDs	□ 16 RTDs
Synchro-check (4)	25							

The figures indicate the number of units available for each protection function

■ standard, □ options.

(1) Protection functions with 2 groups of settings.
(2) According to parameter setting and optional input/output modules.
(3) With optional MET148-2 temperature input modules.


(4) With optional MCS025 synchro-check module.

## **Transformer applications** Transformer feeder protection


#### **Transformer feeder protection**

- transformer short-circuit and overload protection
- internal transformer protection: Thermostat / Buchholz (ANSI 26/63)
- RTD temperature monitoring (ANSI 49T).

#### Transformer feeder protection without voltage monitoring: Sepam T20, T23

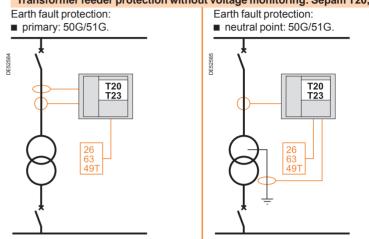


Transformer feeder protection with voltage monitoring: Sepam T40 or T81 Earth fault protection:




Note: for long feeders, the 50G/51G function may be replaced by the 67N/67NC.

## **Transformer applications** Transformer feeder protection

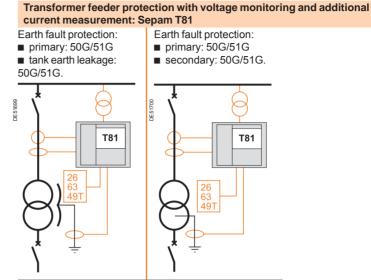

Note: for long feeders, the 50G/51G function may be replaced by the 67N/67NC.


### Transformer feeder differential protection: Sepam T87

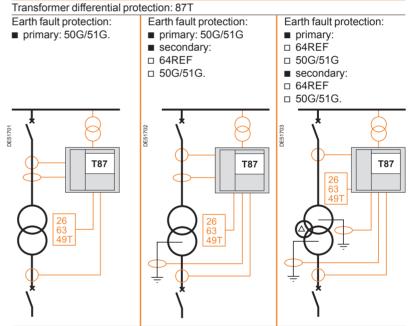


## **Transformer applications** Transformer incomer protection

### **Transformer incomer protection**


- transformer short-circuit and overload protection
- internal transformer protection: Thermostat / Buchholz (ANSI 26/63)
- RTD temperature monitoring (ANSI 49T).

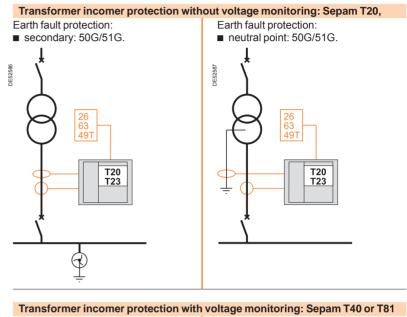












## **Transformer applications** Transformer incomer protection



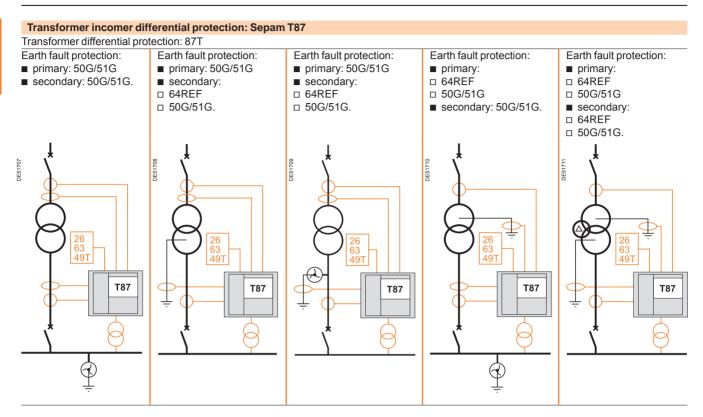


#### Protection of 2 non-coupled transformer incomers: Sepam T81



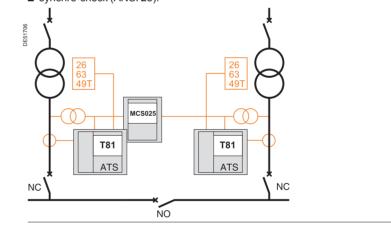


Merlin Ge<u>rin</u>

## **Transformer applications** Transformer incomer protection

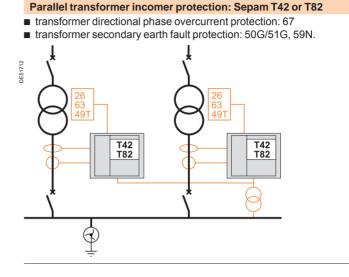


- transformer directional phase overcurrent protection: 67
- transformer secondary earth fault protection: 67N/67NC, 64REF
- with synchro-check (ANSI 25).



#### Parallel incomer differential protection: Sepam T87

- transformer differential protection: 87T
- directional transformer protection: 67
- transformer secondary earth fault protection: 50G/51G, 67N/67NC 64REF.



## **Motor applications**

Protection functions	ANSI code	M20	M41	M81	M87	M88
Phase overcurrent <sup>(1)</sup>	50/51	4	4	8	8	8
Earth fault /	50N/51N	4	4	8	8	8
Sensitive earth fault <sup>(1)</sup>	50G/51G		1	1	1	1
Breaker failure	50BF		· ·	· ·	· ·	·
Negative sequence / unbalance	46	1	2	2	2	2
Thermal overload for machines <sup>(1)</sup>	49RMS	2	2	2	2	2
Two-winding transformer differential	87T					1
Machine differential	87M				1	
Directional earth fault <sup>(1)</sup>	67N/67NC		2	2	2	2
Directional active overpower	32P		1	2	2	2
Directional reactive overpower	32Q/40		1	1	1	1
Field loss (underimpedance)	40			1	1	1
Phase undercurrent	37	1	1	1	1	1
Excessive starting time, locked rotor	48/51LR/14	1	1	1	1	1
Starts per hour	66	1	1	1	1	1
Loss of synchronization	78PS			1	1	1
Overspeed (2 set points) <sup>(2)</sup>	12					
Underspeed (2 set points) <sup>(2)</sup>	14					
Positive sequence undervoltage	27D		2	2	2	2
Remanent undervoltage	27R		1	2	2	2
Undervoltage (L-L or L-N)	27		2	4	4	4
Overvoltage (L-L or L-N)	59		2	4	4	4
Neutral voltage displacement	59N		2	2	2	2
Negative sequence overvoltage	47		1	2	2	2
Overfrequency	81H		2	2	2	2
Underfrequency	81L		4	4	4	4
Thermostat / Buchholz	26/63					
Temperature monitoring (16 RTDs) <sup>(3)</sup>	38/49T	□ 8 RTDs	□ 16 RTDs	□ 16 RTDs	□ 16 RTDs	□ 16 RTDs

The figures indicate the number of units available for each protection function ■ standard, □ options.


(1) Protection functions with 2 groups of settings.
(2) According to parameter setting and optional input/output modules.
(3) With optional MET148-2 temperature input modules.

## **Motor applications**


### **Motor protection**

- internal motor fault protection
- power supply fault protection
- driven load fault protection
- RTD temperature monitoring (ANSI 38/49T).

#### Motor protection without voltage monitoring: Sepam M20

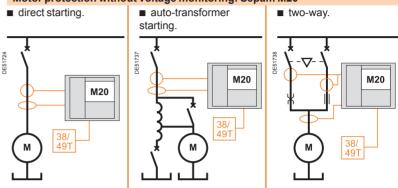

#### Motor protection with voltage monitoring: Sepam M41 or M81

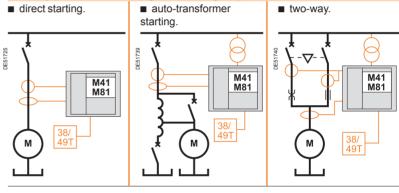

Motor differential protection: Sepam M87 Phase protection by Motor differential protection: 87M. self-balancing-differential scheme: 50/51. direct starting. auto-transformer direct starting. starting. DE51742 DE51743 DE51741 M87 M87 M87 38/ 491 38/ 49T 38/ 491 М Μ Μ

## **Motor applications**


#### Motor-transformer unit protection

- motor and transformer protection against internal faults
- power supply fault protection
- driven load fault protection
- internal transformer protection: Thermostat / Buchholz (ANSI 26/63)
- RTD temperature monitoring (ANSI 38/49T).

### Motor-transformer unit protection without voltage monitoring: Sepam M20


■ transformer primary earth fault protection: 50G/51G.

Note: monitoring of motor insulation must be ensured by another device.



#### Motor-transformer unit protection with voltage monitoring: Sepam M41


- motor earth fault protection: 59N
- transformer primary earth fault protection: 50G/51G.



#### Motor-transformer unit protection with voltage and transformer monitoring: Sepam M81


- motor earth fault protection: 59N
   transformer primary earth fault
- protection: 50G/51G ■ transformer monitoring: Buchholz,

thermostat, temperature measurement.




 motor earth fault protection: 50G/51G
 transformer primary earth fault protection: 50G/51G

 transformer monitoring: Buchholz, thermostat, temperature measurement.



## **Motor applications**

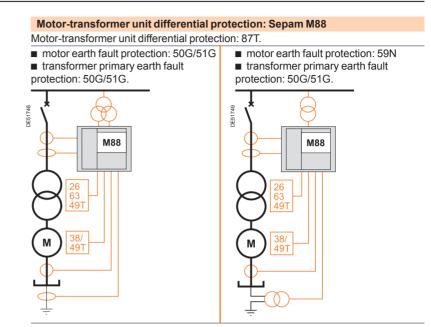

## **Generator applications**

Protection functions	ANSI	G40	G82	G87	G88
	code				
Phase overcurrent <sup>(1)</sup>	50/51	4	8	8	8
Earth fault / Sensitive earth fault <sup>(1)</sup>	50N/51N 50G/51G	4	8	8	8
Breaker failure	50BF	1	1	1	1
Negative sequence / unbalance	46	2	2	2	2
Thermal overload for machines <sup>(1)</sup>	49RMS	2	2	2	2
Restricted earth fault differential	64REF		2		2
Two-winding transformer differential	87T				1
Machine differential	87M			1	
Directional phase overcurrent <sup>(1)</sup>	67		2	2	2
Directional earth fault <sup>(1)</sup>	67N/67NC		2	2	2
Directional active overpower	32P	1	2	2	2
Directional reactive overpower	32Q/40	1	1	1	1
Directional active underpower	37P		2		
Field loss (underimpedance)	40		1	1	1
Loss of synchronization	78PS		1	1	1
Overspeed (2 set points) <sup>(2)</sup>	12				
Underspeed (2 set points) <sup>(2)</sup>	14				
Voltage-restrained phase overcurrent	50V/51V	1	2	2	2
Underimpedance	21B		1	1	1
Inadvertent energization	50/27		1	1	1
Third harmonic undervoltage /	27TN/64G2		2	2	2
100% stator earth fault	64G		-	-	
Overfluxing (V / Hz)	24		2	2	2
Positive sequence undervoltage	27D		2	2	2
Remanent undervoltage	27R	-	2	2	2
Undervoltage (L-L or L-N)	27	2	4	4	4
Overvoltage (L-L or L-N)	59	2	4	4	4
Neutral voltage displacement	59N	2	2	2	2
Negative sequence overvoltage	47	1	2	2	2
Overfrequency	81H	2	2	2	2
Underfrequency	81L	4	4	4	4
Thermostat / Buchholz	26/63				
Temperature monitoring (16 RTDs) <sup>(3)</sup>	38/49T	□ 16 RTDs	□ 16 RTDs	□ 16 RTDs	□ 16 RTDs
Synchro-check (4)	25				

The figures indicate the number of units available for each protection function

The figures indicate the number of units available for each protection in a standard, 


options.
(1) Protection functions with 2 groups of settings.
(2) According to parameter setting and optional input/output modules.
(3) With optional MET148-2 temperature input modules.
(4) With optional MCS025 synchro-check module.

## **Generator applications**

#### **Generator protection**


- internal generator fault protection
- network fault protection
- driving machine fault protection
- RTD temperature monitoring (ANSI 38/49T)
- voltage and frequency monitoring.

#### Protection of a separate generator: Sepam G40

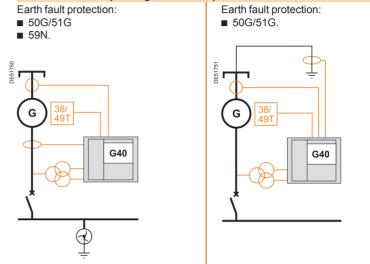


#### Protection of a generator coupled to other generators or to a network: Sepam G82

Short-circuit detection on generator side: 67.

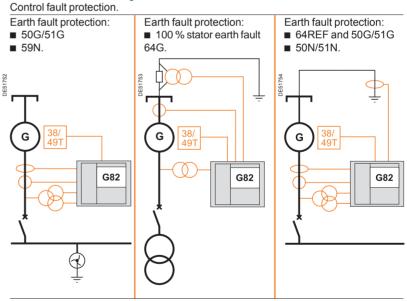

## **Generator applications**

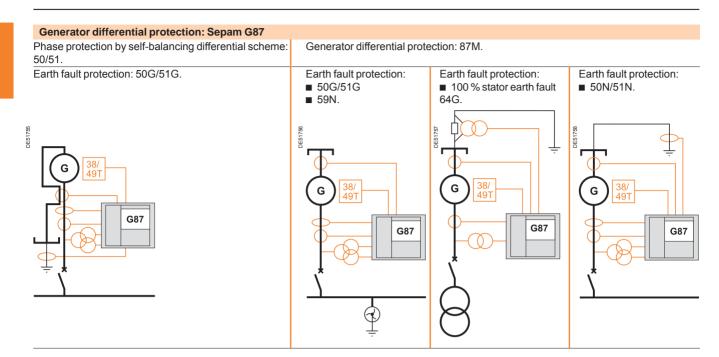

#### Generator-transformer unit protection


- generator and transformer protection against internal faults
- network fault protection
- driving machine fault protection
- RTD temperature monitoring (ANSI 38/49T)
- voltage and frequency monitoring.

#### Separate generator-transformer unit protection. Sepam G40

Earth fault protection:


■ 50G/51G.

Note: monitoring of generator insulation must be ensured by another device.





## **Generator applications**

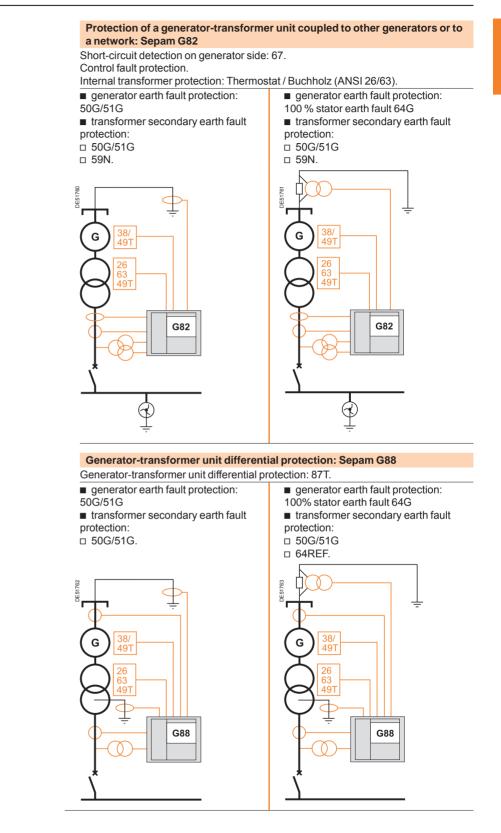

## **Capacitor applications**

		7	
	/		
r	2		

Protection functions	ANSI code	S20	S23	S40	C86
Phase overcurrent <sup>(1)</sup>	50/51	4	4	4	8
Earth fault / Sensitive earth fault <sup>(1)</sup>	50N/51N 50G/51G	4	4	4	8
Breaker failure	50BF		1	1	1
Negative sequence / unbalance	46	1	1	2	2
Thermal overload for capacitors <sup>(1)</sup>	49RMS				2
Capacitor-bank unbalance	51C				8
Positive sequence undervoltage	27D				2
Remanent undervoltage	27R				2
Undervoltage (L-L or L-N)	27			2	4
Overvoltage (L-L or L-N)	59			2	4
Neutral voltage displacement	59N			2	2
Negative sequence overvoltage	47			1	2
Overfrequency	81H			2	2
Underfrequency	81L			4	4
Temperature monitoring (16 RTDs) <sup>(2)</sup>	38/49T				□ 16 RTDs


The figures indicate the number of units available for each protection function
standard, □ options.
(1) Protection functions with 2 groups of settings.
(2) With optional MET148-2 temperature input modules.

## **Capacitor applications**

#### **Capacitor bank protection**


## Protection of a capacitor bank (delta connection) without voltage monitoring: Sepam S20, S23

capacitor bank short-circuit protection.




## Protection of a capacitor bank (delta connection) with voltage monitoring: Sepam S40 or C86

- capacitor bank short-circuit protection
- voltage and frequency monitoring
- overload protection: ANSI 49RMS (Sepam C86 only).




## Protection of a double-star connected capacitor bank with 1 to 4 steps: Sepam C86 $\,$

- capacitor bank short-circuit protection
- voltage and frequency monitoring
- specific overload protection, self-adapted to the number of connected steps
- unbalance protection: 51C.

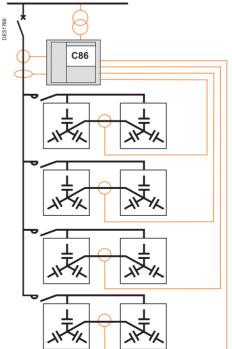

# Communication networks and protocols

All Sepam relays communicate and can be integrated in a communication architecture. All Sepam information can be accessed remotely.



Sepam connection to two communication networks (S-LAN and E-LAN).

## Two types of communication network

Sepam relays can be connected to two types of networks, thus providing access to different types of information:

- a supervisory local area network or S-LAN
- an engineering local area network or E-LAN.

Examples of communication architectures are presented on pages 36 and 37.

#### Supervisory local area network (S-LAN)

An S-LAN is used for supervision functions concerning the installation and the electric network. It can be used to connect a set of communicating devices using the same communication protocol to a centralized supervision system. Sepam can be connected to an S-LAN using one of the following communication protocols:

- Modbus RTU
- Modbus TCP/IP
- DNP3
- IEC 60870-5-103
- IEC 61850

#### Engineering local area network (E-LAN)

An E-LAN is intended for Sepam parameter-setting and operating functions. It can be used to connect a set of Sepam units to a PC running the SFT2841 software. In this configuration, the operator has remote and centralized access to all Sepam information, with no need to develop any special communication software. The operator can easily:

- set up the Sepam general parameters and functions
- collect all Sepam operating and diagnostics information
- manage the protection system for the electric network
- monitor the status of the electric network
- run diagnostics on any incidents affecting the electric network.

## **Communication protocols**

#### Modbus RTU

Modbus RTU is a data-transmission protocol, a de facto standard since 1979 widely used in industry and accepted by many communicating devices. For more information on the Modbus RTU protocol, visit www.modbus.org.

#### Modbus TCP/IP

The Modbus TCP/IP communication protocol offers the same functions as Modbus RTU as well as compatibility with multi-master architectures

#### DNP3

DNP3 is a data-transmission protocol specially suited to the needs of distributors for remote control/monitoring of substations in the electric network. For more information on the DNP3 protocol, visit www.dnp.org.

#### IEC 60870-5-103

IEC 60870-5-103 is an accompanying standard for the standards in the IEC 60870-5 series. It defines communication between protection devices and the various devices in a control system (supervisor or RTU) in a substation. For more information on the IEC 60870-5-103 protocol, visit www.iec.ch.

#### **IEC 61850**

The standards in the IEC 61850 series define a protocol for communication in electrical substations. The Ethernet-based protocol offers advanced characteristics and interoperability between multi-vendor devices.

The Sepam relay handles the station bus, in compliance with standards IEC 61850-6, 7-1, 7-2, 7-3, 7-4 and 8-1.

For more information on the IEC 61850 protocol, visit www.iec.ch.

# Communication networks and protocols

## 1

### Other protocols

A gateway / protocol converter must be used to connect Sepam to a communication network based on other protocols.

### IEC 60870-5-101

The CN1000 gateway developed by EuroSystem enables Sepam connection to IEC 60870-5-101 networks.

This gateway is quick and simple to implement using the supplied configuration software integrating all Sepam parameters.

For more information on the CN1000 gateway, visit www.euro-system.fr.

### Implementation



A complete range of Sepam communication interfaces





Access to Sepam information via a web browser.

### Sepam communication interfaces

#### A complete range of accessories

Sepam connects to a communication network via a communication interface. Selection of the interface depends on the communication architecture:

- number of networks to be connected:
- 1 network, S-LAN or E-LAN
- □ 2 networks, S-LAN and E-LAN
- communication protocol selected for the S-LAN: Modbus RTU, DNP3,
- IEC 60870-5-103 or IEC 61850
- network physical interface:
- □ 2-wire or 4-wire RS485
- □ Ethernet
- □ fiber optic, with star or ring architecture.

Sepam communication interfaces are presented in detail on page 179.

#### **Direct Sepam connection to the Ethernet network**

Sepam series 40 and Sepam series 80 units can be directly connected to the Ethernet network via the ACE 850 communication interface. In this way they make full use of Ethernet network performance and all IEC 61850 functions.

- Compatible communication protocols:
- □ Modbus TCP/IP
- □ IEC 61850
- Network physical interface:
- □ 10 baseT /100 base TX (star architecture)
- □ 100 base FX (star architecture).

#### **Easy implementation**

The communication interfaces are remote modules that are easy to install and connect.

The SFT2841 software is used for complete setup of the communication interfaces:

- protocol selection and setup of the functions specific to each protocol
- setup of the physical interface.

#### Advanced configuration of IEC 61850 protocol

The SFT850 software is used for advanced configuration of the IEC 61850 protocol for both the ECI850 server and the ACE850 communication interface:

- complete Sepam-configuration database (.icd)
- processing of system-configuration files (.scd)
- creation and processing of ECI850 and ACE850 configuration files (.cid).

#### Sepam IEC 61850 server

The entire Sepam range can be connected to an IEC 61850 system via the Sepam ECI850 server, representing the most economical solution. The server also ensures compatibility with the E-LAN network.

#### Ethernet gateways in a Modbus environment

Sepam can be connected to an Ethernet TCP/IP network in a totally transparent manner via the EGX100 gateway or the EGX400 server.

#### EGX100 gateway

The EGX100 offers access to enhanced communication and multi-master architectures. It provides IP (Internet Protocol) connection for communication on all types of networks, notably intranets and internet.

#### EGX400 server


In addition to Ethernet TCP/IP connection, the EGX400 offers a web server and HTML pages designed specially to present the essential Sepam information. This information may be accessed in clear text and at no risk on any PC connected to the intranet/internet and equipped with a web browser.


### **Examples of architectures**


Seven typical communication architectures are presented in the examples below. Each architecture is presented with:


- a simplified diagram
- the characteristics of the implemented networks.

The physical architecture of the communication networks and the connection to networks depends on the type of network (RS485 or fiber optic) and the communication interfaces used. Sepam communication interfaces are presented in detail on page 160.

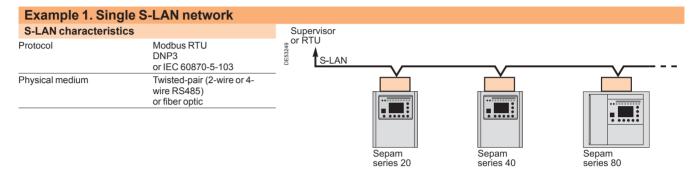


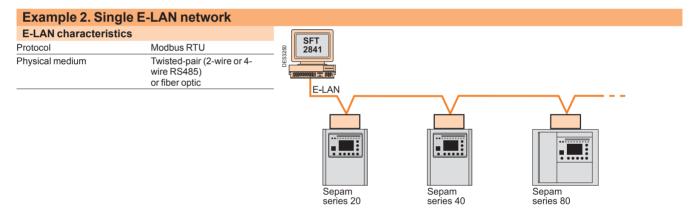

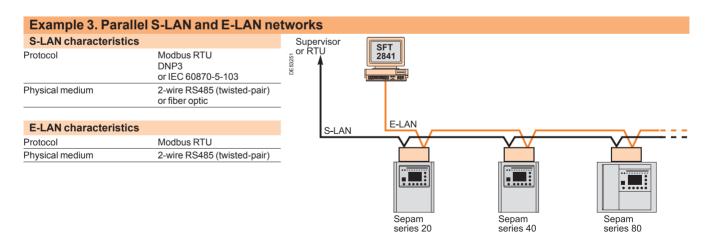


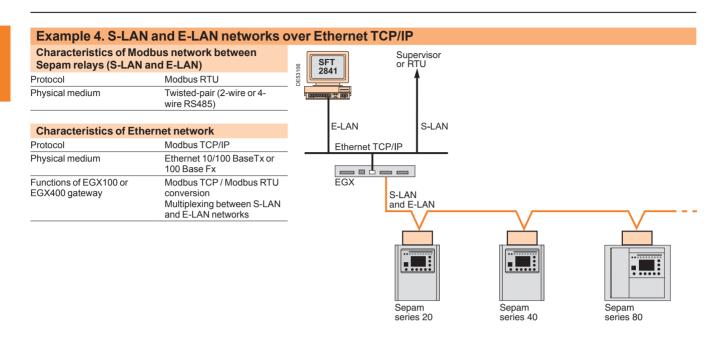


#### Example 5. Two parallel S-LAN networks (Sepam series 80)

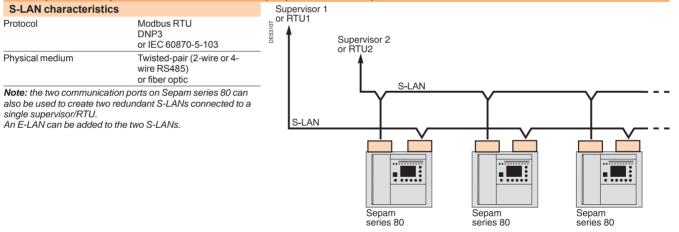

# **Examples of architectures**

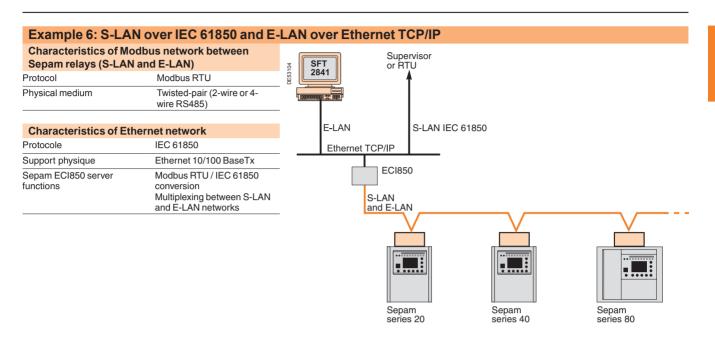

#### Example 7: S-LAN over IEC 61850 and E-LAN over Ethernet TCP/IP (Sepam series 80)

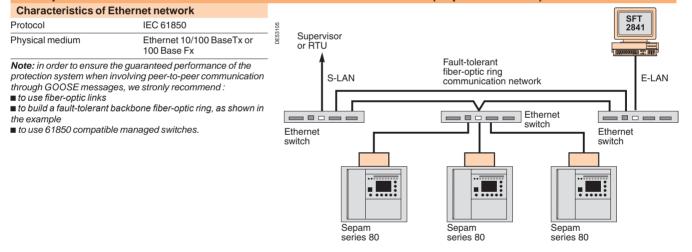

### Available Sepam data Selection table

	Modb	us RTU		DNP3				IEC 60870-5-103		IEC 61	850	
	series 20	series 40	series 80	series 20	series 40	series 80	series 20	series 40	series 80	EC1850*	series 40	series 80
Data transmitted f	rom Se	pam to	the sup	ervisor								
Metering and diagnosis	S											
Veasurements	•			•			•			•		
Energy												
Network diagnosis				•						(1)	(1)	(1)
Vachine diagnosis										(1)	(1)	(1)
Switchgear diagnosis										(1)	(1)	(1)
Sepam diagnosis				1 C C								
_ogipam counters												
Remote indications												
Alarms and internal status conditions	•	•	•	•	•	•	-	•	•	(1)	(1)	(1)
_ogic inputs				10 C						(1)	(1)	(1)
		-	-							(1)	(1)	(1)
ogic equations										(1)	(1) 	(1)
	om the	-		Sanara		-		_			_	_
Data transmitted f						_						
Pulse-type remote-control orders, in direct mode	•	•	•		•	•	•	•	•	(1)	(1)	(1)
<sup>D</sup> ulse-type remote-control orders, in "Select Before Operate" mode				·		•				(1)	(1)	(1)
Maintained remote-control orders (for Logipam)			•								•	•
Remote control security												
Data accessible vi	a speci	ial funct	tions									
	a opco	arrano										
Time-tagging												
Fime-tagged events	-	-	-	6 - E	-		-	-		÷	-	-
Unsollicited events				÷	-					÷	÷	-
Fime-setting and synchronization	•	•	•	<u> </u>	•	•	•	•	•	Ľ.,	•	•
Remote setting												
Selection of the protection- setting group	•							•				
Reading/writing of protection settings												
Reading of general parameters	•	-	•									
Reading/writing of analog output (MSA141)	-	•	•	·	•	•					•	•
Network diagnosis												
Fransfer of disturbance- ecording data	•	•	•	•	•		•	•	•	•	•	•
ripping contexts											(1)	(1)
Dut-of-sync context					-						(1)	(1)
Miscellaneous												
dentification of Sepam				•						<b>.</b>		
Peer-to-peer data												
Protection related												
ogic discrimination												
nter-tripping												
ast load-shedding												•
User-defined												
ogipam contacts												

\*To or from the Sepam series 80, series 40 and series 20 units, depending on the case. (1) Depending on the modelling of the IEC 61850 logic nodes.

# Data transmitted from Sepam to the supervisor

#### Metering and diagnosis

The values measured by Sepam that may be remote accessed are divided into the following categories:

- measurements: currents, voltages, frequency, power, temperatures, etc.
- energy: calculated or pulse-type energy counters
- network diagnosis: phase displacement, tripping currents, unbalance ratio, etc.
- machine diagnosis: temperature rise, motor starting time, remaining operating time before overload tripping, waiting time after tripping, etc.
- switchgear diagnosis: cumulative breaking current, operating time and number of operations, circuit breaker charging time, etc.
- Sepam diagnosis: partial or major fault, etc.
- Logipam counters.

#### **Remote indications**

The logic-state information that may be remote accessed are divided into the following categories:

- alarms and internal status conditions
- status of logic inputs
- status of logic outputs
- status of nine LEDs on the front panel of Sepam
- status of logic-equation output bits.

#### Alarms and internal status conditions

The alarms and internal status conditions are remote indications (TS) pre-assigned to protection and control functions.

Remote indications depend on the type of Sepam and can be re-assigned by Logipam.

The remote indications that can be accessed via the communication link include:

- all protection-function alarms
- monitoring-function alarms: CT or VT fault, control fault
- Sepam status data:
- Sepam not reset
- □ remote setting inhibited, remote-control orders inhibited
- status data on the following functions:
- □ recloser: in service / inhibited, reclosing in progress / successful, permanent trip
- □ disturbance recording: records inhibited / stored.

# Data transmitted from the supervisor to Sepam

#### Pulse-type remote-control orders

Pulse-type remote-control orders (TC) may be carried out in two modes (selected by parameter setting):

- direct mode
- confirmed SBO (select before operate) mode.

Remote-control orders are pre-assigned to metering, protection and control functions and depend on the type of Sepam.

They are used for the following, in particular:

- to control breaking device opening and closing
- to reset Sepam and initialize peak-demand measurements
- to select the active group of settings by enabling group A or B
- to inhibit or enable the following functions: recloser, thermal overload protection, disturbance recording.

Remote-control orders can be re-assigned by Logipam.

#### **Remote-control security**

Transmission of Sepam series 80 remote controls and settings over a Modbus S-LAN can be password protected.

### 1

#### IEC 61850 logical nodes

Sepam supports IEC 61850 logical nodes as indicated in the following table. Note that the actual instantiation of each logical node depends on the application

Nodes		Sepam series 20 <sup>Busbar</sup>	Sepam series 20 Others	Sepam series 40	Sepam series 80
L: systen	n logical nodes				
LPHD	Physical device information	•			
LLN0	Logical node zero	•	•	•	•
P: logical	I nodes for protection functions				
PDIF	Differential				
PDOP	Directional overpower				
PDUP	Directional underpower				
PFRC	Rate of change of frequency	•			
PHIZ	Ground detector				
PMRI	Motor restart inhibition				
PMSS	Motor starting time supervision		•		
PSDE	Sensitive directional earth fault				
РТОС	Time overcurrent				
PTOF	Overfrequency	•			•
PTOV	Overvoltage	•			
PTRC	Protection trip conditioning		•		
PTTR	Thermal overload		•		
PTUC	Undercurrent				
PTUV	Undervoltage	•			
PTUF	Underfrequency				
PVOC	Voltage controlled time overcurrent				
PVPH	Volts per Hz				
PZSU	Zero speed or underspeed				
R: logica	I nodes for protection related functions				
RBRF	Breaker failure				
RREC	Autoreclosing		•		
RSYN	Synchronism-check or synchronizing				
C: logica	I nodes for control				
CSWI	Switch controller				
GG · logic	cal nodes for generic references	_	-	-	_
GGIO	Generic process I/O				
	al nodes for metering and measurement	•	-	-	-
MHAI	Harmonics or interharmonics				
MMTR	Metering				-
MMXU	Measurement				
MSQI	Sequence and imbalance		•		
MSTA	•				
	Metering statistics				
	I nodes for switchgear				
XCBR	Circuit breaker	•	•	•	•
•	I nodes for further power system equipment				
ZCAP	Capacitor bank				

#### IEC 61850 GOOSE messages

GOOSE messages allows peer-to-peer communication between protection devices in a standardized way.

Sepam series 80 with ACE850 communication module supports GOOSE messages for:

- improved system protection:
- □ logic discrimination
- □ inter-tripping
- improved system control:
- □ user-defined Logipam contacts.

High level of performance and security of these messages is ensured by:

- use of fiber optic data link
- use of IEC 61850 compatible managed switches Ethernet
- selection of a fault-tolerant communication architecture.

### **Time-tagging**

#### **Time-tagged events**

The time-tagging function assigns a date and precise time to status changes (events) so that they can be accurately organized over time.

- Sepam systematically time-tags the following events:
- status changes of all logic inputs
- status changes of all remote indications (TS alarms and internal status conditions).

Each event is time-tagged to within one millisecond.

The number of stacks of time-tagged events managed by Sepam on each communication port and the volume of each stack in terms of the numbers of events depend on the communication protocol used.

	Modbus RTU	DNP3	IEC 60870-5-103	IEC 61850
Number of event stacks for each Sepam communication port	2	1	1	Depending on configuration
Number of events per stack	64	100	100	Depending on configuration

Whatever the communication protocol used, Modbus RTU, DNP3, IEC 60870-5-103 or IEC 61850 events may be used by a remote monitoring and control system for data logging and histories, for example.

#### **Unsollicited events**

Using the DNP3 and IEC 61850 protocols, Sepam can spontaneously transmit timetagged events to the supervisor. The transmission of unsollicited events must be activated during setup.

#### Time-setting and synchronization

The Sepam internal clock manages the date and time.

- Time-setting is possible:
- via the Sepam display
- using the SFT2841 software
- via the communication link.

To ensure long-term time stability or to coordinate a number of devices, Sepam units can be synchronized:

- by an external pulse to a dedicated logic input
- via the communication link.

### **Remote setting**

#### Sepam parameter and protection settings

- The following remote-setting functions are available:
- selection of the protection-setting group
- reading of general parameters
- reading of protection settings (remote reading)
   writing of protection settings (remote setting).

The writing of protection settings may be inhibited by parameter setting.

#### S-LAN and E-LAN networks

The availability of remote-setting functions over the S-LAN depends on the communication protocol used.

All remote-setting functions are available over the E-LAN using the SFT2841 software.

### Other data accessible via special functions

#### **Network diagnosis**

The network diagnostic information recorded in files by Sepam can also be transmitted over the communication link:

- disturbance-recording records in COMTRADE format
- tripping contexts
- Out-of-sync context.

#### **Identification of Sepam**

The identification function enables the supervisor to clearly identify the device connected to the S-LAN, based on the following elements of information:

- manufacturer identification
- Sepam type.
- This function is available for all Sepam relays, whatever the protocol used.

# Guiding

### merlin-gerin.com

This international site allows you to access all the Merlin Gerin products in just 2 clicks via comprehensive range data-sheets, with direct links to:

 complete library: technical documents, catalogs, FAQs, brochures...
 selection guides from the e-catalog.
 product discovery sites and their Flash animations.

You will also find illustrated overviews, news to which you can subscribe, the list of country contacts...

The second second	The Gerding System reservation
9 	Construction of the second sec

(

# CAD software and tools

The CAD software and tools enhance productivity and safety. They help you create your installations by simplifying product choice through easy browsing in the Guiding System offers. Last but not least, they optimise use of our products while also complying with standards and proper procedures.



Sepam series 20 Sepam series 40 Sepam series 80

# Sepam series 20 and Sepam series 40

Introduction	7
Sepam series 20 - Sepam series 40	48
Selection table Sepam series 20	48
Selection table Sepam series 40	49
Sensor inputs	50
General settings	51
Metering and diagnosis	52
Description	52
Characteristics	55
Protection	56
Description	56
Main characteristics	60
Setting ranges	61
Control and monitoring	64
Description	64
Description of predefined functions Adaptation of predefined functions using the SFT2841 software	65 67
Adaptation of predenined functions using the SFT204T software	07
Characteristics	68
Base unit	68
Presentation	68
Dimensions	71
Description Technical characteristics	72 74
Environmental characteristics	74
	75
Connection diagrams	76
Base unit	76
Sepam series 20	76
Sepam series 40	77
Other phase current input connection schemes Other residual current input connection schemes	78 79
Voltage inputs Sepam series 20	<b>81</b> 81
Sepam series 40	82
Sepam series 80 Additional modules and accessories	85 120
Order form	139 217
ordonom	211

# **Selection table** Sepam series 20

		Substation		Transformer		Motor	Busbar	
Protection	ANSI code	S20	S23	T20	T23	M20	B21 <sup>(3)</sup>	B22
Phase overcurrent	50/51	4	4	4	4	4	521	DLL
Earth fault / Sensitive earth fault	50N/51N 50G/51G	4	4	4	4	4		
Breaker failure	50BF		1		1			
Vegative sequence / unbalance	46	1	1	1	1	1		
hermal overload	49RMS			2	2	2		
Phase undercurrent	37					1		
Excessive starting time, locked rotor	48/51LR/14					1		
Starts per hour	66					1		
Positive sequence undervoltage	27D/47						2	2
Remanent undervoltage	27R						1	1
Phase-to-phase undervoltage	27						2	2
Phase-to-neutral undervoltage	27S						1	1
Phase-to-phase overvoltage	59						2	2
Veutral voltage displacement	59N						2	2
Dverfrequency	81H						1	1
Jnderfrequency	81L						2	2
Rate of change of frequency	81R							1
Recloser (4 cycles)	79							
Thermostat / Buchholz	26/63							
Temperature monitoring (8 RTDs)	38/49T			_				
Metering								
Phase current I1, I2, I3 RMS, residual current	10			1 C C				
Demand current 11, 12, 13, peak demand current		-		12 - T		- C		
/oltage U21, U32, U13, V1, V2, V3, residual		-	-		-	-		
Positive sequence voltage Vd / rotation direct							12 - T	
Frequency							12 - T	-
requerey							-	-
Network and machine diagn	osis							
Fripping current TripI1, TripI2, TripI3, TripI0				1. A.				
Jnbalance ratio / negative sequence current	li	-		12 - T				
Disturbance recording		-		12 - T				
Thermal capacity used		-	-	12 - T			-	-
Remaining operating time before overload tri	nning			12 - T				
Vaiting time after overload tripping	pping			12 - T				
Running hours counter / operating time				12 - T				
Starting current and time								
Start inhibit time						-		
Number of starts before inhibition						-		
Switchgear diagnosis								
Cumulative breaking current				1.1				
Frip circuit supervision		-		-				
Number of operations, operating time, chargi	na time						-	
Control and monitoring	ANSI code	_	-	-	_	-		
Circuit breaker / contactor control <sup>(1)</sup>	94/69							
atching / acknowledgement	86							
	68						-	-
Switching of groups of settings		(2)	(2)	(2)	(2)	(2)		
Annunciation	30							
Additional modules			-		-	-		
temperature sensor inputs - MET148-2 mod	dule							
low level analog output - MSA141 module								
ogic inputs/outputs -								
MES114/MES114E/MES114F (101/40) modu	ule							
Communication interface -								

standard, D according to parameter setting and MES114/MES114E/MES114F or MET148-2 input/output module options.
 (1) For shunt trip unit or undervoltage trip unit.
 (2) Exclusive choice between logic discrimination and switching from one 2-relay group of settings to another 2-relay group.
 (3) Performs Sepam B20 functions.

# **Selection table** Sepam series 40

		Substation		Transformer		Motor		Generato
Protection	ANSI code	S40	S41	S42	T40	T42	M41	G40
hase overcurrent	50/51	4	4	4	4	4	4	4
oltage-restrained overcurrent	50/51 50V/51V				-			1
arth fault / Sensitive earth fault	50N/51N	4	4	4	4	4	4	4
	50G/51G			·		·		
reaker failure	50BF	1	1	1	1	1	1	1
egative sequence / unbalance	46	2	2	2	2	2	2	2
irectional phase overcurrent	67			2		2		
irectional earth fault	67N/67NC		2	2		2	2	1
irectional active overpower	32P 32Q/40			1			1	1
irectional reactive overpower	49RMS				2	2	2	2
hase undercurrent	37				-	2	1	-
xcessive starting time, locked rotor	48/51LR/14						1	
tarts per hour	66						1	
ositive sequence undervoltage	27D						2	
emanent undervoltage	27R						1	
Indervoltage (3)	27/27S	2	2	2	2	2	2	2
vervoltage <sup>(3)</sup>	59	2	2	2	2	2	2	2
eutral voltage displacement	59N	2	2	2	2	2	2	2
egative sequence overvoltage	47	1	1	1	1	1	1	1
Nerfrequency	81H	2	2	2 4	2 4	2 4	2 4	2
ecloser (4 cycles)	81L	4			4	4	4	4
emperature monitoring (8 or 16 RTDs)	79 38/49T	U		U				
hermostat / Buchholz	26/63						L	
Metering	20,00							
						-		
hase current I1, I2, I3 RMS, residual current I0 remand current I1, I2, I3, peak demand current IM1, IM2, IM3		-	-	-	÷		-	12 - T
oltage U21, U32, U13, V1, V2, V3, residual voltage V0			-	-	5 m	-		_
ositive sequence voltage Vd / rotation direction			-	-				
egative sequence voltage Vi		•			1 A M M	-	•	1 A A A A
requency								1.11
ctive, reactive and apparent power P, Q, S		-				-	-	
eak demand power PM, QM, power factor		•	•	•	1 M M	-	•	
alculated active and reactive energy (±W.h, ±var.h)					1 C C			
ctive and reactive energy by pulse counting ( $\pm$ W.h, $\pm$ .varh)								
emperature								
Network and machine diagnosis								
ripping context								1.1
ripping current TripI1, TripI2, TripI3, TripI0					1 C C			
nbalance ratio / negative sequence current li					•			
hase displacement φ0, φ1, φ2, φ3								
isturbance recording								
hermal capacity used								
emaining operating time before overload tripping					A		•	
/aiting time after overload tripping						•		
unning hours counter / operating time					1			
tarting current and time					_			
tart inhibit time, number of starts before inhibition							•	
Switchgear diagnosis								
umulative breaking current			-	-				
rip circuit supervision								
umber of operations, operating time, charging time								
T / VT supervision	60FL			-	•			•
Control and monitoring	ANSI code							
ircuit breaker / contactor control (1)	94/69				<b>1</b>			•
atching / acknowledgement	86				1 C			•
ogic discrimination	68							
witching of groups of settings								
	30							
						•		•
ogic equation editor								
nnunciation ogic equation editor Additional modules temperature sensor inputs - MET148-2 module <sup>(2)</sup>								
ogic equation editor Additional modules temperature sensor inputs - MET148-2 module <sup>(2)</sup>								
ogic equation editor								
ogic equation editor Additional modules temperature sensor inputs - MET148-2 module <sup>(2)</sup> low level analog output - MSA141 module								

 standard, L according to parameter setting and MEST14/MEST14E/MEST14E/MEST14F or MET148-2 inp (1) For shunt trip unit or undervoltage trip unit.
 (2) 2 modules possible.
 (3) Exclusive choice, phase-to-neutral voltage or phase-to-phase voltage for each of the 2 relays. π

Sepam T20

31

10


# **Sensor inputs**

Each Sepam series 20 or Sepam series 40 has analog inputs that are connected to the measurement sensors required for the application.

### Sepam series 20 sensor inputs

	S20, S23	T20, T23, M20	B21, B22
Phase current inputs	3	3	0
Residual current input	1	1	0
Phase voltage inputs	0	0	3
Residual voltage input	0	0	1
Temperature inputs (on MET148-2 module)	0	8	0


Sepam T20 sensor inputs.



#### Sepam M41 sensor inputs.

### Sepam series 40 sensor inputs

	S40, S41, S42		T40, T42, M41, G40				
Phase current inputs	3	3					
Residual current input	1	1					
Phase voltage inputs	2	3	2	3			
Residual voltage input	1	0	1	0			
Temperature inputs (on MET148-2 module)	0		2x8				



DE51809

In

ln0

lb

# **General settings**

The general settings define the characteristics of the measurement sensors connected to Sepam and determine the performance of the metering and protection functions used. They are accessed via the SFT2841 setting software "General Characteristics", "CT-VT Sensors" and "Particular characteristics" tabs.

Gene	ral settings	Selection	Sepam series 20	Sepam series 40
In	Rated phase current	2 or 3 CT 1 A / 5 A	1 A to 6250 A	1 A to 6250 A
	(sensor primary current)	3 LPCTs	25 A to 3150 A <sup>(1)</sup>	25 A to 3150 A <sup>(1)</sup>
b	Base current, according to rated power of equipment		0.4 to 1.3 In	0.4 to 1.3 In
n0	Rated residual current	Sum of 3 phase currents	See In rated phase current	See In rated phase current
		CSH120 or CSH200 core balance CT	2 A or 20 A rating	2 A, 5 A or 20 A rating
		1 A/5 A CT + CSH30 interposing ring CT	1 A to 6250 A	1 A to 6250 A (In0 = In)
		1 A/5 A CT + CSH30 interposing ring CT Sensitivity x10	-	1 A to 6250 A (In0 = In/10)
		Core balance CT + ACE990 (the core balance CT ratio 1/n must be such that $50 \le n \le 1500$ )	According to current monitored and use of ACE990	According to current monitored and use of ACE990
Unp	Rated primary phase-to-phase voltage (Vnp: rated primary phase-to-neutral voltage Vnp = Unp/ $\sqrt{3}$ )		220 V to 250 kV	220 V to 250 kV
Jns	Rated secondary phase-to-phase voltage	3 VTs: V1, V2, V3	100, 110, 115, 120, 200, 230 V	100, 110, 115, 120, 200, 230 V
		2 VTs: U21, U32	100, 110, 115, 120 V	100, 110, 115, 120 V
		1 VT: V1	100, 110, 115, 120 V	100, 110, 115, 120 V
Jns0	Secondary zero sequence voltage for primary zero sequence voltage Unp/ $\sqrt{3}$		Uns/3 or Uns/√3	Uns/3 or Uns/√3
	Rated frequency		50 Hz or 60 Hz	50 Hz or 60 Hz
	Integration period (for demand current and peak demand current and power)		5, 10, 15, 30, 60 mn	5, 10, 15, 30, 60 mn
	Pulse-type accumulated energy meter	Increments active energy	-	0.1 kW.h to 5 MW.h
		Increments reactive energy	-	0.1 kvar.h to 5 Mvar.h
	Integration period (for demand current and peak demand current and power)	Increments reactive	5, 10, 15, 30, 60 mn -	5, 10, 15, 30, 6 0.1 kW.h to 5 M

(1) In values for LPCT, in Amps: 25, 50, 100, 125, 133, 200, 250, 320, 400, 500, 630, 666, 1000, 1600, 2000, 3150.

### Metering and diagnosis Description

# 2

### Metering

Sepam is a precision metering unit.

All the metering and diagnosis data used for commissioning and required for the operation and maintenance of your equipment are available locally or remotely, expressed in the units concerned (A, V, W, etc.).

#### **Phase current**

RMS current for each phase, taking into account harmonics up to number 13. Different types of sensors may be used to meter phase current:

- 1 A or 5 A current transformers
- LPCT type current sensors.

#### **Residual current**

Two residual current values are available depending on the type of Sepam and sensors connected to it:

- residual currents I0∑, calculated by the vector sum of the 3 phase currents
- measured residual current I0.
- Different types of sensors may be used to measure residual current:
- CSH120 or CSH200 specific core balance CT
- conventional 1 A or 5 A current transformer
- any core balance CT with an ACE990 interface.

#### Demand current and peak demand currents

Demand current and peak demand currents are calculated according to the 3 phase currents I1, I2 and I3:

demand current is calculated over an adjustable period of 5 to 60 minutes

peak demand current is the greatest demand current and indicates the current drawn by peak loads.

Peak demand currents may be cleared.

#### Voltage and frequency

The following measurements are available according to the voltage sensors connected:

- phase-to-neutral voltages V1, V2, V3
- phase-to-phase voltages U21, U32, U13
- residual voltage V0
- positive sequence voltage Vd and negative sequence voltage Vi
- frequency f.

#### Power

Powers are calculated according to the phase currents I1, I2 and I3:

- active power
- reactive power
- apparent power
- **power factor (cos**  $\phi$ ).

Power calculations is based on the 2 wattmeter method.

The 2 wattmeter method is only accurate when there is no residual current and it is not applicable if the neutral is distributed.

#### Peak demand powers

The greatest demand active and reactive power values calculated over the same period as the demand current.

The peak demand powers may be cleared.

#### Energy

4 accumulated energies calculated according to voltages and phase currents I1, I2 and I3 measured: active energy and reactive energy in both directions

■ 1 to 4 additional accumulated energy meters for the acquisition of active or reactive energy pulses from external meters.

#### Temperature

Accurate measurement of temperature inside equipment fitted with Pt100, Ni100 or Ni120 type RTDs, connected to the optional remote MET148-2 module.

# Metering and diagnosis Description

### Machine diagnosis

### assistance

- Sepam assists facility managers by providing:
- data on the operation of their machines
- predictive data to optimize process management
   useful data to facilitate protection function setting
- and implementation.

#### Thermal capacity used

Equivalent temperature buildup in the machine, calculated by the thermal overload protection function. Displayed as a percentage of rated thermal capacity.

# Remaining operating time before overload tripping

Predictive data calculated by the thermal overload protection function.

The time is used by facility managers to optimize process management in real time by deciding to:

interrupt according to procedures

continue operation with inhibition of thermal protection on overloaded machine.

#### Waiting time after overload tripping

Predictive data calculated by the thermal overload protection function.

Waiting time to avoid further tripping of thermal overload protection by premature re-energizing of insufficiently cooled down equipment.

**Running hours counter / operating time** Equipment is considered to be running whenever a phase current is over 0.1 lb.

Cumulative operating time is given in hours.

# Motor starting / overload current and time

- A motor is considered to be starting or overloaded when a phase current is over
- 1.2 lb. For each start / overload, Sepam stores:
- maximum current drawn by the motor
- starting / overload time.

The values are stored until the following start / overload.

# Number of starts before inhibition/start inhibit time

Indicates the number of starts still allowed by the starts per hour protection function and, if the number is zero, the waiting time before starting is allowed again.

### Network diagnosis assistance

Sepam provides network power quality metering functions, and all the data on network disturbances detected by Sepam are recorded for analysis purposes.

#### **Tripping context**

Storage of tripping currents and I0, Ii, U21, U32, U13, V0, Vi, Vd, f, P and Q values when tripping occurs. The values for the last five trips are stored.

#### **Tripping current**

Storage of the 3 phase currents and earth fault current at the time of the last Sepam trip order, to indicate fault current. The values are stored in the tripping contexts.

### Negative sequence / unbalance

Negative sequence component of phase currents I1, I2 and I3, indicating the degree of unbalance in the power supplied to the protected equipment.

#### **Phase displacement**

• phase displacement  $\varphi$ 1,  $\varphi$ 2,  $\varphi$ 3 between phase currents I1, I2, I3 and voltages V1, V2, V3 respectively

phase displacement φ0 between residual current and residual voltage.

#### **Disturbance recording**

Recording triggered by user-set events:

- all sampled values of measured currents and voltages
- status of all logic inputs and outputs
- logic data: pick-up, ...

Characteristics	Sepam series 20	Sepam series 40
Number of recordings in COMTRADE format	2	Adjustable from 1 to 19
Total duration of a recording	86 periods (1.72 s at 50 Hz, 1.43 s at 60 Hz)	Adjustable from 1 to 10 s. The total of all the records plus one must not be more than 20 s at 50 Hz and 16 s at 60 Hz
Number of samples per period	12	12
Duration of recording prior to occurrence of the event	Adjustable from 0 to 86 periods	Adjustable from 0 to 99 periods
Recorded data	<ul> <li>currents or voltages</li> <li>logic inputs</li> <li>pick up</li> <li>logic output O1.</li> </ul>	<ul> <li>currents or voltages</li> <li>logic inputs</li> <li>pick up</li> <li>logic outputs O1 to O4.</li> </ul>

# Metering and diagnosis Description

### Sepam self-diagnosis

Sepam includes a number of self-tests carried out in the base unit and optional modules. The purpose of the self-tests is to:

- detect internal failures that may cause nuisance tripping or failed fault tripping
- put Sepam in fail-safe position to avoid any unwanted operation
- alert the facility manager of the need for maintenance operations.

#### **Internal failure**

Two categories of internal failures are monitored: major failures: Sepam shutdown (to fail-safe position).

The protection functions are inhibited, the output relays are forced to drop out and the "Watchdog" output indicates Sepam shutdown

minor failures: downgraded Sepam operation.
 Sepam's main functions are operational and equipment protection is ensured.

#### **Detection of plugged connectors**

The system checks that the current or voltage sensors are plugged in. A missing connector is a major failure.

#### **Configuration checking**

The system checks that the optional modules configured are present and working correctly. The absence or failure of a remote module is a minor failure, the absence or failure of a logic input/output module is a major failure.

### Switchgear diagnosis assistance

- Switchgear diagnosis data give facility managers information on:
- mechanical condition of breaking device
- Sepam auxiliaries

and assist them for preventive and curative switchgear maintenance actions. The data are to be compared to switchgear manufacturer data.

#### ANSI 60/60FL - CT/VT supervision


Used to monitor the entire metering chain:


- CT and VT sensors
- connection
- Sepam analog inputs.
- Monitoring includes:
- consistency checking of currents and voltages measured
- acquisition of phase or residual voltage transformer protection fuse blown contacts.

In the event of a loss of current or voltage measurement data, the assigned protection functions may be inhibited to avoid nuisance tripping.

#### ANSI 74 - Trip circuit supervision

- To detect trip circuit circuit failures, Sepam monitors:
- shunt trip coil connection
- matching of breaking device open/closed position contacts
- execution of breaking device open and close orders.
- The trip circuit is only supervised when connected as shown below.





Connection for shunt trip coil monitoring.

Connection for undervoltage trip coil monitoring.

### Cumulative breaking current

Six cumulative currents are proposed to assess breaking device pole condition:

- total cumulative breaking current
- cumulative breaking current between 0 and 2 In
- cumulative breaking current between 2 In and 5 In
- cumulative breaking current between 5 In and 10 In
- cumulative breaking current between 10 In and 40 In
- cumulative breaking current > 40 In.

Each time the breaking device opens, the breaking current is added to the cumulative total and to the appropriate range of cumulative breaking current. Cumulative breaking current is given in (kA)<sup>2</sup>.

#### Number of operations

Cumulative number of opening operations performed by the breaking device.

#### Circuit breaker operating time and charging time

Used to assess the condition of the breaking device operating mechanism.

# **Metering and diagnosis**

Characteristics

Functions	Measurement	Accuracy <sup>(1)</sup>	Accuracy <sup>(1)</sup>		Saving
	range	Sepam series 20	Sepam series 40		
Metering			•		
Phase current	0.1 to 40 ln <sup>(3)</sup>	±1 %	±0.5 %		
Residual current Calculated	0.1 to 40 ln	±1%	±1%	-	
Measured	0.1 to 20 In0	±1%	±1%	-	
Demand current	0.1 to 40 ln	±1%	±0.5 %		
Peak demand current	0.1 to 40 ln	±1%	±0.5 %		
Phase-to-phase voltage	0.05 to 1.2 Unp	±1%	±0.5 %		
Phase-to-neutral voltage	0.05 to 1.2 Vnp	±1%	±0.5 %	-	
Residual voltage	0.015 to 3 Vnp	±1%	±1%		
Positive sequence voltage	0.05 to 1.2 Vnp	±5 %	±2%		
Vegative sequence voltage	0.05 to 1,2 Vnp	-	±2 %		-
Frequency Sepam series 20	50 ±5 Hz or 60 ±5 Hz	±0.05 Hz	-		
Frequency Sepam series 40	25 to 65 Hz	-	±0.02 Hz	-	_
Active power	0.015 Sn <sup>(2)</sup> to 999 MW	-	±1%	-	
Reactive power	0.015 Sn <sup>(2)</sup> to 999 Mvar	-	±1%		_
Apparent power	0.015 Sn <sup>(2)</sup> to 999 MVA	-	±1%	-	_
Peak demand active power	0.015 Sn <sup>(2)</sup> to 999 MW	-	±1%	-	
Peak demand reactive power	0.015 Sn <sup>(2)</sup> to 999 Mvar	-	±1%		
Power factor	-1 to +1 (CAP/IND)	-	±1%		
Calculated active energy	0 to 2.1.10 <sup>8</sup> MW.h		±1 % ±1 digit		
Calculated reactive energy	0 to 2.1.10 <sup>8</sup> Mvar.h		$\pm 1\% \pm 1$ digit		
emperature	-30 to +200 °C	±1 °C from +20 to +140 °C	±1 °C from +20 to +140 °C		
emperature	or -22 to +392 °F	11 0110111120101140 0	11 0110111-2010-140-0	•	
Network diagnosis assistance					
ripping context					
Phase tripping current	0.1 to 40 In	±5 %	±5 %		
Earth fault tripping current	0.1 to 20 In0	±5 %	±5 %		
Vegative sequence / unbalance	10 to 500 % of Ib	±2 %	±2 %		
Phase displacement $\varphi 0$ (between V0 and I0)	0 to 359°	-	±2°		
Phase displacement $\phi$ 1, $\phi$ 2, $\phi$ 3	0 to 359°	-	±2°		
between V and I)					
Machine operating assistance					
hermal capacity used	0 to 800 %	±1 %	±1 %		
	(100 % for I phase = Ib)			-	
Remaining operating time before overload	0 to 999 mn	±1 mn	±1 mn		
Vaiting time after overload tripping	0 to 999 mn	±1 mn	±1 mn		_
Running hours counter / operating time	0 to 65535 hours	±1 % or ±0.5 h	±1 % or ±0.5 h		
Starting current	1.2 lb to 24 ln	±5 %	±5 %		
Starting time	0 to 300 s	±300 ms	±300 ms		
Number of starts before inhibition	0 to 60	1	1		
Start inhibit time	0 to 360 mn	±1 mn	±1 mn		
Cooling time constant	5 to 600 mn	-	±5 mn		
Switchgear diagnosis assistance		I		1	
Cumulative breaking current	0 to 65535 kA <sup>2</sup>	±10 %	±10%		
Jumber of operations	0 to 4.10 <sup>9</sup>	1	1		
	0.04.10	1	1		
Operating time	20 to 100 ms	±1 ms	±1 ms		

available on MSA141 analog output module, according to setup.
□ saved in the event of auxiliary supply outage.
(1) Under reference conditions (IEC 60255-6), typical accuracy at In or Unp, cosφ > 0.8.
(2) Sn: apparent power, = √3.Unp.In.
(3) Measurement up to 0.02 In for information purpose.

# **Protection** Description

### **Current protection functions**

#### ANSI 50/51 - Phase overcurrent

Phase-to-phase short-circuit protection, sensitive to the highest phase current measured.

#### Characteristics

- 2 groups of settings
- instantaneous or time-delayed tripping
- definite time (DT) or IDMT curve (choice of 16
- standardized IDMT curves)
- with or without timer hold

With Sepam series 40, tripping can be confirmed or unconfirmed, according to parameter setting:

unconfirmed tripping: standard

 tripping confirmed by negative sequence overvoltage protection (ANSI 47, unit 1), as backup for distant 2phase short-circuits

 tripping confirmed by undervoltage protection (ANSI 27, unit 1), as backup for phase-to-phase shortcircuits in networks with low short-circuit power.

#### ANSI 50N/51N or 50G/51G - Earth fault

Earth fault protection based on measured or calculated residual current values:

- ANSI 50N/51N: residual current calculated or
- measured by 3 phase current sensors
- ANSI 50G/51G: residual current measured directly by a specific sensor.

#### Characteristics

#### 2 groups of settings

- Definite time (DT) or IDMT curve (choice of 16
- standardized IDMT curves)
- with or without timer hold

second harmonic restraint to ensure stability during transformer energizing, activated by parameter setting.

#### ANSI 50BF - Breaker failure

If a breaker fails to be triggered by a tripping order, as detected by the non-extinction of the fault current, this backup protection sends a tripping order to the upstream or adjacent breakers.

#### ANSI 46 - Negative sequence / unbalance

Protection against phase unbalance, detected by the measurement of negative sequence current:

- sensitive protection to detect 2-phase faults at the ends of long lines
- protection of equipment against temperature build-up, caused by an unbalanced power supply, phase inversion or loss of phase, and against phase current unbalance.

#### Characteristics

- Sepam series 20:
- □ 1 definite time (DT) curve
- 1 specific Schneider IDMT curve.
- Sepam series 40:
- □ 1 definite time (DT) curve
- D 7 IDMT curves: 3 IEC curves, 3 IEEE curves and 1 specific Schneider curve.

#### **ANSI 49RMS - Thermal overload**

Protection against thermal damage caused by overloads on machines (transformers, motors or generators).

The thermal capacity used is calculated according to a mathematical model which takes into account:

- current RMS values
- ambient temperature

negative sequence current, a cause of motor rotor temperature rise. The thermal capacity used calculations may be used to calculate predictive data for process control assistance.

The protection may be inhibited by a logic input when required by process control conditions.

#### Characteristics

- 2 groups of settings
- 1 adjustable alarm set point
- 1 adjustable tripping set point
- adjustable initial thermal capacity used setting, to adapt protection characteristics to fit manufacturer's thermal withstand curves
- equipment heating and cooling time constants.

With Sepam series 40, the cooling time constant may be calculated automatically based on measurement of the equipment temperature by a sensor.

### Recloser

#### **ANSI 79**

Automation device used to limit down time after tripping due to transient or semipermanent faults on overhead lines. The recloser orders automatic reclosing of the breaking device after the time delay required to restore the insulation has elapsed. Recloser operation is easy to adapt for different operating modes by parameter setting.

#### Characteristics


■ 1 to 4 reclosing cycles, each cycle has an adjustable dead time

■ adjustable, independent reclaim time and safety time until recloser ready time delays


■ cycle activation linked to instantaneous or time-delayed short-circuit protection function (ANSI 50/51, 50N/51N, 67, 67N/67NC) outputs by parameter setting

inhibition/locking out of recloser by logic input.


# Protection Description



Tripping characteristic of ANSI 67N/67NC type 1 protection (characteristic angle  $\theta 0 0^{\circ}$ ).



Tripping characteristic of ANSI 67N/67NC type 2 protection (characteristic angle  $\theta 0 = 0^\circ$ ).



Tripping characteristic of ANSI 67N/67NC type 3 protection.

### **Directional current protection**

#### **ANSI 67 - Directional phase overcurrent**

Phase-to-phase short-circuit protection, with selective tripping according to fault current direction.

It comprises a phase overcurrent function associated with direction detection, and picks up if the phase overcurrent function in the chosen direction (line or busbar) is activated for at least one of the 3 phases.

#### Characteristics

- 2 groups of settings
- instantaneous or time-delayed tripping
- choice of tripping direction

■ definite time (DT) or IDMT curve (choice of 16 standardized IDMT curves)

with voltage memory to make the protection insensitive to loss of polarization voltage at the time of the fault

with or without timer hold.

#### ANSI 67N/67NC - Directional earth fault

Earth fault protection, with selective tripping according to fault current direction. 3 types of operation:

- type 1: the protection function uses the projection of the IO vector
- type 2: the protection function uses the I0 vector magnitude with half-plane tripping zone

type 3: the protection function uses the IO vector magnitude with angular sector tripping zone

#### ANSI 67N/67NC type 1

Directional earth fault protection for impedant, isolated or compensated neutral systems, based on the projection of measured residual current.

- Type 1 characteristics
- 2 groups of settings
- instantaneous or time-delayed tripping
- definite time (DT) curve
- choice of tripping direction
- characteristic projection angle
- no timer hold

with voltage memory to make the protection insensitive to recurrent faults in compensated neutral systems.

#### ANSI 67N/67NC type 2

Directional overcurrent protection for impedance and solidly earthed systems, based on measured or calculated residual current.

It comprises an earth fault function associated with direction detection, and picks up if the earth fault function in the chosen direction (line or busbar) is activated.

#### Type 2 characteristics

- 2 groups of settings
- instantaneous or time-delayed tripping
- definite time (DT) or IDMT curve (choice of 16 standardized IDMT curves)
- choice of tripping direction
- with or without timer hold.

#### ANSI 67N/67NC type 3

Directional overcurrent protection for distribution networks in which the neutral earthing system varies according to the operating mode, based on measured residual current.

It comprises an earth fault function associated with direction detection (angular sector tripping zone defined by 2 adjustable angles), and picks up if the earth fault function in the chosen direction (line or busbar) is activated. This protectionfunction complies with the Enel DK5600 specification.

#### Type 3 characteristics

- 2 groups of settings
- instantaneous or time-delayed tripping
- definite time (DT) curve
- choice of tripping direction
- no timer hold

# **Protection** Description

# Directional power protection Machine protection functions functions

#### **ANSI 32P - Directional active overpower**

Two-way protection based on calculated active power, for the following applications:

 active overpower protection to detect overloads and allow load shedding

reverse active power protection:

against generators running like motors when the generators consume active power
 against motors running like generators when the motors supply active power.

# ANSI 32Q/40 - Directional reactive overpower

Two-way protection based on calculated reactive power to detect field loss on synchronous machines: reactive overpower protection for motors which

consume more reactive power with field loss ■ reverse reactive overpower protection for generators which consume reactive power with field loss.

#### ANSI 37 - Phase undercurrent

Protection of pumps against the consequences of a loss of priming by the detection of motor no-load operation.

It is sensitive to a minimum of current in phase 1, remains stable during breaker tripping and may be inhibited by a logic input.

#### ANSI 48/51LR/14 - Locked rotor / excessive starting time

Protection of motors against overheating caused by:

excessive motor starting time due to overloads (e.g. conveyor) or insufficient supply voltage.

The reacceleration of a motor that is not shut down, indicated by a logic input, may be considered as starting.

Iocked rotor due to motor load (e.g. crusher):

□ in normal operation, after a normal start

□ directly upon starting, before the detection of excessive starting time, with detection of locked rotor by a zero speed detector connected to a logic input, or by the underspeed function.

#### ANSI 66 - Starts per hour

Protection against motor overheating caused by:

too frequent starts: motor energizing is inhibited when the maximum allowable

number of starts is reached, after counting of:

starts per hour (or adjustable period)
 consecutive motor hot or cold starts (reacceleration of a motor that is not shut

down, indicated by a logic input, may be counted as a start)

starts too close together in time: motor re-energizing after a shutdown is only allowed after an adjustable waiting time.

#### ANSI 50V/51V - Voltage-restrained overcurrent

Phase-to-phase short-circuit protection, for generators. The current tripping set point is voltage-adjusted in order to be sensitive to faults close to the generator which cause voltage drops and lowers the short-circuit current.

#### Characteristics

- instantaneous or time-delayed tripping
- definite time (DT) or IDMT curve (choice of 16 standardized IDMT curves)
- with or without timer hold.

#### ANSI 26/63 - Thermostat/Buchholz

Protection of transformers against temperature rise and internal faults via logic inputs linked to devices integrated in the transformer.

#### ANSI 38/49T - Temperature monitoring

Protection that detects abnormal temperature build-up by measuring the temperature inside equipment fitted with sensors:

- transformer: protection of primary and secondary windings
- motor and generator: protection of stator windings and bearings.

#### Characteristics

- Sepam series 20: 8 Pt100, NI100 or Ni120 type RTDs
- Sepam series 40: 16 Pt100, NI100 or Ni120 type RTDs
- 2 adjustable independent set points for each RTD (alarm and trip).

### **Protection** Description

### Voltage protection functions Frequency protection functions

# ANSI 27D - Positive sequence undervoltage

Protection of motors against faulty operation due to insufficient or unbalanced network voltage, and detection of reverse rotation direction.

#### ANSI 27R - Remanent undervoltage

Protection used to check that remanent voltage sustained by rotating machines has been cleared before allowing the busbar supplying the machines to be re-energized, to avoid electrical and mechanical transients.

#### ANSI 27 - Undervoltage

Protection of motors against voltage sags or detection of abnormally low network voltage to trigger automatic load shedding or source transfer.

Works with phase-to-phase voltage (Sepam series 20 and Sepam series 40) or phase-to-neutral voltage (Sepem series 40 only), each voltage being monitored separately.

#### ANSI 59 - Overvoltage

Detection of abnormally high network voltage or checking for sufficient voltage to enable source transfer.

Works with phase-to-phase or phase-to-neutral voltage, each voltage being monitored separately.

#### ANSI 59N - Neutral voltage displacement

Detection of insulation faults by measuring residual voltage in isolated neutral systems.

#### ANSI 47 - Negative sequence overvoltage

Protection against phase unbalance resulting from phase inversion, unbalanced supply or distant fault, detected by the measurement of negative sequence voltage.

#### **ANSI 81H - Overfrequency**

Detection of abnormally high frequency compared to the rated frequency, to monitor power supply quality.

#### ANSI 81L - Underfrequency

Detection of abnormally low frequency compared to the rated frequency, to monitor power supply quality.

The protection may be used for overall tripping or load shedding. Protection stability is ensured in the event of the loss of the main source and presence of remanent voltage by a restraint in the event of a continuous decrease of the frequency, which is activated by parameter setting.

#### ANSI 81R - Rate of change of frequency

Protection function used for fast disconnection of a generator or load shedding control. Based on the calculation of the frequency variation, it is insensitive to transient voltage disturbances and therefore more stable than a phase-shift protection function.

#### Disconnection

In installations with autonomous production means connected to a utility, the "rate of change of frequency" protection function is used to detect loss of the main system in view of opening the incoming circuit breaker to:

- protect the generators from a reconnection without checking synchronization
- avoid supplying loads outside the installation.

#### Load shedding

The "rate of change of frequency" protection function is used for load shedding in combination with the underfrequency protection to:

- either accelerate shedding in the event of a large overload
- or inhibit shedding following a sudden drop in frequency due to a problem that should not be solved by shedding.

# **Protection** Main characteristics

### **Current IDMT tripping curves**

- Multiple IDMT tripping curves are offered, to cover most applications:
- IEC curves (SIT, VIT/LTI, EIT)
- IEEE curves (MI, VI, EI)
- usual curves (UIT, RI, IAC)

The curve equations are given page 102.

# Setting of IDMT tripping curves, time delay T or TMS factor

The time delays of current IDMT tripping curves (except for customized and RI curves) may be set as follows:

- time T, operating time at 10 x Is
- TMS factor, factor shown as T/ $\beta$  (see curve equation page 102).

### **Timer hold**

- The adjustable timer hold T1 is used for:
- detection of restriking faults (DT curve)
- coordination with electromechanical relays (IDMT curve).
   Timer hold may be inhibited if necessary.

### 2 groups of settings

#### Phase-to-phase and phase-to-earth short-circuit protection

Each unit has 2 groups of settings, A and B, to adapt the settings to suit the network configuration.

The active group of settings (A or B) is set by a logic input or the communication link.

Example of use: normal / backup mode network

group A for network protection in normal mode, when the network is supplied by the utility

■ group B for network protection in backup mode, when the network is supplied by a backup generator.

#### Thermal overload for machines

Each unit has 2 groups of settings to protect equipment that has two operating modes.

#### Examples of use:


 transformers: switching of groups of settings by logic input, according to transformer ventilation operating mode, natural or forced ventilation (ONAN or ONAF)

motors: switching of groups of settings according to current set point, to take into account the thermal withstand of motors with locked rotors.

### Summary table

Characteristics	Protection functions
2 groups of settings A and B	50/51, 50N/51N, 67, 67N/67NC
2 groups of settings, operating modes 1 and 2	49RMS Machine
IEC IDMT curves	50/51, 50N/51N, 50V/51V, 67, 67N/67NC type 2, 46
IEEE IDMT curves	50/51, 50N/51N, 50V/51V, 67, 67N/67NC type 2, 46
Usual IDMT curves	50/51, 50N/51N, 50V/51V, 67, 67N/67NC type 2
Timer hold	50/51, 50N/51N, 50V/51V, 67, 67N/67NC type 2





Detection of restriking faults with adjustable timer hold.

# **Protection** Setting ranges

Functions	Settings		Time delays
ANSI 27 - Phase-to-phase une	dervoltage		
-	5 to 100 % of Unp		0.05 s to 300 s
ANSI 27D/47 - Positive seque	nce undervoltage		
	15 to 60 % of Unp		0.05 s to 300 s
ANSI 27R - Remanent underv	oltage		
	5 to 100 % of Unp		0.05 s to 300 s
ANSI 27S - Phase-to-neutral u	Indervoltage		
	5 to 100 % of Vnp		0.05 s to 300 s
ANSI 32P - Directional active	overpower		
	1 to 120 % of Sn <sup>(3)</sup>		0.1 s to 300 s
ANSI 32Q/40 - Directional rea	ctive overpower		
	5 to 120 % of Sn <sup>(3)</sup>		0.1 s to 300 s
ANSI 37 - Phase undercurren	t		
	0.15 to 1 lb		0.05 s to 300 s
ANSI 38/49T - Temperature m	onitoring (8 or 16 RTDs)		
larm and trip set points	0 to 180 °C (or 32 to 356 °F)		
ANSI 46 - Negative sequence	/ unbalance		
efinite time	0.1 to 5 lb		0.1 s to 300 s
DMT	0.1 to 0.5 lb (Schneider Electric) 0.1 to	o 1 lb (CEI, IEEE)	0.1 s to 1 s
ripping curve	Schneider Electric		
	CEI: SIT/A, LTI/B, VIT/B, EIT/C <sup>(2)</sup>		
	IEEE: MI (D), VI (E), EI (F) <sup>(2)</sup>		
ANSI 47 - Negative sequence	overvoltage		
	1 to 50 % of Unp		0.05 s to 300 s
ANSI 48/51LR/14 - Excessive	starting time, locked rotor		
	0.5 lb to 5 lb	ST starting time	0.5 s to 300 s
		LT and LTS time delays	0.05 s to 300 s
ANSI 49RMS - Thermal overlo		Rate 1 and Rate 2	
ccounting for negative sequence co	-	0 - 2,25 - 4,5 - 9	
ime constant	Heating	Sepam serie 20 T1: 1 to 120 mn	
	<u> </u>	Sepam serie 40 T1: 1 to 600 mn	
	Cooling	Sepam serie 20         T2: 1 to 600 mn           20         T0: 5 to 600 mn	
lorm and tripping act paints		Sepam serie 40 T2: 5 to 600 mn	· · · · · · · · · · · · · · · · · · ·
larm and tripping set points		50 to 300 % of rated thermal capacity 0 to 100 %	
witching of thermal settings condition	ne	By logic input	
witching of thermal settings conduct	115	By Is set point adjustable from 0.25 to 8 lb	
laximum equipment temperature		60 to 200 °C (140 °F to 392 °F)	
ANSI 50/51 - Phase overcurre	nt		
	Tripping time delay	Timer hold	
ripping curve	Definite time	DT	
	SIT, LTI, VIT, EIT, UIT <sup>(1)</sup>	DT	
	RI	DT	
	CEI: SIT/A, LTI/B, VIT/B, EIT/C	DT or IDMT	
	IEEE: MI (D), VI (E), EI (F)	DT or IDMT	
	IAC: I, VI, EI	DT or IDMT	
set point	0.1 to 24 ln	Definite time	Inst ; 0.05 s to 300 s
	0.1 to 2.4 In	IDMT	0.1 s to 12.5 s at 10 ls
mer hold	Definite time (DT ; timer hold)		Inst ; 0.05 s to 300 s
	IDMT (IDMT ; reset time)		0.5 s to 20 s
onfirmation <sup>(2)</sup>	None		
	By negative sequence overvoltage		
	By phase-to-phase undervoltage		
ANSI 50BF - Breaker failure			
resence of current	0.2 to 2 In		
Operating time	0.05 s to 300 s		
1) Tripping as of 1.2 ls.			

# **Protection** Setting ranges

Functions	Settings		Time delays
ANSI 50N/51N or 50G/51G -	Earth fault / Sensitive earth fault		
	Tripping time delay	Timer hold	
ripping curve	Definite time	DT	
	SIT, LTI, VIT, EIT, UIT <sup>(1)</sup>	DT	
	RI	DT	
	CEI: SIT/A,LTI/B, VIT/B, EIT/C	DT or IDMT	
	IEEE: MI (D), VI (E), EI (F)	DT or IDMT	
	IAC: I, VI, EI	DT or IDMT	
s0 set point	0.1 to 15 In0	Definite time	Inst ; 0.05 s to 300 s
	0.1 to 1 In0	IDMT	0.1 s to 12.5 s at 10 ls0
ïmer hold	Definite time (DT ; timer hold)		Inst ; 0.05 s to 300 s
	IDMT (IDMT ; reset time)		0.5 s to 20 s
ANSI 50V/51V - Voltage-rest	rained overcurrent		
	Tripping time delay	Timer hold	
ripping curve	Definite time	DT	
	SIT, LTI, VIT, EIT, UIT <sup>(1)</sup>	DT	
	RI	DT	
	CEI: SIT/A, LTI/B, VIT/B, EIT/C	DT or IDMT	
	IEEE: MI (D), VI (E), EI (F)	DT or IDMT	
	IAC: I, VI, EI	DT or IDMT	
s set point	0.5 to 24 In	Definite time	Inst ; 0.05 s to 300 s
	0.5 to 2.4 ln	IDMT	0.1 s to 12.5 s at 10 ls
limer hold	Definite time (DT; timer hold)		Inst ; 0.05 s to 300 s
	IDMT (IDMT ; reset time)		0.5 s to 20 s
ANSI 59 - Overvoltage	Phase-to-phase	Phase-to-neutral <sup>(2)</sup>	
Jan State St	50 to 150 % of Unp	50 to 150 % of Vnp	0.05 s to 300 s
ANSI 59N - Neutral voltage of			
Altereet literation vehicige (	2 to 80 % of Unp		0.05 s to 300 s
ANSI 66 - Starts per hour	210 00 % 01 0110		0.003103003
Starts per period	1 to 60	Period	1 to 6 hr
Consecutive starts	1 to 60	Time between starts	0 to 90 mn
		Time between starts	010901111
ANSI 67 - Directional phase		Timer hold	
	Tripping time delay Definite time	DT	
ripping curve		DT	
	SIT, LTI, VIT, EIT, UIT <sup>(1)</sup>	DT	
	CEI: SIT/A, LTI/B, VIT/B, EIT/C	DT or IDMT	
	IEEE: MI (D), VI (E), EI (F)	DT or IDMT	
	IAC: I, VI, EI	DT or IDMT	
s set point	0.1 to 24 In	Definite time	Inst ; 0.05 s to 300 s
	0.1 to 2,4 In Definite time (DT; timer hold)	IDMT	0.1 s to 12.5 s at 10 ls
Timer hold	Definite time (1) L - timer hold)		Inst ; 0.05 s to 300 s
Internoid	IDMT (IDMT ; reset time)		0.5 s to 20 s

(1) Tripping as of 1.2 ls.(2) Sepam series 40 only.

# **Protection** Setting ranges

Functions	6	Settings		Time delays
ANSI 67N/67	NC type 1 - Directional ea	rth fault, according to 10 project	tion	
Characteristic ar	ngle	-45°, 0°, 15°, 30°, 45°, 60°, 90°		
s0 set point	-	0.1 to 15 In0	Definite time	Inst ; 0.05 s to 300 s
Vs0 set point		2 to 80 % of Un		
Memory time		T0mem time	0 ; 0.05 s to 300 s	
		V0mem validity set point	0 ; 2 to 80 % of Unp	
ANSI 67N/67	NC type 2 - Directional ea	rth fault, according to I0 magnit	ude with half-plan tripping	g zone
Characteristic ar	ngle	-45°, 0°, 15°, 30°, 45°, 60°, 90°		
		Tripping time delay	Timer hold	
Tripping curve		Definite time	DT	
		SIT, LTI, VIT, EIT, UIT <sup>(1)</sup>	DT	
		RI	DT	
		CEI: SIT/A,LTI/B, VIT/B, EIT/C	DT or IDMT	
		IEEE: MI (D), VI (E), EI (F)	DT or IDMT	
		IAC: I, VI, EI	DT or IDMT	
s0 set point		0.5 to 15 In0	Definite time	Inst ; 0.05 s to 300 s
		0.5 to 1 In0	IDMT	0.1 s to 12.5 s at 10 ls0
/s0 set point		2 to 80 % of Unp		
Timer hold		Definite time (DT ; timer hold)		Inst ; 0.05 s to 300 s
		IDMT (IDMT ; reset time)		0.5 s to 20 s
ANSI 67N/67	NC type 3 - Directional ea	rth fault, according to I0 magni	ude with angular sector tr	ipping zone
Angle at start of t	tripping zone	0° to 359°		
Angle at end of tr	ripping zone	0° to 359°		
Is0 set point	CSH core balance CT (2 A rating)	0.1 A to 30 A	Definite time	Inst ; 0.05 to 300 s
	1 A CT (sensitive, In0 = 0.1 CT In)	0.05 to 15 In0 (min. 0.1 A)		
	Core balance CT + ACE990 (range 1)	0.05 to 15 In0 (min. 0.1 A)		
/s0 set point		Calculated V0 (sum of 3 voltages)	2 to 80 % of Unp	
		Measured V0 (external VT)	0.6 to 80 % of Unp	
ANSI 81H - C	Verfrequency			
Sepam series 20		50 to 53 Hz or 60 to 63 Hz		0.1 s to 300 s
Sepam series 40		50 to 55 Hz or 60 to 65 Hz		0.1 s to 300 s
ANSI 81L - U	nderfrequency			
Sepam series 20	)	45 to 50 Hz or 55 to 60 Hz		0.1 s to 300 s
Sepam series 40		40 to 50 Hz or 50 to 60 Hz		0.1 s to 300 s
ANSI 81R - R	Rate of change of frequence			
		0.1 to 10 Hz/s		Inst ; 0.15 s to 300 s

(1) Tripping as of 1.2 ls.

# **Control and monitoring** Description

Sepam performs all the control and monitoring functions required for electrical network operation.

the main control and monitoring functions are predefined and fit the most frequent cases of use. They are ready to use and are implemented by simple parameter setting after the necessary logic inputs / outputs are assigned.

the predefined control and monitoring functions can be adapted for particular needs using the SFT2841 software, which offers the following customization options: customization of the control matrix by changing the assignment of output relays, LEDs and annunciation messages

□ logic equation editor, to adapt and complete the predefined control and monitoring functions (Sepam series 40 only)

□ creation of personalized messages for local annunciation (Sepam series 40 only).


#### **Operating principle**

The processing of each control and monitoring function may be broken down into 3 phases

- acquisition of input data:
- □ results of protection function processing

□ external logic data, connected to the logic inputs of an optional MES114 input / output module

- □ remote control orders (TC) received via the Modbus communication link
- actual processing of the control and monitoring function
- utilization of the processing results:
- □ activation of output relays to control a device
- □ information sent to the facility manager:
- by message and/or LED on the Sepam display and SFT2841 software
- by remote indication (TS) via the Modbus communication link.

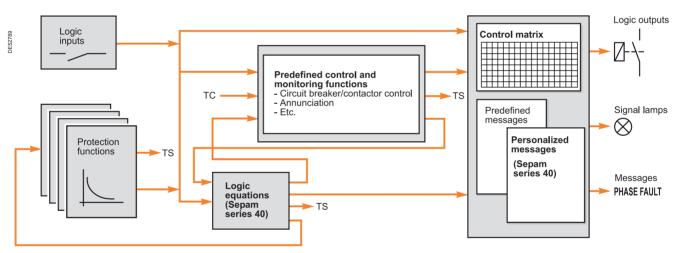

#### Logic inputs and outputs

The number of Sepam inputs / outputs must be adapted to fit the control and monitoring functions used.

The 4 outputs included in the Sepam base unit (series 20 or series 40) may be extended by adding one MES114 modules with 10 logic inputs and 4 output relays. After selecting the MES114 type required by an application, the logic inputs must be assigned to functions. The functions are chosen from a list which covers the whole range of possible uses. The functions are adapted to meet needs within the limits of the logic inputs available. The inputs may also be inverted for undervoltage type operation.

A default input / output assignment is proposed for the most frequent uses.

### **Control and monitoring** Description of predefined functions

Each Sepam contains the appropriate predefined control and monitoring functions for the chosen application.

#### ANSI 94/69 - Commande disjoncteur/contacteur

Control of breaking devices equipped with different types of closing and tripping coils:

- circuit breakers with shunt or undervoltage trip coils
- Iatching contactors with shunt trip coils
- The function processes all breaking device closing and tripping conditions, based on:
- protection functions
- breaking device status data
- remote control orders
- specific control functions for each application (e.g. recloser).

The function also inhibits breaking device closing, according to the operating conditions.

With Sepam series 20, it is necessary to use an MES114 module in order to have all the required logic inputs.

#### ANSI 86 - Latching / acknowledgement

The tripping outputs for all the protection functions and all the logic inputs can be latched individually. The latched information is saved in the event of an auxiliary power failure.

(The logic outputs cannot be latched.)

All the latched data may be acknowledged.

- locally, with the → key
- remotely via a logic input
- or via the communication link.

The Latching/acknowledgement function, when combined with the circuit breaker/ contactor control function, can be used to create the ANSI 86 "Lockout relay" function.

#### **ANSI 68 - Logic discrimination**

This function provides:

 perfect tripping discrimination with phase-to-phase and phase-to-earth shortcircuits, on all types of network

■ faster tripping of the breakers closest to the source (solving the drawback of conventional time discrimination).

Each Sepam is capable of:

■ sending a blocking input when a fault is detected by the phase overcurrent and earth fault protection functions, which may or may not be directional (ANSI 50/51, 50N/51N, 67 or 67N/67NC)

■ and receiving blocking inputs which inhibit protection tripping. A saving mechanism ensures continued operation of the protection in the event of a blocking link failure.

#### **Output relay testing**

Each output relay is activated for 5 seconds, to make it simpler to check output connections and connected switchgear operation.

### **Control and monitoring** Description of predefined functions



Local indications on the Sepam front panel.

#### **ANSI 30 - Local annunciation**

#### LED indication on the Sepam front panel

- 2 LEDs indicate the unit operating status:
- □ green LED ON: Sepam on

□ red "key" LED: Sepam unavailable (initialization phase or detection of an internal failure)

- 9 yellow LEDs:
- □ pre-assigned and identified by standard removable labels
- the SFT2841 software tool may be used to assign LEDs and personalize labels.

#### Local annunciation on Sepam's advanced UMI

Events and alarms may be indicated locally on Sepam's advanced UMI by:

- messages on the display unit, available in 2 languages:
- □ english, factory-set messages, not modifiable

□ local language, according to the version delivered (the language version is chosen when Sepam is set up)

■ the lighting up of one of the 9 yellow LEDs, according to the LED assignment, which is set using SFT2841.

#### Alarm processing

when an alarm appears, the related message replaces the current display and the related LED goes on.

The number and type of messages depend on the type of Sepam. The messages are linked to Sepam functions and may be viewed on the front-panel display and in the SFT2841 "Alarms" screen.

■ to clear the message from the display, press the 🙀 key

■ after the fault has disappeared, press the 😭 key: the light goes off and Sepam is reset

■ the list of alarm messages remains accessible (▲ key) and may be cleared by pressing the ⇔ key.


# **Control and monitoring** Adaptation of predefined functions using the SFT2841 software

The predefined control and monitoring functions can be adapted for particular needs using the SFT2841 software, which offers the following customization options: customization of the control matrix by changing the assignment of output relays,

 customization of the control matrix by changing the assignment of output relays, LEDs and annunciation messages

 logic equation editor, to adapt and complete the predefined control and monitoring functions (Sepam series 40 only)

creation of personalized messages for local annunciation (Sepam series 40 only).



SFT2841: control matrix.

#### **Control matrix**

The control matrix is a simple way to assign data from:

- protection functions
- control and monitoring functions
- logic inputs
- logic equations
- to the following output data:
- output relays
- 9 LEDs on the front panel of Sepam
- messages for local annunciation
- triggering of disturbance recording.

#### Logic equation editor (Sepam series 40)

The logic equation editor included in the SFT2841 software can be used to:

- complete protection function processing:
- □ additional interlocking
- conditional inhibition/validation of functions
- □ etc.

 adapt predefined control functions: particular circuit breaker or recloser control sequences, etc.

A logic equation is created by grouping logic input data received from:

- protection functions
- logic inputs
- remote control orders

using the Boolean operators AND, OR, XOR, NOT, and automation functions such as time delays, bistables and time programmer.

Equation input is assisted and syntax checking is done systematically.

The result of an equation may then be:

- assigned to a logic output, LED or message via the control matrix
- transmitted by the communication link, as a new remote indication

 utilized by the circuit breaker/contactor control function to trip, close or inhibit breaking device closing

used to inhibit or reset a protection function.

#### Personalized alarm and operating messages (Sepam series 40)

The alarm and operating messages may be personalized using the SFT2841 software tool.

The new messages are added to the list of existing messages and may be assigned via the control matrix for display:

- on the Sepam display
- in the SFT2841 "Alarms" and "Alarm History" screens.

### Characteristics Sepam series 20 Sepam series 40

# **Base unit** Presentation

#### Base units are defined according to the following characteristics:

- type of User-Machine Interface (UMI)
- working language
- type of base unit connector
- type of current sensor connector.



Sepam base unit (series 20 or series 40) with integrated advanced UMI.



Sepam base unit (series 20 or series 40) with basic UMI.



Customized Chinese advanced UMI.

### **User-Machine Interface**

Two types of User-Machine Interfaces (UMI) are available for Sepam base units (series 20 or series 40):

- advanced UMI
- basic UMI.

The advanced UMI can be integrated in the base unit or installed remotely on the cubicle. Integrated and remote advanced UMIs offer the same functions.

- A Sepam (series 20 or series 40) with a remote advanced UMI is made up of :
- a base unit with basic UMI, for mounting inside the LV compartment
- a remote advanced UMI (DSM303)

□ for flush mounting on the front panel of the cubicle in the location most suitable for the facility manager

□ for connection to the Sepam base unit using a prefabricated CCA77x cord. The characteristics of the remote advanced UMI module (DSM303) are presented on page 162.

#### Advanced UMI

#### Comprehensive data for facility managers

All the data required for local equipment operation may be displayed on demand:

- display of all measurement and diagnosis data in numerical format with units and/ or in bar graphs
- display of operating and alarm messages, with alarm acknowledgment and Sepam resetting
- display and setting of all the Sepam parameters
- display and setting of all the parameters of each protection function
- display of Sepam and remote module versions
- output testing and logic input status display
- entry of 2 passwords to protect parameter and protection settings.

#### Ergonomic data presentation

- keypad keys identified by pictograms for intuitive navigation
- menu-guided access to data.
- graphical LCD screen to display any character or symbol
- excellent display quality under all lighting conditions: automatic contrast setting and backlit screen (user activated).

#### **Basic UMI**

A Sepam with basic UMI offers an economical solution suited to installations that do not require local operation (managed by a remote monitoring and control system) or to replace electromechanical or analog electronic protections units with no additional operating needs.

The basic UMI includes:

- 2 signal lamps indicating Sepam operating status:
   9 parameterizable yellow signal lamps equipped with a standard label
- button for clearing faults and resetting.

#### Working language

All the texts and messages displayed on the advanced UMI are available in 2 languages:

- english, the default working language
- and a second language, which may be
- □ french
- □ spanish
- another "local" language.

Please contact us regarding local language customization.

#### Setting and operating software

SFT2841 setting and operating software can be used for easy setting of Sepam parameters and protection functions.

A PC containing the SFT2841 software is connected to the communication port on the front of the unit.

Characteristics Sepam series 20 Sepam series 40

### Base unit Presentation

Selection guide			
Base unit	With basic UMI	With integrated advanced UMI	With remote advanced UMI
	Server	Be 1674m 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0	19792
Functions			
Local indication			
Metering and diagnosis data		•	•
Alarms and operating messages		•	•
Sepam parameter setting		•	•
Protection setting			•
Version of Sepam and remote modules		•	•
Status of logic inputs			•
Local control			
Alarmacknowledgement	•	•	•
Sepam reset			
Output testing		•	•
Characteristics			
Screen			
Size		128 x 64 pixels	128 x 64 pixels
Automatic contrast setting		•	•
Backlit screen		•	•
Keypad			
Number of keys	1	9	9
LEDs Sepam operating status	2 LEDs on front	2 LEDs on front	<ul> <li>base unit: 2 LEDs on front</li> <li>remote advanced UMI: 2 LEDs on front</li> </ul>
Indication LEDs	9 LEDs on front	9 LEDs on front	9 LEDs on remote advanced UMI
Mounting			
	Flush mounted on front of cubicle	Flush mounted on front of cubicle	<ul> <li>base unit with basic UMI, mounted at the back of the compartment using the AMT840 mounting plate</li> <li>DSM303 remote advanced UMI module ,flush mounted on the front of the cubicle and connected to the base unit with the CCA77x prefabricated cord</li> </ul>

# Base unit Presentation

### Hardware characteristics

#### Auxiliary power supply

Sepam series 20 and Sepam series 40 can be supplied by either of the following voltages:

24 to 250 V DC
 110 to 240 V AC.

#### Four relay outputs

The 4 relay outputs O1 to O4 on the base unit must be connected to connector  $(\underline{A})$ . Each output can be assigned to a predetermined function using the SFT2841 software.

O1, O2 and O3 are 3 control outputs with one NO contact. O1 and O2 are used by default for the switchgear control function:

- O1: switchgear tripping
- O2: switchgear closing inhibition.

O4 is an indication output with one NO contact and one NC contact.

It is used by default for the watchdog function.

#### Main connector (A)

A choice of 2 types of removable, screw-lockable 20-pin connectors:

- CCA620 screw-type connector
- CCA622 ring lug connector.

#### Phase current input connector

Current sensors connected to removable, screw-lockable connectors according to type of sensors used:

- CCA630 or CCA634 connector for 1 A or 5 A current transformers
- or
- CCA670 connector for LPCT sensors.
- The presence of these connectors is monitored.

#### Voltage input connector

#### Sepam B21 and B22

Voltage sensors connected to the removable, screw-lockable CCT640 connector. The presence of the CCT640 connector is monitored.

#### Sepam series 40

Voltage sensors connected to the 6-pin connector (E).

- A choice of 2 types of removable, screw-lockable 6-pin connectors:
- CCA626 screw-type connector
- or
- CCA627 ring lug connector.

The presence of the (E) connector is monitored.

### **Mounting accessories**

#### AMT840 mounting plate

It is used to mount a Sepam with basic UMI inside the compartment with access to connectors on the rear panel.

Mounting used with remote advanced UMI module (DSM303).

#### AMT852 lead sealing accessory

The AMT852 lead sealing accessory can be used to prevent unauthorized modification of the settings of Sepam series 20 and Sepam series 40 units with integrated advanced UMIs.

- The accessory includes:
- a lead-sealable cover plate
- the screws required to secure the cover plate to the integrated advanced UMI of the Sepam unit.


**Note:** the AMT852 lead sealing accessory can secured only to the integrated advanced UMIs of Sepam series 20 and Sepam series 40 units with serial numbers higher than 0440000.



Sepam unit with integrated advanced UMI and lead sealing accessory AMT852.

### Characteristics Sepam series 20 Sepam series 40

# **Base unit** Dimensions





HAZARD OF CUTS

any jagged edges.

serious injury.

### **Dimensions**





Sepam with advanced UMI and MES114, flush-mounted in front panel.

(1) With basic UMI: 23 mm (0.91 in).


Sepam with advanced UMI and MES114, flush-mounted in front panel.

### Cut-out

JF 80028

Cut-out accuracy must be complied with to ensure good withstand.

#### For mounting plate 3.17 mm (0.125 inch) thick




#### 162 <sup>±0,2</sup> 6.38


### Assembly with AMT840 mounting plate

Used to mount Sepam with basic UMI at the back of the compartment with access to the connectors on the rear panel.

Mounting associated with the use of the remote advanced UMI (DSM303).



Sepam with basic UMI and MES114, mounted with AMT840 plate. Mounting plate thickness: 2 mm (0.079 in).




CAUTION

Trim the edges of the cut-out plates to remove

Failure to follow this instruction can cause

AMT840 mounting plate.

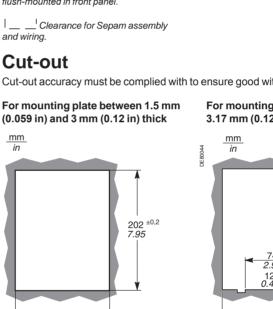


### Characteristics Sepam series 20 Sepam series 40

### Base unit Description


- 1 Green LED: Sepam on.
- 2 Red LED: Sepam unavailable.
- **3** 9 yellow indication LEDs.
- 4 Label identifying the indication LEDs.
- 5 Graphical LCD screen.
- 6 Display of measurements.
- 7 Display of switchgear, network and machine diagnosis data.
- 8 Display of alarm messages.
- 9 Sepam reset (or confirm data entry).10 Acknowledgement and clearing of alarms
- (or move cursor up).
- 11 LED test (or move cursor down).
- 12 Access to protection settings.
- 13 Access to Sepam parameter setting.
- 14 Entry of 2 passwords.
- 15 PC connection port.

The " $\dashv$ ,  $\blacktriangle$ ,  $\bigstar$  keys (9, 10, 11) are used to browse through the menus and to scroll through and accept the values displayed.

- 1 Green LED: Sepam on.
- 2 Red LED: Sepam unavailable.
- **3** 9 yellow indication LEDs.
- 4 Label identifying the indication LEDs.
- 5 Acknowledgement / clearing of alarms and Sepam reset.
- 6 PC connection port.

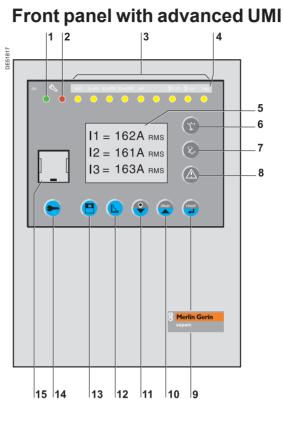


### Front panel with basic UMI

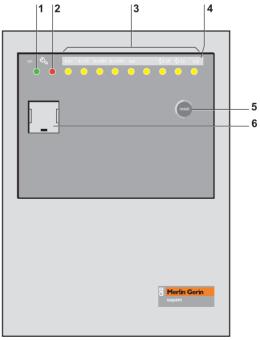


DF51818

### Characteristics Sepam series 20 Sepam series 40

### Base unit Description

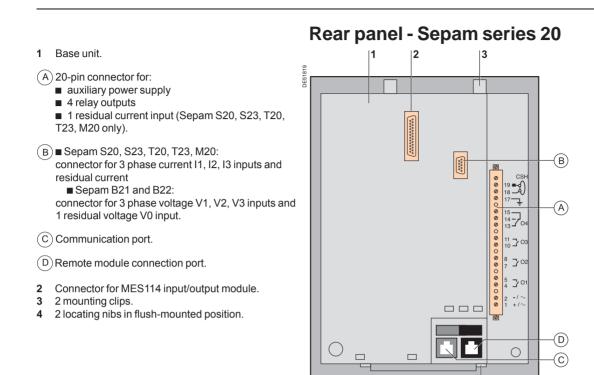

- 1 Base unit.
  - 20-pin connector for:
  - auxiliary poxer supply
  - 4 relay outputs
  - 1 residual current input.
- (B) Connector for 3 phase current I1, I2, I3 inputs and residual current
- C Communication port.
- (D) Remote module connection port .
- (E) 6-pin connector for 3 phase voltage V1, V2, V3 inputs.
- 2 Connector for MES114 input/output module.
- 3 2 mounting clips.
- 4 2 locating nibs in flush-mounted position.

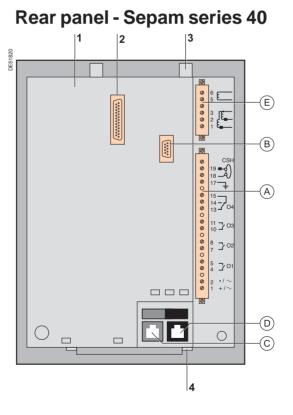

4

### **Base unit Technical characteristics**

Weight						
Sepam series 20		Minimum weight (	base unit with basic	LIMI and without M	IES114)	1.2 kg (2.6 lb)
Separit Series 20					,	1.7 kg (3.7 lb)
Sepam series 40		Maximum weight (base unit with advanced UMI and MES114) Minimum weight (base unit with basic UMI and without MES114)			1.4 kg (3.1 lb)	
			(base unit with adva		,	1.9 kg (4.2 lb)
Analog inputs		Maximum weight	(Dase unit with adva		5114)	1.9 Kg (4.2 lb)
Analog inputs						
Current transformer		Input impedance				< 0.02 Ω
A or 5 A CT (with CCA630 or CC	CA634)	Consumption				< 0.02 VA at 1 A
1 A to 6250 A ratings						< 0.5 VA at 5 A
		Rated thermal wit				4 In
		1-second overloa	d			100 ln
/oltage transformer		Input impedance				> 100 kΩ
220 V to 250 kV ratings		Input voltage				100 to 230/√3 V
		Rated thermal wit				240 V
		1-second overloa	d			480 V
<b>Temperature sensor</b>	input (MET148-2 mo	dule)				
ype of sensor		Pt 100				Ni 100 / 120
solation from earth		None				None
Current injected in sensor		4 mA				4 mA
Maximum distance between sens	sor and module	1 km (0.62 mi)				
Logic inputs		MES114	MES114E		MES114F	
/oltage		24 to 250 V DC	110 to 125 V DC	110 V AC	220 to 250 V DC	220 to 240 V AC
Range		19.2 to 275 V DC	88 to 150 V DC	88 to 132 V AC	176 to 275 V DC	176 to 264 V AC
Frequency		-	-	47 to 63 Hz	-	47 to 63 Hz
Typical consumption		3 mA	3 mA	3 mA	3 mA	3 mA
ypical switching threshold		14 V DC	82 V DC	58 V AC	154 V DC	120 V AC
nput limit voltage	At state 1	≥ 19 V DC	≥88 V DC	≥ 88 V AC	≥ 176 V DC	≥176 V AC
	At state 0	≤6VDC	≤75 V DC	≤22 V AC	≤ 137 V DC	≤48 V AC
solation of inputs in relation to ot	her isolated groups	Enhanced	Enhanced	Enhanced	Enhanced	Enhanced
Relays outputs						
Control relay outputs (O1	02.03.011 contacts) (2)					
/oltage	DC	24 / 48 V DC	127 V DC	220 V D	)C	
, onago	AC (47.5 to 63 Hz)	-	-	-	-	) to 240 V AC
Continuous current		8A	8A	8A	8A	
Breaking capacity	Resistive load	8/4A	0.7 A	0.3A	0/1	•
sicalling capacity	L/R load < 20 ms	6/2A	0.5 A	0.2A		
	L/R load < 40 ms	4/1A	0.2 A	0.1A		
	Resistive load	-	-	-	8A	
	p.f. load > 0.3	_	-		5A	
Making capacity	p.i. iodd - 0.0	< 15 A for 200 ms			0/1	
solation of outputs in relation to c	other isolated arouns	Enhanced				
	• •					
	t (04, 012, 013, 014 conta	,	127.100	220 \/ E		
	DC	24 / 48 V DC	127 V DC	220 V D		
/oltage	· · · ·	24/48VDC -	-	-	100	) to 240 V AC
/oltage Continuous current	DC AC (47.5 to 63 Hz)	24/48 V DC - 2 A	- 2 A	- 2 A		
/oltage Continuous current	DC AC (47.5 to 63 Hz) L/R load < 20 ms	24/48 V DC - 2A 2/1A	- 2A 0.5A	- 2A 0.15A	100 2 A	
/oltage Continuous current Breaking capacity	DC AC (47.5 to 63 Hz) L/R load < 20 ms p.f. load > 0.3	24/48VDC - 2A 2/1A -	- 2 A	- 2 A	100	
/oltage Continuous current Breaking capacity solation of outputs in relation to o	DC AC (47.5 to 63 Hz) L/R load < 20 ms p.f. load > 0.3	24/48 V DC - 2A 2/1A	- 2A 0.5A	- 2A 0.15A	100 2 A	
Poltage Continuous current Breaking capacity solation of outputs in relation to o <b>Power supply</b>	DC AC (47.5 to 63 Hz) L/R load < 20 ms p.f. load > 0.3	24/48 V DC - 2A 2/1A - Enhanced	- 2A 0.5A	- 2 A 0.15 A -	100 2 A 1 A	
Continuous current Breaking capacity solation of outputs in relation to o <b>Power supply</b> /oltage	DC AC (47.5 to 63 Hz) L/R load < 20 ms p.f. load > 0.3	24/48 V DC - 2A 2/1A - Enhanced 24/250 V DC	- 2A 0.5A	- 2 A 0.15 A - 110 / 24	100 2 A 1 A 0 VAC	
Continuous current Breaking capacity solation of outputs in relation to o <b>Power supply</b> /oltage Range	DC AC (47.5 to 63 Hz) L/R load < 20 ms p.f. load > 0.3 other isolated groups	24 / 48 V DC - 2 A 2 / 1 A - Enhanced 24 / 250 V DC -20 % +10 %	- 2A 0.5A	- 2 A 0.15 A - 110 / 24 -20 % +	100 2 A 1 A	
Continuous current Breaking capacity solation of outputs in relation to o <b>Power supply</b> Yoltage Range	DC AC (47.5 to 63 Hz) L/R load < 20 ms p.f. load > 0.3 other isolated groups	24 / 48 V DC - 2 A 2 / 1 A - Enhanced 24 / 250 V DC -20 % +10 % < 4.5 W	- 2A 0.5A	- 2 A 0.15 A - 110 / 24 -20 % + < 6 VA	100 2 A 1 A 0 VAC	
Continuous current Breaking capacity solation of outputs in relation to on <b>Power supply</b> Coltage Range Deactivated consumption <sup>(1)</sup>	DC AC (47.5 to 63 Hz) L/R load < 20 ms p.f. load > 0.3 other isolated groups Sepam series 20 Sepam series 40	24 / 48 V DC - 2 A 2 / 1 A - Enhanced 24 / 250 V DC -20 % +10 % < 4.5 W < 6 W	- 2A 0.5A	- 2 A 0.15 A - 110 / 24 -20 % +	100 2 A 1 A 0 VAC	
Continuous current Continuous current Breaking capacity Solation of outputs in relation to on <b>Power supply</b> Voltage Range Deactivated consumption <sup>(1)</sup>	DC AC (47.5 to 63 Hz) L/R load < 20 ms p.f. load > 0.3 other isolated groups	24 / 48 V DC - 2 A 2 / 1 A - Enhanced 24 / 250 V DC -20 % +10 % < 4.5 W < 6 W < 8 W	- 2A 0.5A	- 2 A 0.15 A - 110 / 24 -20 % + < 6 VA < 6 VA < 15 VA	10( 2 A 1 A 0 V AC 10 % (47.5 to 63 Hz	
Continuous current Breaking capacity solation of outputs in relation to on <b>Power supply</b> Coltage Range Deactivated consumption <sup>(1)</sup>	DC AC (47.5 to 63 Hz) L/R load < 20 ms p.f. load > 0.3 other isolated groups Sepam series 20 Sepam series 40	24 / 48 V DC - 2 A 2 / 1 A - Enhanced 24 / 250 V DC -20 % +10 % < 4.5 W < 6 W	- 2A 0.5A	- 2 A 0.15 A - 110 / 24 -20 % + < 6 VA < 6 VA	10( 2 A 1 A 0 V AC 10 % (47.5 to 63 Hz	
Voltage Continuous current Breaking capacity solation of outputs in relation to o <b>Power supply</b> Voltage Range Deactivated consumption <sup>(1)</sup>	DC AC (47.5 to 63 Hz) L/R load < 20 ms p.f. load > 0.3 other isolated groups Sepam series 20 Sepam series 40 Sepam series 20	24 / 48 V DC - 2 A 2 / 1 A - Enhanced 24 / 250 V DC -20 % +10 % < 4.5 W < 6 W < 8 W	- 2A 0.5A -	- 2 A 0.15 A - - 110 / 24 -20 % + < 6 VA < 6 VA < 6 VA < 15 VA < 25 VA	10( 2 A 1 A 0 V AC 10 % (47.5 to 63 Hz	
Voltage Continuous current Breaking capacity solation of outputs in relation to o	DC AC (47.5 to 63 Hz) L/R load < 20 ms p.f. load > 0.3 other isolated groups Sepam series 20 Sepam series 40 Sepam series 20 Sepam series 20 Sepam series 20	24 / 48 V DC - 2 A 2 / 1 A - Enhanced 24 / 250 V DC -20 % +10 % < 4.5 W < 6 W < 8 W < 11 W	- 2A 0.5A -	- 2 A 0.15 A - - 110 / 24 -20 % + < 6 VA < 6 VA < 6 VA < 15 VA < 25 VA	10( 2 A 1 A 0 V AC 10 % (47.5 to 63 Hz	
Voltage Continuous current Breaking capacity solation of outputs in relation to o <b>Power supply</b> Voltage Range Deactivated consumption <sup>(1)</sup> Maximum consumption <sup>(1)</sup>	DC AC (47.5 to 63 Hz) L/R load < 20 ms p.f. load > 0.3 other isolated groups Sepam series 20 Sepam series 40 Sepam series 20 Sepam series 40 Sepam series 20, serie 40	24 / 48 V DC - 2A 2 / 1A - Enhanced 24 / 250 V DC -20 % +10 % < 4.5 W < 6 W < 8 W < 11 W < 10 A for 10 ms, <	- 2A 0.5A -	- 2 A 0.15 A - - 110 / 24 -20 % + < 6 VA < 6 VA < 6 VA < 15 VA < 25 VA < 15 A	10( 2 A 1 A 0 V AC 10 % (47.5 to 63 Hz	
Voltage Continuous current Breaking capacity solation of outputs in relation to o <b>Power supply</b> Voltage Range Deactivated consumption <sup>(1)</sup> Maximum consumption <sup>(1)</sup>	DC AC (47.5 to 63 Hz) L/R load < 20 ms p.f. load > 0.3 other isolated groups Sepam series 20 Sepam series 40 Sepam series 20 Sepam series 40 Sepam series 20, serie 40 Sepam series 20, serie 40 Sepam series 20 Sepam series 20 Sepam series 20	24 / 48 V DC - 2A 2 / 1A - Enhanced 24 / 250 V DC -20 % +10 % < 4.5 W < 6 W < 8 W < 10 A for 10 ms, <	- 2A 0.5A -	- 2 A 0.15 A - - 110 / 24 -20 % + < 6 VA < 6 VA < 6 VA < 15 VA < 25 VA < 15 Aft 10 ms	10( 2 A 1 A 0 V AC 10 % (47.5 to 63 Hz	
A continuous current Continuous current Breaking capacity solation of outputs in relation to of <b>Power supply</b> (oltage Range Deactivated consumption (1) Maximum consumption (1) Maximum consumption (1) Inrush current Acceptable momentary outages <b>Analog output (MSA</b>	DC AC (47.5 to 63 Hz) L/R load < 20 ms p.f. load > 0.3 other isolated groups Sepam series 20 Sepam series 40 Sepam series 20 Sepam series 40 Sepam series 20, serie 40 Sepam series 20, serie 40 Sepam series 20 Sepam series 20 Sepam series 20	24 / 48 V DC - 2A 2 / 1A - Enhanced 24 / 250 V DC -20 % +10 % < 4.5 W < 6 W < 8 W < 11 W < 10 A for 10 ms, < 10 ms 10 ms	- 2 A 0.5 A - -	- 2 A 0.15 A - - 110 / 24 -20 % + < 6 VA < 6 VA < 6 VA < 15 VA < 25 VA < 15 Aft 10 ms	10( 2 A 1 A 0 V AC 10 % (47.5 to 63 Hz	
Voltage Continuous current Breaking capacity solation of outputs in relation to o <b>Power supply</b> Voltage Range Deactivated consumption <sup>(1)</sup> Maximum consumption <sup>(1)</sup> Inrush current Acceptable momentary outages	DC AC (47.5 to 63 Hz) L/R load < 20 ms p.f. load > 0.3 other isolated groups Sepam series 20 Sepam series 40 Sepam series 20 Sepam series 40 Sepam series 20, serie 40 Sepam series 20, serie 40 Sepam series 20 Sepam series 20 Sepam series 20	24 / 48 V DC - 2A 2 / 1A - Enhanced 24 / 250 V DC -20 % +10 % < 4.5 W < 6 W < 8 W < 10 A for 10 ms, <	- 2 A 0.5 A - - 28 A for 100 µs	- 2 A 0.15 A - - 110 / 24 -20 % + < 6 VA < 6 VA < 6 VA < 15 VA < 25 VA < 15 Aft 10 ms	10( 2 A 1 A 0 V AC 10 % (47.5 to 63 Hz	

(1) According to configuration. (2) Relay outputs comply with clause 6.7 of standard C37.90 (30 A, 200 ms, 2000 operations).

### **Characteristics** Sepam series 20 . Sepam series 40


### **Base unit Environmental characteristics**

Electromagnetic compatibility	Standard	Level / Class	Value
Emission tests			
Disturbing field emission	IEC 60255-25		
	EN 55022	A	
Conducted disturbance emission	IEC 60255-25		
	EN 55022	В	
Immunity tests – Radiated disturbances			
nmunity to radiated fields	IEC 60255-22-3		10 V/m ; 80 MHz - 1 GHz
	IEC 61000-4-3	III	10 V/m ; 80 MHz - 2 GHz
	ANSI C37.90.2 (1995)		35 V/m ; 25 MHz - 1 GHz
lectrostatic discharge	IEC 60255-22-2		8 kV air ; 6 kV contact
	ANSI C37.90.3		8 kV air ; 4 kV contact
mmunity to magnetic fields at network frequency	IEC 61000-4-8	IV	30 A/m (continuous) - 300 A/m (13
Immunity tests – Conducted disturbances			40.1/
nmunity to conducted RF disturbances	IEC 60255-22-6 IEC 60255-22-4	A or B	10 V
ast transient bursts	IEC 60255-22-4	IV	4 kV ; 2.5 kHz / 2 kV ; 5 kHz 4 kV ; 2.5 kHz
	ANSI C37.90.1	10	4 kV ; 2.5 kHz
MHz damped oscillating wave	IEC 60255-22-1		2.5 kV MC ; 1 kV MD
winiz damped oscillating wave	ANSI C37.90.1		2.5 kV MC and MD
00 kHz damped oscillating wave	IEC 61000-4-12		2.5 kV MC ; 1 kV MD
urges	IEC 61000-4-5		2 kV MC ; 1 kV MD
oltage interruptions	IEC 60255-11		Series 20: 100 %, 10 ms
			Series 40: 100 %, 20 ms
Mechanical robustness	Standard	Level / Class	Value
In operation	otandara		Tuluo .
librations	IEC 60255-21-1	2	1 Gn ; 10 Hz - 150 Hz
IDIAUOIIS	IEC 60255-21-1	2 Fc	2 Hz - 13.2 Hz ; a = ±1 mm
Shocks	IEC 60255-21-2	2	10 Gn / 11 ms
arthquakes	IEC 60255-21-2	2	2 Gn (horizontal axes)
ailiquakes	IEC 00235-21-3	2	1 Gn (vertical axes)
De-energized			i Gii (ventical axes)
ibrations	IEC 60255-21-1	2	2 Gn ; 10 Hz - 150 Hz
Chocks	IEC 60255-21-1	2	30 Gn / 11 ms
olts	IEC 60255-21-2	2	20 Gn / 16 ms
		Level / Class	
Climatic withstand	Standard	Level / Class	Value
In operation			
xposure to cold	IEC 60068-2-1	Series 20: Ab	-25 °C (-13 °F)
where the dry best	IEC 60068-2-2	Series 40: Ad Series 20: Bb	+70 °C (+158 °F)
xposure to dry heat	IEC 00068-2-2	Series 40: Bd	+70 C(+156 F)
Continuous exposure to damp heat	IEC 60068-2-3	Ca	10 days; 93 % RH; 40 °C (104 °F)
emperature variation with specified variation rate	IEC 60068-2-14	Nb	-25 °C to +70 °C (-13 °F to +158 °
			5 °C/min (41 °F/min)
alt mist	IEC 60068-2-52	Kb/2	••••••••
nfluence of corrosion/gaz test 2	IEC 60068-2-60	С	21 days ; 75 % RH ; 25 °C (-13 °F)
C C			0.5 ppm H <sub>2</sub> S ; 1 ppm SO <sub>2</sub>
nfluence of corrosion/gaz test 4	IEC 60068-2-60		21 days ; 75 % RH ; 25 °C ;
			0.01 ppm H <sub>2</sub> S; 0.2 ppm SO <sub>2</sub> ;
			0.02 ppm NÕ <sub>2;</sub> ; 0.01 ppm Cl <sub>2</sub>
In storage <sup>(3)</sup>			
xposure to cold	IEC 60068-2-1	Ab	-25 °C (-13 °F)
xposure to dry heat	IEC 60068-2-2	Bb	+70 °C (+158 °F)
· · · ·		Са	56 days ; 93 % RH ; 40 °C (104 °F)
continuous exposure to damp heat	IEC 60068-2-3		
Continuous exposure to damp heat	IEC 60068-2-3 Standard	Level / Class	Value
Continuous exposure to damp heat Safety		Level / Class	Value
Safety Enclosure safety tests		Level / Class	Value Other panels closed, except for
Safety Enclosure safety tests	Standard IEC 60529	IP52	Other panels closed, except for rear panel IP20
Continuous exposure to damp heat Safety Enclosure safety tests ront panel tightness	Standard IEC 60529 NEMA		Other panels closed, except for rear panel IP20
ontinuous exposure to damp heat Safety Enclosure safety tests ront panel tightness	Standard IEC 60529	IP52	Other panels closed, except for rear panel IP20
ontinuous exposure to damp heat Safety Enclosure safety tests ront panel tightness	Standard IEC 60529 NEMA	IP52	Other panels closed, except for rear panel IP20 d 650 °C with glow wire (1562 °F)
ontinuous exposure to damp heat Safety Enclosure safety tests ront panel tightness ire withstand Electrical safety tests 2/50 µs impulse wave	Standard           IEC 60529           NEMA           IEC 60695-2-11           IEC 60255-5	IP52	Other panels closed, except for rear panel IP20 d 650 °C with glow wire (1562 °F) 5 kV <sup>(1)</sup>
Anotinuous exposure to damp heat Safety Enclosure safety tests ront panel tightness ire withstand Electrical safety tests .2/50 µs impulse wave ower frequency dielectric withstand	Standard IEC 60529 NEMA IEC 60695-2-11	IP52	Other panels closed, except for rear panel IP20 d 650 °C with glow wire (1562 °F)
Anotinuous exposure to damp heat Safety Enclosure safety tests ront panel tightness ire withstand Electrical safety tests .2/50 µs impulse wave ower frequency dielectric withstand	Standard           IEC 60529           NEMA           IEC 60695-2-11           IEC 60255-5	IP52	Other panels closed, except for rear panel IP20 d 650 °C with glow wire (1562 °F) 5 kV <sup>(1)</sup>
Certification Certification Continuous exposure to damp heat Safety Enclosure safety tests Front panel tightness Fire withstand Electrical safety tests 2/50 µs impulse wave Power frequency dielectric withstand Certification	Standard           IEC 60529           NEMA           IEC 60695-2-11           IEC 60255-5           IEC 60255-5           IEC 60255-5           Harmonized standard:	IP52 Type 12 with gasket supplie	Other panels closed, except for rear panel IP20 d 650 °C with glow wire (1562 °F) 5 kV <sup>(1)</sup> 2 kV 1 mn <sup>(2)</sup>
Continuous exposure to damp heat Safety Enclosure safety tests Front panel tightness Fire withstand Electrical safety tests .2/50 µs impulse wave Power frequency dielectric withstand Certification	Standard           IEC 60529           NEMA           IEC 60695-2-11           IEC 60255-5           IEC 60255-5	IP52 Type 12 with gasket supplie European directives: 89/336/CEE Electromag 92/31/CEE Amendmen 93/68/CEE Amendmen 73/23/CEE Low Voltage	Other panels closed, except for rear panel IP20 d 650 °C with glow wire (1562 °F) 5 kV <sup>(1)</sup> 2 kV 1 mn <sup>(2)</sup> gnetic Comptability (EMC) Directive t t e Directive
Continuous exposure to damp heat Safety Enclosure safety tests ront panel tightness ire withstand Electrical safety tests .2/50 µs impulse wave lower frequency dielectric withstand Certification	Standard           IEC 60529           NEMA           IEC 60695-2-11           IEC 60255-5           IEC 60255-5           IEC 60255-5           Harmonized standard:	IP52 Type 12 with gasket supplie European directives: 89/336/CEE Electromag 92/31/CEE Amendmen 93/68/CEE Amendmen 73/23/CEE Low Voltage 93/68/CEE Amendmen	Other panels closed, except for rear panel IP20 d 650 °C with glow wire (1562 °F) 5 kV <sup>(1)</sup> 2 kV 1 mn <sup>(2)</sup> gnetic Comptability (EMC) Directive t t e Directive

Except for communication: 3 kV in common mode and 1kV in differential mode
 Except for communication: 1 kVrms
 Sepam must be stored in its original packing.



### Base unit Sepam series 20

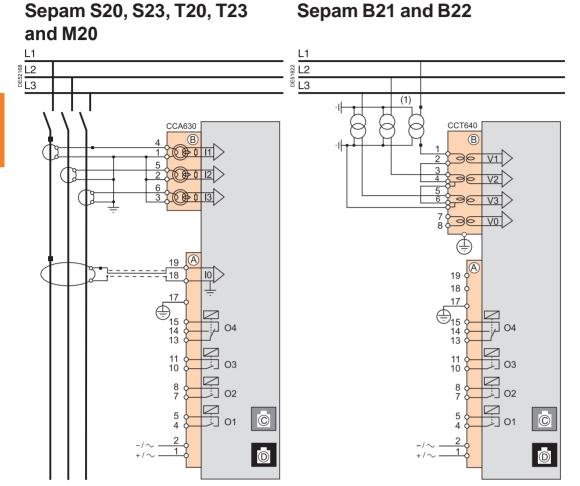

(1) This type of connection allows the calculation of residual voltage.

#### Connection

Dangerous voltages may be present on the terminal screws, whether the terminals are used or not. To avoid all danger of electrical shock, tighten all terminal screws so that they cannot be touched inadvertently.


Connector	Туре	Reference	Wiring
	Screw type	CCA620	<ul> <li>wiring with no fittings:</li> <li>1 wire with max. cross-section 0.2 to 2.5 mm² (≥AWG 24-12) or 2 wires with max. cross-section 0.2 to 1 mm² (≥AWG 24-16)</li> <li>stripped length: 8 to 10 mm</li> <li>wiring with fittings:</li> <li>recommended wiring with Telemecanique fittings:</li> <li>DZ5CE015D for 1 x 1.5 mm² wire</li> <li>DZ5CE025D for 1 x 2.5 mm² wire</li> <li>AZ5DE010D for 2 x 1 mm² wires</li> <li>tube length: 8.2 mm</li> <li>stripped length: 8 mm</li> </ul>
	6.35 mm ring lugs	CCA622	<ul> <li>6.35 mm ring or spade lugs (1/4 in)</li> <li>maximum wire cross-section of 0.2 to 2.5 mm² (≥ AWG 24-12)</li> <li>stripped length: 6 mm</li> <li>use an appropriate tool to crimp the lugs on the wires</li> <li>maximum of 2 ring or spade lugs per terminal</li> <li>tightening torque: 0.7 to 1 Nm</li> </ul>
For Sepam S20, S23, T20, T23 and	4 mm ring lugs	CCA630, CCA634 for connection of 1 A or 5 A CTs	<ul> <li>wire cross-section of 1.5 to 6 mm<sup>2</sup> (AWG 16-10)</li> <li>tightening torque: 1.2 Nm (13.27 lb-in)</li> </ul>
M20	RJ45 plug	CCA670, for connection of 3 LPCT sensors	Integrated with LPCT sensor
For Sepam B21 and B22	Screw type	CCT640	Same as wiring for the CCA620
	Green RJ45 plug		CCA612
	Black RJ45 plug		CCA770: L = 0.6 m (2 ft) CCA772: L = 2 m (6.6 ft) CCA774: L = 4 m (13 ft)

Merlin Geri

76

### Connection diagrams Sepam series 20 Sepam series 40

### Base unit Sepam series 40

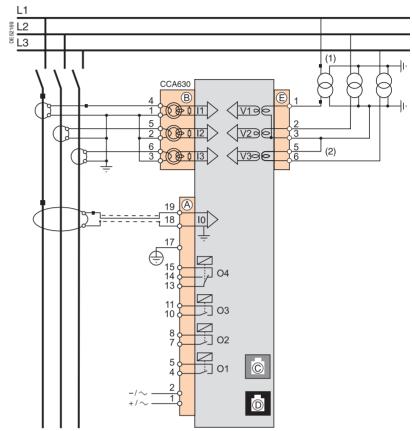

(1) This type of connection allows the calculation of residual voltage. (2) Accessory for bridging terminals 3 and 5 supplied with CCA626 and CCA627 connector.

### Connection


Dangerous voltages may be present on the terminal screws, whether the terminals are used or not. To avoid all danger of electrical shock, tighten all terminal screws so that they cannot be touched inadvertently.

Connector	Туре	Reference	Wiring
	Screw type	CCA620	<ul> <li>wiring with no fittings:</li> <li>1 wire with max. cross-section 0.2 to 2.5 mm² (≥AWG 24-12) or 2 wires with max. cross-section 0.2 to 1 mm² (≥AWG 24-16)</li> <li>stripped length: 8 to 10 mm</li> <li>wiring with fittings:</li> <li>recommended wiring with Telemecanique fittings:</li> <li>DZ5CE015D for 1 x 1.5 mm² wire</li> <li>DZ5CE025D for 1 x 2.5 mm² wire</li> <li>AZ5DE010D for 2 x 1 mm² wires</li> <li>tube length: 8.2 mm</li> <li>stripped length: 8 mm</li> </ul>
	6.35 mm ring lugs	CCA622	<ul> <li>€ .35 mm ring or spade lugs (1/4 in)</li> <li>maximum wire cross-section of 0.2 to 2.5 mm<sup>2</sup> (≥ AWG 24-12)</li> <li>stripped length: 6 mm</li> <li>use an appropriate tool to crimp the lugs on the wires</li> <li>maximum of 2 ring or spade lugs per terminal</li> <li>tightening torque: 0.7 to 1 Nm</li> </ul>
	4 mm ring lugs	CCA630, CCA634, for connection of 1 A or 5 A CTs	<ul> <li>wire cross-section of 1.5 to 6 mm<sup>2</sup> (AWG 16-10)</li> <li>tightening torque: 1.2 Nm (13.27 lb-in)</li> </ul>
	RJ45 plug	CCA670, for connection of 3 LPCT sensors	Integrated with LPCT sensor
	Green RJ45 plug		CCA612
	Black RJ45 plug		CCA770: L = 0.6 m (2 ft) CCA772: L = 2 m (6.6 ft) CCA774: L = 4 m (13 ft)
	Screw type	CCA626	Same as wiring for the CCA620
	6.35 mm ring lugs	CCA627	Same as wiring for the CCA622



### **Base unit** Other phase current input connection schemes

#### Variant 1: phase current measurements by 3 x 1 A or 5 A CTs (standard connection)



L1 L2 L3

**7E80145** 

Description

Connection of 3 x 1 A or 5 A sensors to the CCA630 or CCA634 connector.

The measurement of the 3 phase currents allows the calculation of residual current.

#### Parameters

i aramotoro	
Sensor type	5 A C T or 1 A C T
Number of CTs	11, 12, 13
Rated current (In)	1 A to 6250 A

#### Variant 2: phase current measurement by 2 x 1 A or 5 A CTs



**Description** Connection of 2 x 1 A or 5 A sensors to the CCA630 or CCA634 connector.


The measurement of phase currents 1 and 3 is sufficient to ensure all the phase current-based protection functions. The phase current I2 is only assessed for metering functions, assuming that I0 = 0.

This arrangement does not allow the calculation of residual current.

#### Parameters

Sensor type	5 A C T or 1 A C T
Number of CTs	11, 13
Rated current (In)	1 A to 6250 A

#### Variant 3: phase current measurement by 3 LPCT type sensors



#### Description

Connection of 3 Low Power Current Transducer (LPCT) type sensors to the CCA670 connector. The connection of only one or two LPCT sensors is not allowed and causes Sepam to go into fail-safe position.

The measurement of the 3 phase currents allows the calculation of residual current.

#### Parameters

Sensor type	LPCT
Number of CTs	11, 12, 13
Rated current (In)	25, 50, 100, 125, 133, 200, 250, 320, 400, 500, 630, 666, 1000, 1600, 2000 or 3150 A

Note: Parameter In must be set 2 twice:

Software parameter setting using the advanced UMI or the SFT2841 software tool

■ Hardware parameter setting using microswitches on the CCA670 connector

### **Base unit** Other residual current input connection schemes

#### Variant 1: residual current calculation by sum of 3 phase currents


#### Description

Residual current is calculated by the vector sum of the 3 phase currents 11, 12 and I3, measured by 3 x 1 A or 5 A CTs or by 3 LPCT type sensors. See current input connection diagrams.

#### Parameters

Residual current	Rated residual current	Measuring range	
Sum of 3 Is	In0 = In, CT primary current	0.1 to 40 In0	

#### Variant 2: residual current measurement by CSH120 or CSH200 core balance CT (standard connection)




#### Description

Arrangement recommended for the protection of isolated or compensated neutral systems, in which very low fault currents need to be detected.

#### Parameters

Residual current	Rated residual current	Measuring range
2 A rating CSH	In0 = 2 A	0.2 to 40 A
5 A rating CSH (Sepam series 40)	In0 = 5 A	0.5 to 100 A
20 A rating CSH	In0 = 20 A	2 to 400 A
20 A rating CSH	In0 = 20 A	2 to 400 A

#### Variant 3: residual current measurement by 1 A or 5 A CTs and CCA634




#### Description

Residual current measurement by 1 A or 5 A CTs. Terminal 7: 1 A CT

- Terminal 8: 5 A CT

#### Parameters

Residual current	Rated residual current	Measuring range
1 A CT	In0 = In, CT primary current	0.1 to 20 In0
1 A CT sensitive	In0 = In/10 (Sepam series 40)	0.1 to 20 In0
5ACT	In0 = In, CT primary current	0.1 to 20 In0
5 A CT sensitive	In0 = In/10 (Sepam series 40)	0.1 to 20 In0



LL3

÷

### **Base unit** Other residual current input connection schemes

#### Variant 4: residual current measurement by 1 A or 5 A CTs and CSH30 interposing ring CT

A

10

19

18



The CSH30 interposing ring CT is used to connect 1 A or 5 A CTs to Sepam to measure residual current:


connection of CSH30 interposing ring CT to 1 A CT: make 2 turns through CSH primary

■ connection of CSH30 interposing ring CT to 5 A CT: make 4 turns through CSH primary.

■ for Sepam series 40, the sensitivity can be mulitplied by 10 using the "sensitive" setting with In0 = In/10.

#### Parameters


Residual current	Rated residual current	Measuring range
1 A CT	In0 = In, CT primary current	0.1 to 20 In0
1 A CT sensitive	In0 = In/10 (Sepam series 40)	0.1 to 20 In0
5ACT	In0 = In, CT primary current	0.1 to 20 In0
5 A CT sensitive	In0 = In/10 (Sepam series 40)	0.1 to 20 In0



CSH30

CT 1 A : 2 turns CT 5 A : 4 turns

#### Variant 5: residual current measurement by core balance CT with ratio of 1/n (n between 50 and 1500)



#### Description

The ACE990 is used as an interface between an MV core balance CT with a ratio of 1/n (50 < n < 1500) and the Sepam residual current input. This arrangement allows the continued use of existing core balance CTs on the installation.

#### Parameters

Residual current	Rated residual current	Measuring range
ACE990 - range 1	$ln0 = lk.n^{(1)}$	0.1 to 20 In0
(0.00578≤ k≤ 0.04)		
ACE990 - range 2	$ln0 = lk.n^{(1)}$	0.1 to 20 In0
(0.0578 ≤ k ≤ 0.26316)		
	0.7	

(1) n = number of core balance CT turns

 $\dot{k}$  = factor to be determined according to ACE990 wiring and setting range used by Sepam


DE80115

### Connection diagrams Sepam series 20 Sepam series 40

### Voltage inputs Sepam series 20

The phase and residual voltage transformer secondary circuits are connected to the CCT640 connector (item (B)) on Sepam series 20 type B units. The CCT640 connector contains 4 transformers which perform isolation and impedance matching of the VTs and Sepam input circuits.


#### Variant 1: measurement of 3 phase-to-neutral voltages (standard connection)



Parameters	
Voltages measured by VTs	V1, V2, V3
Residual voltage	Sum of 3Vs
Voltages measured	V1, V2, V3
Functions available	V/1 V/2 V/2
Values calculated	U21, U32, U13, V0, Vd, f
Measurements available	All

Protection functions available (according to type of Sepam) All

#### Variant 2: measurement of 3 phase-to-neutral voltages and residual voltage




#### Parameters

Voltages measured by VTs	V1, V2, V3
Residual voltage	External VT

#### Functions available

Voltages measured	V1, V2, V3, V0
Values calculated	U21, U32, U13, Vd, f
Measurements available	All
Protection functions available (according to type of Sepam)	All


#### Variant 3: measurement of 2 phase-to-phase voltages



U21, U32	
None	
	None

Voltages measured	V1, V2, V3
Values calculated	U13, Vd, f
Measurements available	U21, U32, U13, Vd, f
Protection functions available (according to type of Sepam)	All except 59N, 27S


#### Variant 4: measurement of 1 phase-to-phase voltage and residual voltage



Parameters	1124	
Voltages measured by VTs	U21	
Residual voltage	External VT	

Functions available	
Voltages measured	U21, V0
Values calculated	f
Measurements available	U21, V0, f
Protection functions available (according to type of Sepam)	All except 47, 27D, 27S

#### Variant 5: measurement of 1 phase-to-phase voltage



Voltages measured by VTs	U21	
Residual voltage	None	

# Functions available Voltages measured U21 Values calculated f Measurements available U21, f

Protection functions available (according to type of Sepam) All except 47, 27D, 59N, 27S


Merlin Ge

### Voltage inputs Sepam series 40

The phase and residual voltage transformer secondary circuits are connected directly to the connector marked  $(\underline{E})$ .

The 3 impedance matching and isolation transformers are integrated in the Sepam series 40 base unit.

#### Variant 1: measurement of 3 phase-to-neutral voltages (standard connection)

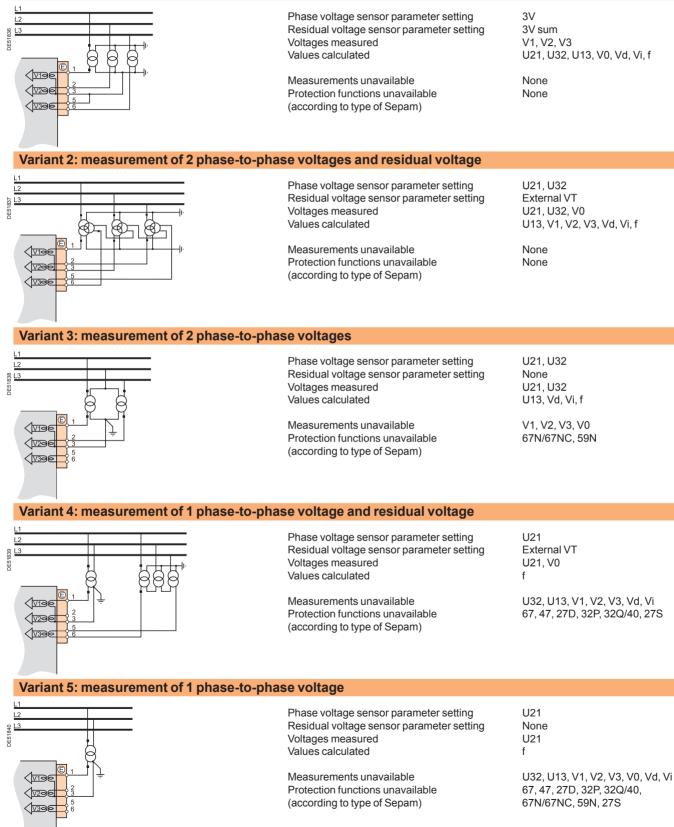

# Guiding

#### merlin-gerin.com

This international site allows you to access all the Merlin Gerin products in just 2 clicks via comprehensive range data-sheets, with direct links to: • complete library: technical documents, catalogs, FAQs, brochures... • selection guides from the e-catalog. • product discovery sites and their Flash

animations. You will also find illustrated overviews, news to which you can

news to which you can subscribe, the list of country contacts...

The second second	a methoday burner taxet baset taxet
	Fact into
9	"E statement and
The State of State	To announce of the second

#### Training

Training allows you to acquire the Merlin Gerin expertise (installation design, work with power on, etc.) for increased efficiency and a guarantee of improved customer service. The training catalogue includes beginner's courses in electrical distribution, knowledge of MV and LV switchgear, operation and maintenance of installations, design of LV installations to give but a few examples.



C

### Sepam series 20 Sepam series 40 Sepam series 80

### Sepam series 80

Introduction Sepam series 20 and Sepam series 40	7 47
Sepam series 80	86
Selection table	86
Functions	88
Sensor inputs	88
General settings	89
Metering and diagnosis	90
Description	90
Characteristics	95
Protection	<b>96</b> 96
Description Tripping curves	90 102
Main characteristics	104
Setting ranges	105
Control and monitoring	109
Description	109
Description of predefined functions	110
Adaptation of predefined functions using the SFT2841 software Customized functions using Logipam	114 116
	110
Characteristics	117
Characteristics Base unit	<b>117</b> 117
Base unit Presentation	
Base unit Presentation Description	<b>117</b> 117 121
Base unit Presentation Description Technical characteristics	<b>117</b> 117 121 123
Base unit Presentation Description	<b>117</b> 117 121
Base unit Presentation Description Technical characteristics	<b>117</b> 117 121 123
Base unit Presentation Description Technical characteristics Dimensions	<b>117</b> 117 121 123 125
Base unit Presentation Description Technical characteristics Dimensions Connection diagrams Sepam series 80 Base unit	<b>117</b> 117 121 123 125 <b>126</b>
Base unit Presentation Description Technical characteristics Dimensions Connection diagrams Sepam series 80 Base unit Connection	<b>117</b> 117 121 123 125 <b>126</b> 126 <b>127</b> 127
Base unit Presentation Description Technical characteristics Dimensions Connection diagrams Sepam series 80 Base unit Connection Sepam B83	<b>117</b> 117 121 123 125 <b>126</b> 126 <b>127</b> 127 128
Base unit Presentation Description Technical characteristics Dimensions Connection diagrams Sepam series 80 Base unit Connection Sepam B83 Sepam C86	<ul> <li>117</li> <li>117</li> <li>121</li> <li>123</li> <li>125</li> <li>126</li> <li>126</li> <li>127</li> <li>128</li> <li>129</li> </ul>
Base unit Presentation Description Technical characteristics Dimensions Connection diagrams Sepam series 80 Base unit Connection Sepam B83	<b>117</b> 117 121 123 125 <b>126</b> 126 <b>127</b> 127 128
Base unit         Presentation         Description         Technical characteristics         Dimensions         Connection diagrams         Sepam series 80         Base unit         Connection         Sepam B83         Sepam C86         Phase current inputs	<ul> <li>117</li> <li>117</li> <li>121</li> <li>123</li> <li>125</li> <li>126</li> <li>126</li> <li>127</li> <li>128</li> <li>129</li> <li>130</li> </ul>
Base unit         Presentation         Description         Technical characteristics         Dimensions         Connection diagrams         Sepam series 80         Base unit         Connection         Sepam B83         Sepam C86         Phase current inputs         Residual current inputs         Residual current inputs         Main channels	<ul> <li>117</li> <li>117</li> <li>121</li> <li>123</li> <li>125</li> <li>126</li> <li>126</li> <li>127</li> <li>128</li> <li>129</li> <li>130</li> <li>131</li> </ul>
Base unit         Presentation         Description         Technical characteristics         Dimensions         Connection diagrams         Sepam series 80         Base unit         Connection         Sepam B83         Sepam C86         Phase current inputs         Residual current inputs         Phase voltage inputs - Residual voltage input         Main channels         Additional channels for Sepam B83	<ul> <li>117</li> <li>117</li> <li>121</li> <li>123</li> <li>125</li> <li>126</li> <li>126</li> <li>127</li> <li>128</li> <li>129</li> <li>130</li> <li>131</li> <li>133</li> <li>134</li> </ul>
Base unit         Presentation         Description         Technical characteristics         Dimensions         Connection diagrams         Sepam series 80         Base unit         Connection         Sepam B83         Sepam C86         Phase current inputs         Residual current inputs         Residual current inputs         Additional channels for Sepam B83         Additional channel for Sepam B83	<ul> <li>117</li> <li>117</li> <li>121</li> <li>123</li> <li>125</li> <li>126</li> <li>126</li> <li>127</li> <li>128</li> <li>129</li> <li>130</li> <li>131</li> <li>133</li> <li>134</li> <li>135</li> </ul>
Base unit         Presentation         Description         Technical characteristics         Dimensions         Connection diagrams         Sepam series 80         Base unit         Connection         Sepam B83         Sepam C86         Phase current inputs         Residual current inputs         Phase voltage inputs - Residual voltage input         Main channels         Additional channels for Sepam B83	<ul> <li>117</li> <li>117</li> <li>121</li> <li>123</li> <li>125</li> <li>126</li> <li>126</li> <li>127</li> <li>128</li> <li>129</li> <li>130</li> <li>131</li> <li>133</li> <li>134</li> </ul>

### **Selection table**

		Subs	tatio	n		Tran	sform	er	Moto	r		Gene	rator		Busb	ar	Cap.
Protection	<b>ANSI</b> code	<b>S80</b>	<b>S81</b>	S82	<b>S84</b>	<b>T81</b>	<b>T82</b>	<b>T87</b>	<b>M81</b>	<b>M87</b>	<b>M88</b>	G82	G87	G88	<b>B80</b>	<b>B83</b>	C86
Phase overcurrent <sup>(1)</sup>	50/51	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8
Earth fault / Sensitive earth fault <sup>(1)</sup>		8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8
Breaker failure	50BF	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
Negative sequence / unbalance	46	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2
Thermal overload for cables	49RMS		2	2	2												
Thermal overload for machines <sup>(1)</sup>	49RMS					2	2	2	2	2	2	2	2	2			
Thermal overload for capacitors	49RMS																2
Capacitor bank unbalance	51C					-						-					8
Restricted earth fault	64REF					2	2	2				2		2			
Two-winding transformer differential	87T							1			1			1			
Machine differential	87M									1		_	1				
Directional phase overcurrent <sup>(1)</sup>	67			2	2		2	2				2	2	2			
Directional earth fault <sup>(1)</sup>	67N/67NC		2	2	2	2	2	2	2	2	2	2	2	2			
Directional active overpower	32P		2	2	2	2	2	2	2	2	2	2	2	2			
Directional reactive overpower	32Q								1	1	1	1	1	1			
Directional active underpower	37P				2	_						2					<u> </u>
Phase undercurrent	37								1	1	1						
Excessive starting time, locked rotor	48/51LR								1	1	1						
Starts per hour	66								1	1	1						
Field loss (underimpedance)	40								1	1	1	1	1	1			
Pole slip	78PS								1	1	1	1	1	1			
Overspeed (2 set points) <sup>(2)</sup>	12																
Underspeed (2 set points) <sup>(2)</sup>	14																
Voltage-restrained overcurrent	50V/51V											2	2	2			
Underimpedance	21B											1	1	1			
Inadvertent energization	50/27											1	1	1			
Third harmonic undervoltage / 100 % stator earth fault	27TN/64G2 64G											2	2	2			
Overfluxing (V / Hz)	24							2				2	2	2			
Positive sequence undercurrent	27D	2	2	2	4	2	2	2	2	2	2	2	2	2	4	4	4
Remanent undervoltage	27R	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2
Undervoltage (L-L or L-N)	27	4	4	4	2	4	4	4	4	4	4	4	4	4	2	2	2
Overvoltage (L-L or L-N)	59	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4
Neutral voltage displacement	59N	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2
Negative sequence overvoltage	47	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2
Overfrequency	81H	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2
Underfrequency	81L	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4
Rate of change of frequency	81R				2												
Recloser (4 cycles) <sup>(2)</sup>	79																
Thermostat / Buchholz <sup>(2)</sup>	26/63																
Temperature monitoring (16 RTDs) <sup>(3)</sup>	38/49T																
Synchro-check <sup>(4)</sup>	25																
<b>Control and monitori</b>	ng																
Circuit breaker / contactor control	-																
Automatic transfer (AT) <sup>(2)</sup>																	
Load shedding / automatic restart																	
De-excitation												•					
Genset shutdown												•	•				
Capacitor step control <sup>(2)</sup>																	
Logic discrimination <sup>(2)</sup>	68																
Latching / acknowledgement	86	•				×.,			•			×			•		×
Annunciation	30		-	_		<u>.</u>	_			_	-	<u>.</u>			-	_	
Switching of groups of settings			_	_	_	÷.,				_	_	<u>.</u>		-	-	_	<u>.</u>
Adaptation using logic equations			-	<b>–</b>	-		-	-			<b>_</b>				-	-	
Logipam programming (Ladder la	nguage)																

 Logipam programming (Ladder language)
 □
 □
 □
 □

 The figures indicate the number of relays available for each protection function.
 ■
 ■
 ■
 ■

 ■ standard, □ options.
 (1) Protection functions with 2 groups of settings.
 (2) According to parameter setting and optional MES120 input/output modules.
 (3) With optional MET148-2 temperature input modules.
 (4) With optional MCS025 synchro-check module.

86


### Sepam series 80

### **Selection table**

		tatio				sform		Moto				erator		Busk		C
Metering	<b>S80</b>	<b>S81</b>	<b>S82</b>	<b>S84</b>	<b>T81</b>	<b>T82</b>	<b>T87</b>	<b>M81</b>	M87	' M88	G82	G87	G88	<b>B80</b>	B83	С
hase current I1, I2, I3 RMS		•	•	•	•			•			•					P
Measured residual current I0, calculated I0Σ					B. 1						B. 1					Lâ
Demand current I1, I2, I3 Peak demand current IM1, IM2, IM3	÷.,				18 J	÷.		÷.,			18 J.	÷.	÷.	÷.	÷.	Li
	-	-	-	-	÷.,	-	-	-	-	-	÷.,	-	-	-		H
Aeasured residual current l'O											_					
/oltage U21, U32, U13, V1, V2, V3					Б÷.						Б÷.					Ľ
Residual voltage V0 Positive sequence voltage Vd / rotation direction					18 J						18 J			÷.,		Li
Vegative sequence voltage Vi		-	-	-	÷	-		-	-		1 i -	-	-			Li
Frequency																
Active power P, P1, P2, P3											•					
Reactive power Q, Q1, Q2, Q3																Ŀ
Apparent power S, S1, S2, S3		•	•	•	<b>.</b>			•	•	•					•	Ľ
Peak demand power PM, QM			•		•			•	•					•	•	P
Power factor								•			•					1
Calculated active and reactive energy (±Wh, ±VARh)			•		•			•	•					•	•	P
Active and reactive energy by pulse counting <sup>(2)</sup>																[
± Wh, ± VARh)																
Phase current I'1, I'2, I'3 RMS																
Calculated residual current I'02							-						•			
/oltage U'21, V'1 and frequency																
/oltage U'21, U'32, U'13, V'1, V'2, V'3, V'd, V'i and																
requency																
Residual voltage V'0																
Femperature (16 RTDs) <sup>(3)</sup>																0
Rotation speed <sup>(2)</sup>																
leutral point voltage Vnt											•					E
Network and machine diagnosis																
•																
ripping context					15 H						12 - I					Ľ
Tripping current TripI1, TripI2, TripI3	-	-	-	-	÷.,		_	-	-		÷.,	_		-		
Phase fault and earth fault trip counters	•	-	-	-				•		-						1
Inbalance ratio / negative sequence current li																1
Harmonic distortion (THD), current and voltage Ithd,	•	-			•				-		•				•	P
Jthd																
Phase displacement φ0, φ'0, φ0Σ	•	-			•				-		•					P
Phase displacement φ1, φ2, φ3																
Disturbance recording					•					-	•					P
Thermal capacity used					•						•					P
Remaining operating time before overload tripping											<b>.</b>					T
Naiting time after overload tripping					<b>.</b>						<b>.</b>					Ŀ
Running hours counter / operating time					<b>.</b>						<b>.</b>					P
Starting current and time																E
					-			-	-		-					-
Start inhibit time Number of starts before inhibition																
					-			-	-	-	-					-
Jnbalance ratio / negative sequence current l'i									-	-						-
Differential current Idiff1, Idiff2, Idiff3																
Through current It1, It2, It3 Current phase displacement θ												÷.				
· · ·					1.1		-		-	-	10.1	-	-			
Apparent positive sequence impedance Zd Apparent phase-to-phase impedances Z21, Z32, Z13					18 J			÷.,			18 J.	÷.	÷.	81	÷.	Lā
		-	-	-	-	-	_	-	-		÷.,	-	-	_	-	H
Fhird harmonic voltage, neutral point or residual	_													_	_	-
Difference in amplitude, frequency and phase of voltages compared for synchro-check <sup>(4)</sup>							Ц									
· · · · ·					-						-					
Capacitor unbalance current and capacitance																L,
Switchgear diagnosis ANSI co	de															
CT / VT supervision 60/60FL					•						•					P
rip circuit supervision <sup>(2)</sup> 74																0
Auxiliary power supply monitoring																
Cumulative breaking current	-	-	-	-	÷	-	-	-	-		÷	-	-	-	-	
						-	-									
Number of operations, operating time, charging time,	0					ш				L			Ц			Ľ
umber of racking out operations <sup>(2)</sup>	-	400	B	DO		0=0										
Modbus communication, IEC 60 8	(0-5	-103	, DN	P3 01	r CEI	850										
leasurement readout (4)																[
Remote indication and time tagging of events <sup>(4)</sup>																1
Remote control orders (4)																1
Remote protection setting <sup>(4)</sup>																[
Fransfer of disturbance recording data (4)																0
■ standard, □ options. (2) According to parameter setting and optional MES1 (3) With optional MET148-2 temperature input module. (4) With optional MCS025 synchro-check module. (5) With ACE949-2, ACE959, ACE937, ACE969TP, AC	es.				nunica	tion inte	erface.									

3

### **Sensor inputs**

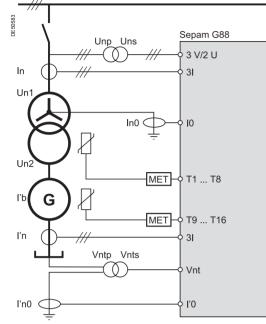

Sepam series 80 has analog inputs that are connected to the measurement sensors required for applications:

- main analog inputs, available on all types of Sepam series 80:
- □ 3 phase current inputs I1, I2, I3
- □ 1 residual current input I0
- □ 3 phase voltage inputs V1, V2, V3
- □ 1 residual voltage input V0
- additional analog inputs, dependent on the type of Sepam:
- □ 3 additional phase current inputs I'1, I'2, I'3
- □ 1 additional residual current input I'0
- □ 3 additional phase voltage inputs V'1, V'2, V'3
- □ 1 additional residual voltage input V'0

The table below lists the analog inputs available according to the type of Sepam series 80.

Sepam G88 sensor inputs.

		S80, S81, S82, S84	T81, T82, M81, G82	T87, M87, M88,	B80	B83	C86
Phase current inputs	Main channel	1,  2,  3	11, 12, 13	1,  2,  3	11, 12, 13	1,  2,  3	11, 12, 13
	Additional channels			l'1, l'2, l'3			
Residual current inputs	Main channel	10	10	10	10	10	10
	Additional channels	l'O	ľO	ľO	l'0		
Unbalance current inputs for capacitor steps							l'1, l'2, l'3, l'0
Phase voltage inputs	Main channel	V1, V2, V3 or U21, U32	V1, V2, V3 or U21, U32				
	Additional channels				V'1 or U'21	V'1, V'2, V'3 or U'21, U'32	
Residual voltage inputs	Main channel	V0	V0	V0	V0 <sup>(1)</sup>	V0	V0
	Additional channel					V'0	
Temperature inputs (on MET148-2 module)			T1 to T16	T1 to T16			T1 to T16

Note: by extension, an additional measurement (current or voltage) is a value measured via an additional analog channel.

(1) Available with phase voltage U21, U32.

### **General settings**

The general settings define the characteristics of the measurement sensors connected to Sepam and determine the performance of the metering and protection functions used. They are accessed via the SFT2841 setting software "General Characteristics", "CT-VT Sensors" and "Particular characteristics" tabs.

Gene	eral settings	Selection	Value
ln, l'n	Rated phase current	2 or 31A/5ACTs	1 A to 6250 A
	(sensor primary current)	3 LPCTs	25 A to 3150 A <sup>(1)</sup>
'n	Unbalance current sensor rating (capacitor application)	CT1A/2A/5A	1 A to 30 A
b	Base current, according to rated power of equipment		0.2 to 1.3 In
ľb	Base current on additional channels	Applications with transformer	l'b = lb x Un1/Un2
	(not adjustable)	Other applications	l'b = lb
ln0, l'n0	Rated residual current	Sum of 3 phase currents	See In(I'n) rated phase current
		CSH120 or CSH200 core balance CT	2 A or 20 A rating
		1 A/5 A CT + CSH30 interposing ring CT	1 A to 6250 A
		Core balance CT + ACE990 (the core balance CT ratio $1/n$ must be such that $50 \le n \le 1500$ )	According to current monitored and use of ACE990
Unp, U'np	Rated primary phase-to-phase voltage (Vnp: rated primary phase-to-neutral voltage Vnp = Unp/ $\sqrt{3}$ )		220 V to 250 kV
Uns,	Rated secondary phase-to-phase voltage	3 VTs: V1, V2, V3	90 to 230 V
U'ns		2 VTs: U21, U32	90 to 120 V
		1 VT: U21	90 to 120 V
		1 VT: V1	90 to 230 V
Uns0, U'nso	Secondary zero sequence voltage for primary zero sequence voltage Unp/ $\sqrt{3}$		Uns/3 or Uns/√3
Vntp	Neutral point voltage transformer primary voltage (generator application)		220 V to 250 kV
Vnts	Neutral point voltage transformer secondary voltage (generator application)		57.7 V to 133 V
fn	Rated frequency		50 Hz or 60 Hz
	Phase rotation direction		1-2-3 oru 1-3-2
	Integration period (for demand current and peak demand current and power)		5, 10, 15, 30, 60 min
	Pulse-type accumulated energy meter	Increments active energy	0.1 kWh to 5 MWh
		Increments reactive energy	0.1 kVARh to 5 MVARh
Р	Rated transformer power		100 kVA to 999 MVA
Un1	Rated winding 1 voltage (main channels: I)		220 V to 220 kV
Un2	Rated winding 2 voltage (additional channels: I')		220 V to 400 kV
In1	Rated winding 1 current (not adjustable)		$\ln 1 = P/(\sqrt{3} Un1)$
ln2	Rated winding 2 current (not adjustable)		$\ln 2 = P/(\sqrt{3} Un2)$
	Transformer vector shift		0 to 11
Ωn	Rated speed (motor, generator)		100 to 3600 rpm
२	Number of pulses per rotation (for speed acquisition)		1 to 1800 (Ωn x R/60 ≤ 1500)
	Zero speed set point		5 to 20 % of Ωn
	Number of capacitor steps		1 to 4
	Connection of capacitor steps		Star / Delta
	Capacitor step ratio	Step 1	1
		Step 2	1, 2
		Step 3	1, 2, 3, 4
		Step 4	1, 2, 3, 4, 6, 8

(1) In values for LPCT, in Amps: 25, 50, 100, 125, 133, 200, 250, 320, 400, 500, 630, 666, 1000, 1600, 2000, 3150.

### Metering and diagnosis Description

### Metering

Sepam is a precision metering unit.

All the metering and diagnosis data used for commissioning and required

for the operation and maintenance of your equipment are available locally

or remotely, expressed in the units concerned (A, V, W, etc.).

#### Phase current

RMS current for each phase, taking into account harmonics up to number 13. Different types of sensors may be used to meter phase

current:

- 1 A or 5 A current transformers
- LPCT type current sensors.

#### **Residual current**

Four types of residual current values are available depending on the type of Sepam and sensors connected to it:

• 2 residual currents  $IO\Sigma$  and  $I'O\Sigma$ , calculated by the vector sum of the 3 phase currents

■ 2 measured residual currents I0 and I'0.

Different types of sensors may be used to measure residual current:

- CSH120 or CSH200 specific core balance CT
- conventional 1 A or 5 A current transformer with

CSH30 interposing ring CT

■ any core balance CT with an ACE990 interface.

### Demand current and peak demand currents

Demand current and peak demand currents are calculated according to the 3 phase currents I1, I2 and I3:

demand current is calculated over an adjustable period of 5 to 60 minutes

 peak demand current is the greatest demand current and indicates the current drawn by peak loads.
 Peak demand currents may be cleared.

#### Voltage and frequency

The following measurements are available according to the voltage sensors connected:

- phase-to-neutral voltages V1, V2, V3 and V'1, V'2,
- V'3
- $\blacksquare\,$  phase-to-phase voltages U21, U32, U13 and U'21, U'32, U'13
- residual voltage V0, V'0 or neutral point voltage Vnt
- positive sequence voltage Vd, V'd and negative
- sequence voltage Vi, V'i
- frequency measured on the main and additional voltage channels.

#### Power

Powers are calculated according to the phase currents I1, I2 and I3:

- active power
- reactive power
- apparent power
- power factor (cos φ).

According to the sensors used, power calculations may be based on the 2 or 3 wattmeter method.

The 2 wattmeter method is only accurate when there is no residual current and it is not applicable if the neutral is distributed.

The 3 wattmeter method gives an accurate calculation of 3-phase and phase by phase powers in all cases, regardless of whether or not the neutral is distributed.

#### Peak demand powers

The greatest demand active and reactive power values calculated over the same period as the demand current. The peak demand powers may be cleared.

#### Energy

4 accumulated energies calculated according to voltages and phase currents I1, I2 and I3 measured: active energy and reactive energy in both directions

■ 1 to 4 additional accumulated energy meters for the acquisition of active or reactive energy pulses from external meters.

#### Temperature

Accurate measurement of temperature inside equipment fitted with Pt100, Ni100 or Ni120 type RTDs, connected to the optional remote MET148-2 module.

#### **Rotation speed**

Calculated by the counting of pulses transmitted by a proximity sensor at each passage of a cam driven by the rotation of the motor or generator shaft. Acquisition of pulses on a logic input.

#### Phasor diagram

A phasor diagram is displayed by SFT2841 software and the mimic-based UMI to check cabling and assist in the setting and commissioning of directional and differential protection functions.

According to the connected sensors, all current and voltage information can be selected for display in vector form.

### Metering and diagnosis Description

#### Network diagnosis assistance

Sepam provides network power quality metering functions, and all the data on network disturbances detected by Sepam are recorded for analysis purposes.

#### **Tripping context**

Storage of tripping currents and I0, Ii, U21, U32, U13, V1, V2, V3, V0, Vi, Vd, F, P, Q, Idiff, It and Vnt values when tripping occurs. The values for the last five trips are stored.

#### **Tripping current**

Storage of the 3 phase currents and earth fault current at the time of the last Sepam trip order, to indicate fault current.

The values are stored in the tripping contexts.

#### Number of trips

2 trip counters:

■ number of phase fault trips, incremented by each trip triggered by ANSI 50/51, 50V/51V and 67 protection functions

number of earth fault trips, incremented by each trip triggered by ANSI 50N/51 and 67N/67NC protection functions.

#### Negative sequence / unbalance

Negative sequence component of phase currents I1, I2 and I3 (and I'1, I'2 and I'3), indicating the degree of unbalance in the power supplied to the protected equipment.

#### **Total harmonic distortion**

Two THD values calculated to assess network power quality, taking into account harmonics up to number 13:

- current THD, calculated according to I1
- voltage THD, calculated according to V1 or U21.

#### Phase displacement

■ phase displacement  $\varphi$ 1,  $\varphi$ 2,  $\varphi$ 3 between phase currents I1, I2, I3 and voltages V1, V2, V3 respectively

phase displacement φ0 between residual current and residual voltage.

#### **Disturbance recording**

Recording triggered by user-set events:

- all sampled values of measured currents and voltages
- status of all logic inputs and outputs logic data: pick-up, ...

#### **Recording characteristics**

Number of recordings in COMTRADE format		
Total duration of a recording		
	12 or 36	
ccurrence of the event	Adjustable from 0 to 99 periods	
oability		
12 samples per period	36 samples per period	
50 Hz 22 s		
60 Hz 18 s		
	ccurrence of the event <b>pability</b> 12 samples per period 22 s	

#### Voltage comparison for synchro-check

For the synchro-check function, the MCS025 module continuously measures the amplitude, frequency and phase differences between the 2 voltages to be checked.

#### Out-of-sync context

Storage of amplitude, frequency and phase differences between the 2 voltages measured by the MCS025 module when a closing order is inhibited by the synchro-check function.

### Metering and diagnosis Description

#### Machine diagnosis assistance

Sepam assists facility managers by providing:

- data on the operation of their machines
- predictive data to optimize process management
- useful data to facilitate protection function setting and implementation.

#### Thermal capacity used

Equivalent temperature buildup in the machine, calculated by the thermal overload protection function.

Displayed as a percentage of rated thermal capacity.

#### Remaining operating time before overload tripping

Predictive data calculated by the thermal overload protection function. The time is used by facility managers to optimize process management in real time

- by deciding to:interrupt according to procedures
- continue operation with inhibition of thermal protection on overloaded machine.

#### Waiting time after overload tripping

Predictive data calculated by the thermal overload protection function. Waiting time to avoid further tripping of thermal overload protection by premature re-energizing of insufficiently cooled down equipment.

#### Running hours counter / operating time

Equipment is considered to be running whenever a phase current is over 0.1 lb. Cumulative operating time is given in hours.

#### Motor starting / overload current and time

A motor is considered to be starting or overloaded when a phase current is over 1.2 lb. For each start / overload, Sepam stores:

- maximum current drawn by the motor
- starting / overload time.

The values are stored until the following start / overload.

#### Number of starts before inhibition/start inhibit time

Indicates the number of starts still allowed by the starts per hour protection function and, if the number is zero, the waiting time before starting is allowed again.

#### **Differential and through current**

Values calculated to facilitate the implementation of ANSI 87T and 87M differential protection functions.

#### **Current phase displacement**

Phase shift between the main phase currents and additional phase currents to facilitate implementation of ANSI 87T differential protection function.

#### Apparent positive sequence impedance Zd

Value calculated to facilitate the implementation of the underimpedance field loss protection (ANSI 40).

#### Apparent phase-to-phase impedances Z21, Z32, Z13

Values calculated to facilitate the implementation of the backup underimpedance protection function (ANSI 21B).

#### Third harmonic neutral point or residual voltage

Values measured to facilitate the implementation of the third harmonic undervoltage / 100 % stator earth fault protection function (ANSI 27TN/64G2).

#### Capacitance

Measurement, for each phase, of the total capacitance of the connected capacitor bank steps. This measurement is used to monitor the condition of the capacitors.

#### Capacitor unbalance current

Measurement of the unbalance current for each capacitor bank step. This measurement is possible when the steps are connected in a double star arrangement.

### Metering and diagnosis Description

# Switchgear diagnosis assistance

Switchgear diagnosis data give facility managers information on:

- mechanical condition of breaking device
- Sepam auxiliaries

and assist them for preventive and curative switchgear maintenance actions.

The data are to be compared to switchgear manufacturer data.

#### ANSI 60/60FL - CT/VT supervision

Used to monitor the entire metering chain:

- CT and VT sensors
- connection

Sepam analog inputs.

Monitoring includes:

- consistency checking of currents and voltages measured
- acquisition of phase or residual voltage transformer protection fuse blown contacts.


In the event of a loss of current or voltage measurement data, the assigned protection functions may be inhibited to avoid nuisance tripping.


#### ANSI 74 - Trip/closing circuit supervision


To detect trip circuit and closing circuit failures, Sepam monitors:

- shunt trip coil connection
- closing coil connection
- matching of breaking device open/closed position contacts
- execution of breaking device open and close orders.

The trip and closing circuits are only supervised when connected as shown below.







Connection for shunt trip coil monitoring.

Connection for undervoltage trip coil monitoring.

Connection for closing circuit supervision

#### Auxiliary power supply monitoring

The voltage rating of Sepam's auxiliary supply should be set between 24 V DC and 250 V DC.

If the auxiliary supply drifts, 2 alarms may be triggered:

high set point alarm, adjustable from 105 % to 150 % of rated supply (maximum 275 V)

■ low set point alarm, adjustable from 60 % to 95 % of rated supply (minimum 20 V).

#### Cumulative breaking current monitoring

Six cumulative currents are proposed to assess breaking device pole condition:

- total cumulative breaking current
- cumulative breaking current between 0 and 2 In
- cumulative breaking current between 2 In and 5 In
- cumulative breaking current between 5 In and 10 In
- cumulative breaking current between 10 In and 40 In
- cumulative breaking current > 40 In.

Each time the breaking device opens, the breaking current is added to the cumulative total and to the appropriate range of cumulative breaking current.

Cumulative breaking current is given in (kA)<sup>2</sup>.

An alarm can be generated when the total cumulative breaking current exceeds a set point.

#### Number of operations

Cumulative number of opening operations performed by the breaking device.

#### Circuit breaker operating time and charging time Number of rackouts

Used to assess the condition of the breaking device operating mechanism.

### Metering and diagnosis Description

### Sepam self-diagnosis

Sepam includes a number of self-tests carried out in the base unit and optional modules. The purpose of the self-tests is to:

- detect internal failures that may cause nuisance tripping or failed fault tripping
- put Sepam in fail-safe position to avoid any unwanted operation
- alert the facility manager of the need for maintenance operations.

#### Internal failure

Two categories of internal failures are monitored:

major failures: Sepam shutdown (to fail-safe position).

The protection functions are inhibited, the output relays are forced to drop out and the "Watchdog" output indicates Sepam shutdown

minor failures: downgraded Sepam operation.

Sepam's main functions are operational and equipment protection is ensured.

#### **Battery monitoring**

Monitoring of battery voltage to guarantee data is saved in the event of an outage. A battery fault generates an alarm.

#### Detection of plugged connectors

The system checks that the current or voltage sensors are plugged in. A missing connector is a major failure.

#### **Configuration checking**

The system checks that the optional modules configured are present and working correctly.

The absence or failure of a remote module is a minor failure, the absence or failure of a logic input/output module is a major failure.

### **Metering and diagnosis** Characteristics

Functions		Measurement range	Accuracy <sup>(1)</sup>	<b>MSA141</b>	Savino
Metering			,		
Phase current		0.02 to 40 In	±0.5 %	1_	
Residual current	Calculated	0.005 to 40 In	±1%		
	Measured	0.005 to 20 In0	±1%		
Demand current	meddured	0.02 to 40 ln	±0.5 %		
Peak demand current		0.02 to 40 ln	±0.5 %	_	_
Phase-to-phase voltage	Main channels (U)	0.05 to 1.2 Unp	±0.5 %	_	
Filase-to-pilase voltage		i	±0.5 %		
	Additional channels (U')	0.05 to 1.2 Unp		_	
Phase-to-neutral voltage	Main channels (V)	0.05 to 1.2 Vnp	±0.5 %		
	Additional channels (V')	0.05 to 1.2 Vnp	±1%		
Residual voltage		0.015 to 3 Vnp	±1%	_	
Neutral point voltage		0.015 to 3 Vntp	±1%		
Positive sequence voltage		0.05 to 1.2 Vnp	±2 %		
Negative sequence voltage		0.05 to 1.2 Vnp	±2%		
Frequency	Main channels (f)	25 to 65 Hz	±0.01 Hz		
	Additional channels (f')	45 to 55 Hz (fn = 50 Hz)	±0.05 Hz		
		55 to 65 Hz (fn = 60 Hz)			
Active power (total or per phas	/	0.008 Sn to 999 MW	±1%		
Reactive power (total or per pl	hase)	0.008 Sn to 999 MVAR	±1 %		
Apparent power (total or per p	hase)	0.008 Sn to 999 MVA	±1 %		
Peak demand active power		0.008 Sn to 999 MW	±1 %		
Peak demand reactive power		0.008 Sn to 999 MVAR	±1 %		
Power factor		-1 to + 1 (CAP/IND)	±0.01		
Calculated active energy		0 to 2.1 x 108 MWh	±1 % ±1 digit		
Calculated reactive energy		0 to 2.1 x 10 <sup>8</sup> MVARh	±1 % ±1 digit		
Temperature		-30 °C to +200 °C	±1 °C from +20 to +140 °C		
ionipolataro		or -22 °F to +392 °F	±1,8 °F from +68 to +384 °F	-	
Rotation speed		0 to 7200 rpm	±1 rpm		
Network diagnosis ass	istance			1	
Tripping context					
Tripping current		0.02 to 40 In	±5 %	-	
Number of trips		0 to 65535	-		
Negative sequence / unbalan	20	1 to 500 % of lb	±2 %	_	
Total harmonic distortion, curr		0 to 100 %	±2 %	-	
,					
Total harmonic distortion, volta	•	0 to 100 %	±1%	_	
Phase displacement φ0 (betw		0 to 359°	±2°		
Phase displacement φ1, φ2, φ	φ3 (between V and I)	0 to 359°	±2°		
Disturbance recording					
Amplitude difference		0 to 1.2 Usync1	±1%		
Frequency difference		0 to 10 Hz	±0.5 Hz		
Phase difference		0 to 359°	±2°		
Out-of-sync context					
Machine operating ass	istance				
Thermal capacity used		0 to 800 %	±1 %	•	
		(100 % for phase I = Ib)			
Remaining operating time bef	ore overload tripping	0 to 999 min	±1 min		
Waiting time after overload trip	oping	0 to 999 min	±1 min		
Running hours counter / opera	ating time	0 to 65535 hours	±1 % or ±0.5 h		
Starting current		1.2 lb to 40 ln	±5 %		
Starting time		0 to 300 s	±300 ms		
Number of starts before inhibi	tion	0 to 60			
Start inhibit time		0 to 360 min	±1 min	-	
Differential current		0.015 to 40 ln	±1%		
Through current		0.015 to 40 ln	±1%	-	
~				_	
Phase displacement 01, 02, 0	· /	0 to 359°	±2°		
Apparent impedance Zd, Z21,		0 to 200 kΩ	±5 %	_	
Third harmonic neutral point v		0.2 to 30 % of Vnp	±1 %	_	
Third harmonic residual voltag	je	0.2 to 90 % of Vnp	±1%	_	
Capacitance		0 to 30 F	±5 %		
Capacitor unbalance current		0.02 to 40 l'n	±5 %		
Switchgear diagnosis a	Issistance				
Cumulative breaking current		0 to 65535 kA <sup>2</sup>	±10 %		
Auxiliary supply		24 V DC to 250 V DC	±4 V or ±10 %		
		0 to 4 x 10 <sup>9</sup>	-		
			1		
Number of operations			+1 ms		
		20 to 100 s 1 to 20 s	±1 ms ±0.5 s		

■ available on MSA141 analog output module, according to setup
 □ saved in the event of auxiliary supply outage, even without battery
 □ saved by battery in the event of auxiliary supply outage.
 (1) Under reference conditions (IEC 60255-6), typical accuracy at ln or Unp, cosφ > 0.8.

### **Current protection functions**

#### ANSI 50/51 - Phase overcurrent

Phase-to-phase short-circuit protection.

2 modes: • overcurrent protection sensitive to the highest phase current measured

machine differential protection sensitive to the

highest differential phase currents obtained in selfbalancing schemes.

#### Characteristics

- 2 groups of settings
- instantaneous or time-delayed tripping
- definite time (DT), IDMT (choice of 16 standardized IDMT curves) or customized curve
- with or without timer hold

tripping confirmed or unconfirmed, according to parameter setting:

□ unconfirmed tripping: standard

□ tripping confirmed by negative sequence overvoltage protection (ANSI 47, unit 1), as backup for distant 2-phase short-circuits

□ tripping confirmed by undervoltage protection (ANSI 27, unit 1), as backup for phase-to-phase shortcircuits in networks with low short-circuit power.

#### ANSI 50N/51N or 50G/51G - Earth fault

Earth fault protection based on measured or calculated residual current values:

- ANSI 50N/51N: residual current calculated or
- measured by 3 phase current sensors

■ ANSI 50G/51G: residual current measured directly by a specific sensor.

#### Characteristics

- 2 groups of settings
- definite time (DT), IDMT (choice of 17 standardized
- IDMT curves) or customized curve
- with or without timer hold

second harmonic restraint to ensure stability during transformer energizing, activated by parameter setting.

#### ANSI 50BF - Breaker failure

If a breaker fails to be triggered by a tripping order, as detected by the non-extinction of the fault current, this backup protection sends a tripping order to the upstream or adjacent breakers.

#### ANSI 46 - Negative sequence / unbalance

Protection against phase unbalance, detected by the measurement of negative sequence current.

- sensitive protection to detect 2-phase faults at the ends of long lines
- protection of equipment against temperature buildup, caused by an unbalanced power supply, phase inversion or loss of phase, and against phase current unbalance.

#### Characteristi cs

■ 1 definite time (DT) curve

■ 9 IDMT curves: 4 IÉC curves and 3 IEEE curves, 1 ANSI curve in RI<sup>2</sup> and 1 specific Schneider curve

#### **ANSI 49RMS - Thermal overload**

- Protection against thermal damage caused by overloads on
- machines (transformers, motors or generators)
- cables
- capacitors

The thermal capacity used is calculated according to a mathematical model which takes into account:

- current RMS values
- ambient temperature
- negative sequence current, a cause of motor rotor temperature rise.

The thermal capacity used calculations may be used to calculate predictive data for process control assistance.

The protection may be inhibited by a logic input when required by process control conditions.

#### Thermal overload for machines - Characteristics

- 2 groups of settings
- 1 adjustable alarm set point
- 1 adjustable tripping set point
- adjustable initial thermal capacity used setting, to adapt protection characteristics to fit manufacturer's thermal withstand curves
- equipment heating and cooling time constants.

The cooling time constant may be calculated automatically based on measurement of the equipment temperature by a sensor.

#### Thermal overload for cables - Characteristics

- 1 group of settings
- cable current carrying capacity, which determines alarm and trip set points
- cable heating and cooling time constants.

#### Thermal overload for capacitors - Characteristics

- 1 group of settings
- alarm current, which determines the alarm set point
- overload current, which determines the tripping set point
- hot tripping time and current setting, which determine a point on the tripping curve.

#### ANSI 51C - Capacitor bank unbalance

Detection of capacitor step internal faults by measuring the unbalance current flowing between the two neutral points of a step connected in a double star arrangement. Four unbalance currents can be measured to protect up to 4 steps.

#### Characteristics

- 2 set points per step
- definite time (DT) curve.

### Recloser

#### **ANSI 79**

Automation device used to limit down time after tripping due to transient or semi-permanent faults on overhead lines. The recloser orders automatic reclosing of the breaking device after the time delay required to restore the insulation has elapsed.

Recloser operation is easy to adapt for different operating modes by parameter setting.

#### Characteristics

1 to 4 reclosing cycles, each cycle has an adjustable dead time

■ adjustable, independent reclaim time and safety time until recloser ready time delays

■ cycle activation linked to instantaneous or timedelayed short-circuit protection function (ANSI 50/51,

50N/51N, 67, 67N/67NC) outputs by parameter setting ■ inhibition/locking out of recloser by logic input.

### Synchro-check

#### **ANSI 25**

This function checks the voltages upstream and downstream of a circuit breaker and allows closing when the differences in amplitude, frequency and phase are within authorized limits.

#### Characteristics

adjustable and independent set points for differences in voltage, frequency and phase


■ adjustable lead time to take into account the circuitbreaker closing time

■ 5 possible operating modes to take no-voltage conditions into account.

### **Differential protection functions**

#### ANSI 64REF - Restricted earth fault differential

Detection of phase-to-earth faults on 3-phase windings with earthed neutral, by comparison of residual current calculated from the 3 phase currents and residual current measured at the neutral point.



#### Characteristics

instantaneous tripping

- e percentage-based characteristic with fixed slope and adjustable low set point
- more sensitive than transformer or machine differential protection.

### ANSI 87T - Transformer and transformer-machine unit differential (2 windings)

Phase-to-phase short-circuit protection of two-winding transformers or transformermachine units.

Protection based on phase by phase comparison of the primary and secondary currents with:

amplitude and phase correction of the currents in each winding according to the transformer vector shift and the voltage values set

clearance of zero sequence current from the primary and secondary windings (suitable for all earthing systems).

#### Characteristics

instantaneous tripping

adjustable high set point for fast tripping for violent faults, with no restraint

percentage-based characteristic with two adjustable slopes and adjustable low set point

■ restraint based on percentage of harmonics. These restraints prevent nuisance tripping during transformer energizing, during faults outside the zone that provoke saturation of the current transformers and during operation of a transformer supplied with excessive voltage (overfluxing).

□ self-adapting neural network restraint: this restraint analyzes the percentage of harmonics 2 and 5 as well as differential and through currents

□ restraint based on the percentage of harmonic 2 per phase or total

□ restraint based on the percentage of harmonic 5 per phase or total. Self-adapting restraint is exclusive with respect to restraints on the percentage of harmonic 2 or on the percentage of harmonic 5.

■ restraint on energization. This restraint, based on the magnetizing current of the transformer or on a logic equation or Logipam, ensures stability of transformers that have low harmonic percentages on energization


#### fast restraint upon loss of sensor.

#### ANSI 87M - Machine differential


Phase-to-phase short-circuit protection, based on phase by phase comparison of the currents on motor and generator windings.

#### Characteristics


- instantaneous tripping
- fixed high set point for fast tripping for violent faults, with no restraint
- percentage-based characteristic with fixed slope and adjustable low set point
- tripping restraint according to percentage characteristic activated by detection of:
- □ external fault or machine starting
- sensor saturation or disconnection
- □ transformer energizing (harmonic 2 restraint)



Tripping characteristic of ANSI 67N/67NC type 1 protection (characteristic angle q0 ¼ 0°).



Tripping characteristic of ANSI 67N/67NC type 2 protection (characteristic angle q0 1/4 0°)



Tripping characteristic of ANSI 67N/67NC type 3 protection.

### **Directional current protection**

#### **ANSI 67 - Directional phase overcurrent**

Phase-to-phase short-circuit protection, with selective tripping according to fault current direction

It comprises a phase overcurrent function associated with direction detection, and picks up if the phase overcurrent function in the chosen direction (line or busbar) is activated for at least one of the 3 phases.

#### **Characteristics**

- 2 groups of settings
- instantaneous or time-delayed tripping
- choice of tripping direction
- definite time (DT), IDMT (choice of 16 standardized IDMT curves) or customized curve

with voltage memory to make the protection insensitive to loss of polarization voltage at the time of the fault

with or without timer hold

#### ANSI 67N/67NC - Directional earth fault

Earth fault protection, with selective tripping according to fault current direction.

- 2 types of operation:
- type 1, projection
- type 2, according to the magnitude of the residual current phasor.

#### ANSI 67N/67NC type 1

Directional earth fault protection for impedant, isolated or compensated neutral systems, based on the projection of measured residual current.

#### **Type 1 characteristics**

b 2 groups of settings

- instantaneous or time-delayed tripping
- definite time (DT) curve
- choice of tripping direction
- characteristic projection angle
- no timer hold

■ with voltage memory to make the protection insensitive to recurrent faults in compensated neutral systems.

#### ANSI 67N/67NC type 2

Directional overcurrent protection for impedance and solidly earthed systems, based on measured or calculated residual current.

It comprises an earth fault function associated with direction detection, and picks up if the earth fault function in the chosen direction (line or busbar) is activated.

- **Type 2 characteristics**
- 2 groups of settings
- instantaneous or time-delayed tripping

definite time (DT), IDMT (choice of 16 standardized IDMT curves) or customized curve

- choice of tripping direction with or without timer hold

#### ANSI 67N/67NC type 3

Directional overcurrent protection for distribution networks in which the neutral earthing system varies according to the operating mode, based on measured residual current.

It comprises an earth fault function associated with direction detection (angular sector tripping zone defined by 2 adjustable angles), and picks up if the earth fault function in the chosen direction (line or busbar) is activated. This protectionfunction complies with the Enel DK5600 specification.

#### **Type 3 characteristics**

- 2 groups of settings
- instantaneous or time-delayed tripping
- definite time (DT) curve
- choice of tripping direction
- no timer hold

# Directional power protection Machine protection functions functions

#### **ANSI 32P - Directional active overpower**

Two-way protection based on calculated active power, for the following applications:

 active overpower protection to detect overloads and allow load shedding

reverse active power protection:

□ against generators running like motors when the generators consume active power

against motors running like generators when the motors supply active power.

#### ANSI 32Q - Directional reactive overpower

Two-way protection based on calculated reactive power to detect field loss on synchronous machines:

reactive overpower protection for motors which

consume more reactive power with field loss

■ reverse reactive overpower protection for generators which consume reactive power with field loss.

#### ANSI 37P - Directional active underpower

Two-way protection based on calculated active power Checking of active power flows:

■ to adapt the number of parallel sources to fit the network load power demand

• to create an isolated system in an installation with its own generating unit.

#### ANSI 37 - Phase undercurrent

Protection of pumps against the consequences of a loss of priming by the detection of motor no-load operation.

It is sensitive to a minimum of current in phase 1, remains stable during breaker tripping and may be inhibited by a logic input.

#### ANSI 48/51LR - Locked rotor / excessive starting time

Protection of motors against overheating caused by:

■ excessive motor starting time due to overloads (e.g. conveyor) or insufficient supply voltage.

The reacceleration of a motor that is not shut down, indicated by a logic input, may be considered as starting.

locked rotor due to motor load (e.g. crusher):

□ in normal operation, after a normal start

□ directly upon starting, before the detection of excessive starting time, with detection of locked rotor by a zero speed detector connected to a logic input, or by the underspeed function.

#### ANSI 66 - Starts per hour

Protection against motor overheating caused by:

■ too frequent starts: motor energizing is inhibited when the maximum allowable number of starts is reached, after counting of:

□ starts per hour (or adjustable period)

□ consecutive motor hot or cold starts (reacceleration of a motor that is not shut down, indicated by a logic input, may be counted as a start)


■ starts too close together in time: motor re-energizing after a shutdown is only allowed after an adjustable waiting time.

#### ANSI 40 - Field loss (underimpedance)

Protection of synchronous machines against field loss, based on the calculation of positive sequence impedance on the machine terminals or transformer terminals in the case of transformer-machine units.

#### Characteristics

2 circular characteristics defined by reactances Xa, Xb and Xc



2 circular tripping characteristics of ANSI 40 protection.

■ tripping when the machine's positive sequence impedance enters one of the circular characteristics.

■ definite (DT) time delay for each circular characteristic

setting assistance function included in SFT2841 software to calculate the values of Xa, Xb and Xc according to the electrical characteristics of the machine (and transformer, when applicable).

Characteristics

E51844

#### ANSI 78PS - Pole slip

Protection against loss of synchronism on synchronous machines, based on calculated active power. 2 types of operation:

 tripping according to the equal-area criterion, time-delayed

tripping according to power swing (number of active power swings):

□ suitable for generators capable of withstanding high electrical and mechanical constraints

 $\square$  to be set as a number of rotations.

The 2 types of operation may be used independently or at the same time.

#### ANSI 12 - Overspeed

Detection of machine overspeed, based on the speed calculated by pulse-counting, to detect synchronous generator racing due to loss of synchronism, or for process monitoring, for example.

#### ANSI 14 - Underspeed

Machine speed monitoring based on the speed calculated by pulse-counting:

detection of machine underspeed after starting, for process monitoring, for example

 zero speed data for detection of locked rotor upon starting.

#### ANSI 50V/51V - Voltage-restrained overcurrent

Phase-to-phase short-circuit protection, for generators. The current tripping set point is voltage-adjusted in order to be sensitive to faults close to the generator which cause voltage drops and lowers the short-circuit current.

#### Characteristics


- instantaneous or time-delayed tripping
- definite time (DT), IDMT (choice of 16 standardized
- IDMT curves) or customized curve
- with or without timer hold.

#### **ANSI 21B - Underimpedance**

Phase-to-phase short-circuit protection, for generators, based on the calculation of apparent phase-to-phase impedance.

 $Z21 = \frac{U21}{I2 - I1}$ 

apparent impedance between phases 1 and 2.

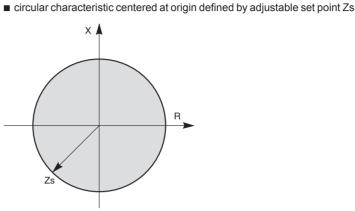

Circular tripping characteristic of ANSI 21B protection.

■ time-delayed definite time (DT) tripping when one of the three apparent impedances enters the circular tripping characteristic.

#### ANSI 50/27 - Inadvertent energization

Checking of generator starting sequence to detect inadvertent energization of generators that are shut down (a generator which is energized when shut down runs like a motor).

Consists of an instantaneous phase overcurrent protection confirmed by a timedelayed undervoltage protection function.


#### ANSI 64G - 100 % stator earth fault

Protection of generators with earthed neutral against phase-to-earth insulation faults in stator windings. This function may be used to protect generators connected to step-up transformers

100 % stator earth fault is a combination of two protection functions:

■ ANSI 59N/64G1: neutral voltage displacement, protection of 85 % to 90 % of the stator winding, terminal end.

■ ANSI 27TN/64G2: thrid harmonic undervoltage, protection of 10 % to 20 % of the stator winding, neutral point end.



Stator winding of a generator protected 100 % by the combination of ANSI 59N and ANSI 27TN protection functions.

#### ANSI 27TN/64G2 - Third harmonic undervoltage

Protection of generators with earthed neutral against phase-to-earth insulation faults, by the detection of a reduction of third harmonic residual voltage.

Protects the 10 to 20 % of the stator winding, neutral point end, not protected by the ANSI 59N/64G1 function, neutral voltage displacement.

#### Characteristics

- choice of 2 tripping principles, according to the sensors used:
- □ fixed third harmonic undervoltage set point
- adaptive neutral and terminal third harmonic voltage comparator set point
- time-delayed definite time (DT) tripping.

#### ANSI 26/63 - Thermostat/Buchholz

Protection of transformers against temperature rise and internal faults via logic inputs linked to devices integrated in the transformer.

#### ANSI 38/49T - Temperature monitoring

Protection that detects abnormal temperature build-up by measuring the temperature inside equipment fitted with sensors:

- transformer: protection of primary and secondary windings
- motor and generator: protection of stator windings and bearings.

#### Characteristics

- 16 Pt100, NI100 or Ni120 type RTDs
- 2 adjustable independent set points for each RTD (alarm and trip).

### Voltage protection functions

#### ANSI 24 - Overfluxing (V/Hz)

Protection which detects overfluxing of transformer or generator magnetic circuits by calculating the ratio between the greatest phase-to-neutral or phase-tophase voltage divided by the frequency.

#### Characteristics

machine coupling to be set up

■ definite time (DT) or IDMT time delays (choice of 3 curves)

#### **ANSI 27D - Positive sequence** undervoltage

Protection of motors against faulty operation due to insufficient or unbalanced network voltage, and detection of reverse rotation direction.

#### ANSI 27R - Remanent undervoltage

Protection used to check that remanent voltage sustained by rotating machines has been cleared before allowing the busbar supplying the machines to be re-energized, to avoid electrical and mechanical transients.

#### ANSI 27 - Undervoltage

Protection of motors against voltage sags or detection of abnormally low network voltage to trigger automatic load shedding or source transfer.

Works with phase-to-phase or phase-to-neutral voltage, each voltage being monitored separately.

#### Characteristics

- definite time (DT) curve
- IDMT curve.

#### ANSI 59 - Overvoltage

Detection of abnormally high network voltage or checking for sufficient voltage to enable source transfer

Works with phase-to-phase or phase-to-neutral voltage, each voltage being monitored separately.

#### **ANSI 59N - Neutral voltage displacement**

Detection of insulation faults by measuring residual voltage

ANSI 59N: in isolated neutral systems

ANSI 59N/64G1: in stator windings of generators with earthed neutral. Protects the 85 % to 90 % of the winding, terminal end, not protected by the ANSI 27TN/64G2 function, third harmonic undervoltage.

#### Characteristics

- definite time (DT) curve
- IDMT curve.

#### ANSI 47 - Negative sequence overvoltage

Protection against phase unbalance resulting from phase inversion, unbalanced supply or distant fault, detected by the measurement of negative sequence voltage.

### Frequency protection functions

#### ANSI 81H - Overfrequency

Detection of abnormally high frequency compared to the rated frequency, to monitor power supply quality.

#### ANSI 81L - Underfrequency

Detection of abnormally low frequency compared to the rated frequency, to monitor power supply quality.

The protection may be used for overall tripping or load shedding. Protection stability is ensured in the event of the loss of the main source and presence of remanent voltage by a restraint in the event of a continuous decrease of the frequency, which is activated by parameter setting.

#### ANSI 81R - Rate of change of frequency

Protection function used for fast disconnection of a generator or load shedding control. Based on the calculation of the frequency variation, it is insensitive to transient voltage disturbances and therefore more stable than a phase-shift protection function.

#### Disconnection

In installations with autonomous production means connected to a utility, the "rate of change of frequency" protection function is used to detect loss of the main system in view of opening the incoming circuit breaker to:

protect the generators from a reconnection without checking synchronization avoid supplying loads outside the installation.


#### Load shedding

The "rate of change of frequency" protection function is used for load shedding in combination with the underfrequency protection to:

either accelerate shedding in the event of a large overload

or inhibit shedding following a sudden drop in frequency due to a problem that should not be solved by shedding.

### **Protection Tripping curves**



**Customized tripping curve** Defined point by point using the SFT2841 setting and operating software tool, this curve may be used to solve all special cases involving protection coordination or revamping.

### **IDMT** tripping curves

#### **Current IDM T tripping curves**

Multiple IDMT tripping curves are offered, to cover most applications:

- IEC curves (SIT, VIT/LTI, EIT)
- IEEE curves (MI, VI, EI)
- usual curves (UIT, RI, IAC).

Customized tripping curve set using SFT2841 software.

$$t d(I) = \frac{k}{\left(\frac{I}{Is}\right)^{\alpha} - 1} \times \frac{T}{\beta}$$

Equation

#### **IEC curves**

Curve type	Coefficient values			
	k	α	β	
Standard inverse / A	0.14	0.02	2.97	
Very inverse / B	13.5	1	1.50	
Long time inverse / B	120	1	13.33	
Extremely inverse / C	80	2	0.808	
Ultra inverse	315.2	2.5	1	

#### **RI** curve

Equation:

$$td(I) = \frac{1}{0,339 - 0,236 \left(\frac{I}{Is}\right)^{-1}} \times \frac{T}{3,1706}$$

### Equation

$$td(l) = \left( \frac{A}{\left( \frac{l}{ls} \right)^p - 1} + B \right) \times \frac{T}{\beta}$$

Equation

$$td(I) = \left(A + \frac{B}{\left(\frac{I}{I_{S}} - C\right)} + \frac{D}{\left(\frac{I}{I_{S}} - C\right)^{2}} + \frac{E}{\left(\frac{I}{I_{S}} - C\right)^{3}}\right) x \frac{T}{\beta}$$


#### **IEEE curves**

Curve type	Coefficient values					
	Α	В	р	β		
Moderately inverse	0.010	0.023	0.02	0.241		
Very inverse	3.922	0.098	2	0.138		
Extremely inverse	5.64	0.0243	2	0.081		

#### **IEEE curves**

Curve type	Coeffic	Coefficient values							
	Α	в	С	D	Е	β			
Inverse	0.208	0.863	0.800	-0.418	0.195	0.297			
Very inverse	0.090	0.795	0.100	-1.288	7.958	0.165			
Extremely inverse	0.004	0.638	0.620	1.787	0.246	0.092			

### **Protection** Tripping curves

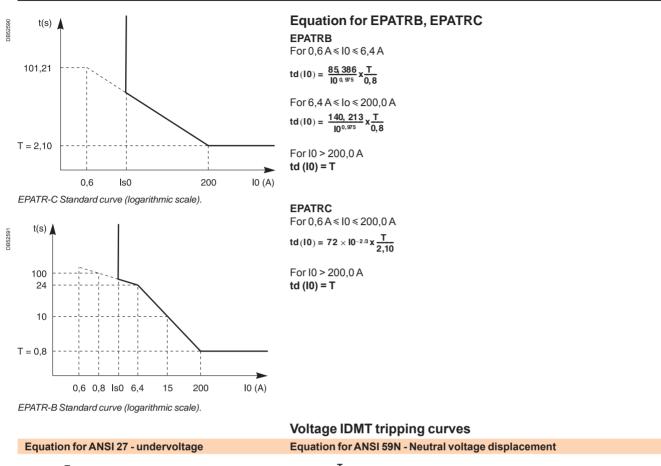

 $td(I) = \frac{T}{1 - \left(\frac{V}{Vs}\right)}$ 

Equation for ANSI 27 - undervoltage
With $G = V/f$ or $U/f$

$$td(G) = \frac{1}{\left(\frac{G}{Gs} - 1\right)^p} x T$$

## $td(I) = \frac{T}{\left(\frac{V}{Vs}\right) - 1}$

### Voltage/frequency ratio IDMT tripping curves


Voltage/Incque	
Curve type	P
Α	0.5
В	1
С	2

### **Protection** Main characteristics


### Setting of IDMT tripping curves,

time delay T or TMS factor The time delays of current IDMT tripping curves (except for customized and RI

- curves) may be set as follows:
- time T, operating time at 10 x ls
- TMS factor, factor shown as T/b in the equations on the left.



Detection of restriking faults with adjustable timer hold.



#### **Timer hold**

The adjustable timer hold T1 is used for:

- detection of restriking faults (DT curve)
- coordination with electromechanical relays (IDMT curve).

Timer hold may be inhibited if necessary.

#### 2 groups of settings

#### Phase-to-phase and phase-to-earth short-circuit protection

Each unit has 2 groups of settings, A and B, to adapt the settings to suit the network configuration.

The active group of settings (A or B) is set by a logic input or the communication link. **Example of use: normal / backup mode network** 

group A for network protection in normal mode, when the network is supplied by the utility

■ group B for network protection in backup mode, when the network is supplied by a backup generator.

#### Thermal overload for machines

Each unit has 2 groups of settings to protect equipment that has two operating modes.

#### Examples of use:

■ transformers: switching of groups of settings by logic input, according to transformer ventilation operating mode, natural or forced ventilation (ONAN or ONAF)

motors: switching of groups of settings according to current set point, to take into account the thermal withstand of motors with locked rotors.

#### **Measurement origin**

The measurement origin needs to be indicated for each unit of the protection functions that may use measurements of different origins.

The setting links a measurement to a protection unit and allows the protection units to be distributed optimally among the measurements available according to the sensors connected to the analog inputs.

**Example:** distribution of ANSI 50N/51N function units for transformer earth fault protection:

- 2 units linked to measured I0 for transformer primary protection
- 2 units linked to measured I'0 for transformer secondary protection
- 2 units linked to IOS for protection upstream of the transformer
- 2 units linked to I'0S for protection downstream of the transformer.

#### Summary table

Characteristics	Protection functions
2 groups of settings A et B	50/51, 50N/51N, 67, 67N/67NC
2 groups of settings, operating modes 1 and 2	49RMS Machine
IEC IDMT curves	50/51, 50N/51N, 50V/51V, 67,
	67N/67NC type 2, 46
IEEE IDMT curves	50/51, 50N/51N, 50V/51V, 67,
	67N/67NC type 2, 46
Usual IDMT curves	50/51, 50N/51N, 50V/51V, 67,
	67N/67NC type 2
EPATR curves	50N/51N
Voltage IDMT curves	27, 59N, 24
Customized curve	50/51, 50N/51N, 50V/51V, 67, 67N/67NC type 2
Timer hold	50/51, 50N/51N, 50V/51V, 67,
	67N/67NC type 2

### **Protection** Setting ranges

Functions	Settings		Time delays
ANSI 12 - Overspeed			
	100 to 160 % of Wn		1 to 300 s
ANSI 14 - Underspeed			
	10 to 100 % of Wn		1 to 300 s
ANSI 21B - Underimpedance			
mpedance Zs	0.05 to 2.00 Vn/lb		
ANSI 24 - Overfluxing (V/Hz)			
Tripping curve	Definite time		
	IDMT type A, B or C		
Gs set point	1.03 to 2 pu	Definite time	0.1 to 20000 s
		IDMT	0.1 to 1250 s
ANSI 25 - Synchro-check			
leasured voltages	Phase-to-phase	Phase-to-neutral	
Rated primary phase-to-phase voltage	)		
Jnp sync1 (Vnp sync1 = Unp sync1/ $\sqrt{3}$ )	220 V to 250 kV	220 V to 250 kV	
Jnp sync2 (Vnp sync2 = Unp sync2/ $\sqrt{3}$ )	220 V to 250 kV	220 V to 250 kV	
Rated secondary phase-to-phase volta	age		
Jns sync1	90 V to 120 V	90 V to 230 V	
Jns sync2	90 V to 120 V	90 V to 230 V	
Synchro-check setpoints			
IUs set point	3 % to 30 % of Unp sync1	3 % to 30 % of Vnp sync1	
Ifs set point	0.05 to 0.5 Hz	0,05 to 0,5 Hz	
IPhi set point	5 to 80°	5 to 80°	
Js high set point	70 % to 110 % Unp sync1	70 % to 110 % Vnp sync1	
Js low set point	10 % to 70 % Unp sync1	10 % to 70 % Vnp sync1	
Other settings			
_ead time	0 to 0.5 s	0 to 0.5 s	
Operating modes: no-voltage conditions	Dead1 AND Live2	Dead1 AND Live2	
or which coupling is allowed	Live1 AND Dead2	Live1 AND Dead2	
	Dead1 XOR Dead2	Dead1 XOR Dead2	
	Dead1 OR Dead2	Dead1 OR Dead2	
	Dead1 AND Dead2	Dead1 AND Dead2	
ANSI 27 - Undervoltage (L-L) or (	L-N)		
Tripping curve	Definite time		
	IDMT		
Set point	5 to 100 % of Unp		0.05 to 300 s
Measurement origin	Main channels (U) or additional c	hannels (U')	
ANSI 27D - Positive sequence un	ndervoltage		
Set point and time delay	15 to 60 % of Unp		0.05 to 300 s
Drigine de la mesure	Main channels (U) or additional c	hannels (U')	
ANSI 27R - Remanent undervolta	age		
Set point and time delay	5 to 100 % of Unp		0.05 to 300 s
Measurement origin	Main channels (U) or additional c	hannels (U')	
ANSI 27TN/64G2 - Third harmoni	( )		
/s set point (fixed)	0.2 to 20 % of Vntp		0.05 to 300 s
<pre>&lt; set point (adaptive)</pre>	0.1 to 0.2		0.05 to 300 s
Positive sequence undervoltage	50 to 100 % of Unp		
Ainimum apparent power	1 to 90 % of Sb (Sb = 3.Un.lb)		
ANSI 32P - Directional active over	, ,		
	1 to 120 % of Sn <sup>(1)</sup>		0.1 s to 300 s
ANSI 32Q - Directional reactive of			0.1 5 10 500 5
	5 to 120 % of Sn <sup>(1)</sup>		0.1 s to 300 s
ANSI 27 Dhogo undergurrent			0.15003005
ANSI 37 - Phase undercurrent			0.05 +- 200 -
	0.05 to 1 lb		0.05 to 300 s
	•		
ANSI 37P - Directional active und	5 to 100 % of Sn <sup>(1)</sup>		0.1 s to 300 s
ANSI 38/49T - Temperature moni	toring		
ANSI 38/49T - Temperature moni Alarm set point TS1	<b>toring</b> 0 °C to 180 °C or 32 °F to 356 °F		
ANSI 38/49T - Temperature moni Alarm set point TS1 Frip set point TS2	toring 0 °C to 180 °C or 32 °F to 356 °F 0 °C to 180 °C or 32 °F to 356 °F		
ANSI 38/49T - Temperature moni Alarm set point TS1	toring 0 °C to 180 °C or 32 °F to 356 °F 0 °C to 180 °C or 32 °F to 356 °F		
ANSI 38/49T - Temperature moni Alarm set point TS1 Frip set point TS2	toring 0 °C to 180 °C or 32 °F to 356 °F 0 °C to 180 °C or 32 °F to 356 °F	2	
ANSI 38/49T - Temperature moni Alarm set point TS1 Trip set point TS2 ANSI 40 - Field loss (underimped	toring 0 °C to 180 °C or 32 °F to 356 °F 0 °C to 180 °C or 32 °F to 356 °F lance)	· · · · · · · · · · · · · · · · · · ·	0.05 to 300 s

(1)  $Sn = \sqrt{3}$ .In.Unp.

### **Protection** Setting ranges

Functions	Settings		Time delay	S
ANSI 46 - Negative sequence / ur				
Tripping curve	Definite time			
	Schneider Electric			
	IEC: SIT/A, LTI/B, VIT/B, EIT/C			
	IEEE: MI (D), VI (E), EI (F)			
	RI <sup>2</sup> (setting constant from 1 to 100)			
s set point	0.1 to 5 lb	Definite time	0.1 to 300 s	
	0.1 to 5 lb (Schneider Electric)	IDMT	0.1 to 1s	
	0.1 to 1 lb (IEC, IEEE)		0.110 13	
	0.03 to 0.2 lb (Rl <sup>2</sup> )			
Aeasurement origin	Main channels (I) or additional channe			
· ·	.,	IS (I )		
ANSI 47 - Negative sequence over	•			
Set point and time delay	1 to 50 % of Unp		0.05 to 300 s	
leasurement origin	Main channels (I) or additional channe	ls (l')		
ANSI 48/51LR -Locked rotor / exe	cessive starting time			
s set point	0.5 lb to 5 lb	ST starting time	0.5 to 300 s	
		LT and LTS time delays	0.05 to 300 s	
ANSI 49RMS - Thermal overload	for cables			
Admissible current	1 to 1.73 lb			
Time constant T1	1 to 600 mn			
ANSI 49RMS - Thermal overload				
		1.05 lb to 1.70 lb		
Alarm current		1.05 lb to 1.70 lb		
rip current		1.05 lb to 1.70 lb		
Positioning of the hot tripping curve	Current setting	1.02 x trip current to 2 lb		
	Time setting	1 to 2000 minutes (variable range depe	ending on the trip cur	rrent and current
	for successful to a second	setting)	M. 1. 4	M. J. A
ANSI 49RMS - Thermal overload			Mode 1	Mode 2
Accounting for negative sequence compo	onent	0 - 2.25 - 4.5 - 9		
Time constant	Heating		T1: 1 to 600 mn	T1: 1 to 600 m
	Cooling		T2: 5 to 600 mn	T2: 5 to 600 m
Alarm and tripping set points (Es1 and Es	\$2)	0 to 300 % of rated thermal capacity		
nitial thermal capacity used (Es0)		0 to 100 %		
Switching of thermal settings condition		by logic input		
		by Is set point adjustable from 0.25 to 8	3 lb	
Aaximum equipment temperature		60 to 200 °C (140 °F to 392 °F)		
leasurement origin	Main channels (I) or additional channe	ls (l')		
ANSI 50BF - Breaker failure				
Presence of current	0.2 to 2 In			
Derating time	0.05 s to 3 s			
ANSI 50/27 - Inadvertent energiz				
s set point	0.05 to 4 In		T1 01 10	
/s set point	10 to 100 % Unp		T1: 0 to 10 s	
			T2: 0 to 10 s	
ANSI 50/51 - Phase overcurrent				
	Tripping time delay	Timer hold		
Tripping curve	Definite time	DT		
	SIT, LTI, VIT, EIT, UIT <sup>(1)</sup>	DT		
	RI	DT		
	IEC: SIT/A, LTI/B, VIT/B, EIT/C	DT or IDMT		
	IEEE: MI (D), VI (E), EI (F)	DT or IDMT		
	IA: I, VI, EI	DT or IDMT		
	Customized	DT		
s set point	0.05 to 24 In	Definite time	Inst; 0.05 s to 300	S
Jocponic				
"marhald	0.05 to 2.4 ln	IDMT	0.1 s to 12.5 s at 1	
ïmer hold	Definite time (DT; timer hold)		Inst; 0.05 s to 300	5
			0.5 s to 20 s	
	IDMT (IDMT; reset time)			
	Main channels (I) or additional channe	ls (l')		
	Main channels (I) or additional channe None	ls (l')		
Measurement origin Confirmation	Main channels (I) or additional channe	ls (l')		

(1) Tripping as of 1.2 ls.

### **Protection** Setting ranges

	Settings		Time delays
ANSI 50N/51N or 50G/51G -	-		
	Tripping time delay	Timer hold	
Tripping curve	Definite time	DT	
	SIT, LTI, VIT, EIT, UIT (1)	DT	
	RI	DT	
	IEC: SIT/A,LTI/B, VIT/B, EIT/C	DT or IDMT	
	IEEE: MI (D), VI (E), EI (F)	DT or IDMT	
	IAC: I, VI, EI	DT or IDMT	
	EPATR-B, EPATR-C	DT	
	Customized	DT	
	0.6 to 5 A	EPATR-B	0.5 to 1 s
	0.6 to 5 A	EPATR-C	0.1 to 3 s
Is0 set point Timer hold	0.01 to 15 In0 (min. 0.1 A)	Definite time	Inst; 0.05 s to 300 s
	0.01 to 1 In0 (min. 0.1 A)	IDMT	0.1 s to 12.5 s at 10 ls0
	Definite time (DT; timer hold)		Inst; 0.05 s to 300 s
	IDMT (IDMT; reset time)		0.5 s to 20 s
easurement origin		ents $I0\Sigma$ or sum of phase currents $I'0\Sigma$	
NSI 50V/51V - Voltage-res			
Tripping curve	Tripping time delay	Timer hold	
		DT	
	SIT, LTI, VIT, EIT, UIT (1)	DT	
		DT	
	CEI: SIT/A, LTI/B, VIT/B, EIT/C	DT or IDMT	
	IEEE : MI (D), VI (E), EI (F)	DT or IDMT	
	IAC : I, VI, EI	DT or IDMT	
	Customized	DT	
	0.5 to 24 In	Definite time	Inst; 0.05 s to 300 s
	0.5 to 2.4 ln	IDMT	0.1 s to 12.5 s at 10 ls0
Timer hold	Definite time (DT; timer hold)		Inst; 0.05 s to 300 s
	IDMT (IDMT; reset time)		0.5 s to 20 s
asurement origin	Main channels (I) or additional chann	neis (I)	
NSI 51C - Capacitor bank			0.415.000
et point	0.05 A to 2 I'n	Definite time	0.1 to 300 s
NSI 59 - Overvoltage (L-L)			
point and time delay	50 to 150 % of Unp or Vnp		0.05 to 300 s
asurement origin	Main channels (U) or additional char	nnels (U <sup>r</sup> )	
NSI 59N - Neutral voltage			
Tripping curve	Definite time		
	IDMT		
point	2 to 80 % of Unp	Definite time	0.05 to 300 s
	2 to 10 % of Unp	IDMT	0.1 to 100 s
surement origin	Main channels (U), additional channels	eis (U) or neutral-point voltage Vnt	
NSI 64REF - Restricted ea			
set point	0.05 to 0.8 ln (ln ≥ 20 A)		
	0.1 to 0.8 ln (ln < 20 A)		
asurement origin	Main channels (I, I0) or additional ch	anneis (F, FU)	
U			
NSI 66 - Starts per hour			
NSI 66 - Starts per hour al number of starts	1 to 60	Period	1 to 6 h
NSI 66 - Starts per hour al number of starts mber of consecutive starts	1 to 60 1 to 60	Period T time delay stop/start	1 to 6 h 0 to 90 mn
ISI 66 - Starts per hour I number of starts uber of consecutive starts fripping as of 1.2 ls.	1 to 60		
NSI 66 - Starts per hour I number of starts her of consecutive starts Fripping as of 1.2 Is. NSI 67 - Directional phase	1 to 60 e overcurrent		
NSI 66 - Starts per hour I number of starts nber of consecutive starts Tripping as of 1.2 Is. NSI 67 - Directional phase	1 to 60 e overcurrent 30°, 45°, 60°	T time delay stop/start	
ISI 66 - Starts per hour I number of starts her of consecutive starts <i>Tripping as of 1.2 Is.</i> ISI 67 - Directional phase racteristic angle	1 to 60 e overcurrent 30°, 45°, 60° Tripping time delay	T time delay stop/start	
NSI 66 - Starts per hour I number of starts her of consecutive starts Fripping as of 1.2 Is. ISI 67 - Directional phase racteristic angle	1 to 60 e overcurrent 30°, 45°, 60° Tripping time delay Definite time	T time delay stop/start Timer hold delay DT	
NSI 66 - Starts per hour al number of starts nber of consecutive starts Tripping as of 1.2 Is. NSI 67 - Directional phase iracteristic angle	1 to 60 e overcurrent 30°, 45°, 60° Tripping time delay Definite time SIT, LTI, VIT, EIT, UIT <sup>(1)</sup>	T time delay stop/start Timer hold delay DT DT	
NSI 66 - Starts per hour al number of starts nber of consecutive starts <i>Tripping as of 1.2 Is.</i> NSI 67 - Directional phase aracteristic angle	1 to 60 e overcurrent 30°, 45°, 60° Tripping time delay Definite time SIT, LTI, VIT, EIT, UIT <sup>(1)</sup> RI	T time delay stop/start Timer hold delay DT DT DT DT	
NSI 66 - Starts per hour al number of starts mber of consecutive starts <i>Tripping as of 1.2 Is.</i> NSI 67 - Directional phase aracteristic angle	1 to 60 e overcurrent 30°, 45°, 60° Tripping time delay Definite time SIT, LTI, VIT, EIT, UIT <sup>(1)</sup> RI IEC: SIT/A, LTI/B, VIT/B, EIT/C	T time delay stop/start Timer hold delay DT DT DT DT DT DT DT DT OT IDMT	
NSI 66 - Starts per hour al number of starts mber of consecutive starts <i>Tripping as of 1.2 Is.</i> NSI 67 - Directional phase aracteristic angle	1 to 60 e overcurrent 30°, 45°, 60° Tripping time delay Definite time SIT, LTI, VIT, EIT, UIT <sup>(1)</sup> RI IEC: SIT/A, LTI/B, VIT/B, EIT/C IEEE: MI (D), VI (E), EI (F)	T time delay stop/start Timer hold delay DT DT DT DT DT DT DT or IDMT DT or IDMT	
NSI 66 - Starts per hour al number of starts mber of consecutive starts <i>Tripping as of 1.2 Is.</i> NSI 67 - Directional phase aracteristic angle	1 to 60 e overcurrent 30°, 45°, 60° Tripping time delay Definite time SIT, LTI, VIT, EIT, UIT <sup>(1)</sup> RI IEC: SIT/A, LTI/B, VIT/B, EIT/C IEEE: MI (D), VI (E), EI (F) IAC: I, VI, EI	T time delay stop/start Timer hold delay DT DT DT DT DT DT or IDMT DT or IDMT DT or IDMT	
NSI 66 - Starts per hour al number of starts mber of consecutive starts <i>Tripping as of 1.2 Is.</i> NSI 67 - Directional phase aracteristic angle oping curve	1 to 60 e overcurrent 30°, 45°, 60° Tripping time delay Definite time SIT, LTI, VIT, EIT, UIT <sup>(1)</sup> RI IEC: SIT/A, LTI/B, VIT/B, EIT/C IEEE: MI (D), VI (E), EI (F) IAC: I, VI, EI Customized	T time delay stop/start Timer hold delay DT DT DT DT DT T iDMT DT or IDMT DT or IDMT DT or IDMT DT or IDMT	0 to 90 mn
ANSI 66 - Starts per hour tal number of starts imber of consecutive starts of <i>Tripping</i> as of 1.2 Is. ANSI 67 - Directional phase naracteristic angle pping curve	1 to 60 e overcurrent 30°, 45°, 60° Tripping time delay Definite time SIT, LTI, VIT, EIT, UIT <sup>(1)</sup> RI IEC: SIT/A, LTI/B, VIT/B, EIT/C IEEE: MI (D), VI (E), EI (F) IAC: I, VI, EI Customized 0.1 to 24 In	T time delay stop/start Timer hold delay DT DT DT DT DT or IDMT DT	0 to 90 mn
NSI 66 - Starts per hour al number of starts mber of consecutive starts <i>Tripping as of 1.2 Is.</i> NSI 67 - Directional phase aracteristic angle oping curve	1 to 60 e overcurrent 30°, 45°, 60° Tripping time delay Definite time SIT, LTI, VIT, EIT, UIT <sup>(1)</sup> RI IEC: SIT/A, LTI/B, VIT/B, EIT/C IEEE: MI (D), VI (E), EI (F) IAC: I, VI, EI Customized	T time delay stop/start Timer hold delay DT DT DT DT DT T iDMT DT or IDMT DT or IDMT DT or IDMT DT or IDMT	0 to 90 mn

(1) Tripping as of 1.2 ls.

### **Protection** Setting ranges

Function	S	Settings		Time
	7NC - Directional earth fault, proj	•		
Characteristic a		-45°, 0°, 15°, 30°, 45°, 60°, 90°		
s0 set point		0.01 to 15 In0 (mini. 0,1 A)	Definite time	Inst; 0.05 s to 300 s
/s0 set point		2 to 80 % of Unp		
Nemory time		T0mem time	0; 0.05 s to 300 s	
		V0mem validity set point	0; 2 to 80 % of Unp	
Measurement o	origin	10 input, I'0 input	· · · · ·	
<b>ANSI 67N/6</b>	7NC - Directional earth fault, acco	ording to 10 vector magnitude (ty	vpe 2)	
Characteristic a	angle	-45°, 0°, 15°, 30°, 45°, 60°, 90°		
		Tripping time delay	Timer hold delay	
Courbe de décl	enchement	Definite time	DT	
		SIT, LTI, VIT, EIT, UIT <sup>(1)</sup>	DT	
		RI	DT	
		IEC: SIT/A,LTI/B, VIT/B, EIT/C	DT or IDMT	
		IEEE: MI (D), VI (E), EI (F)	DT or IDMT	
		IAC: I, VI, EI	DT or IDMT	
		Customized	DT	
s0 set point		0.1 to 15 In0 (min. 0.1 A)	Definite time	Inst; 0.05 s to 300 s
		0.01 to 1 In0 (min. 0.1 A)	IDMT	0.1 s to 12.5 s at 10 ls0
/s0 set point		2 to 80 % of Unp		
imer hold		Definite time (DT; timer hold)		Inst; 0.05 s to 300 s
		IDMT (IDMT; reset time)		0.5 s to 20 s
leasurement o	origin	10 input, I'0 input or sum of phase curr	ents I0S	
ANSI 67N/6	7NC type 3 - Directional earth fau	lt, according to I0 vector magnit	ude directionalized on a	tripping sector
ripping sector	start angle	0° to 359°		
ripping sector	end angle	0° to 359°		
s0 set point	CSH core balance CT (2 A rating)	0.1 A to 30 A	Definite time	Inst; 0.05 s to 300 s
	1ACT	0.005 to 15 In0 (min. 0.1 A)		
	Core balance CT + ACE990 (range 1)	0.01 to 15 In0 (min. 0.1 A)		
/s0 set point		Calculated V0 (sum of 3 voltages)	2 to 80 % of Unp	
		Measured V0 (external VT)	0.6 to 80 % of Unp	
Measurement o	origin	10 input or I'0 input		
ANSI 78PS	- Pole slip			
	ne equal-area criterion	0.1 to 300 s		
,	ber of power swings	1 to 30		
	2 power swings	1 to 300 s		
	Overfrequency			
Set point and tir		50 to 55 Hz or 60 to 65 Hz		0.1 to 300 s
Measurement of		Main channels (U) or additional chann		0.110 300 \$
	Underfrequency			
				0.4 to 200 o
Set point and tir		40 to 50 Hz or 50 to 60 Hz Main channels (U) or additional chann		0.1 to 300 s
Measurement of		Main channels (0) of additional chann	iels (O)	
AN5181R-1	Rate of change of frequency			0.451,000
		0.1 to 10 Hz/s		0.15 to 300 s
	Machine différential			
ds set point		0.05 to 0.5 ln (ln u 20 A)		
		0.1 to 0.5 ln (ln < 20 A)		
	Transformer differential			
ligh set point		3 to 18 In1		
Percentage-b	based curve			
ds set point		30 to 100 % In1		
Slope Id/It		15 to 50 %		
Slope Id/It2		without, 50 to 100 %		
Slope change p		1 to 18 ln1		
Restraint on	-			
Current thresho	old	1 to 10 %		
Delay		0 to 300 s		
Restraint on	CT loss			
Activity		On / Off		
Retenues sur	r taux d'harmoniques	Classic	Self-adapting	
Choice of restra	aint	Classic	Self-adapting	
High set point		On	On / Off	
	centage set point	off, 5 to 40 %		
Harmonic 2 res	traint	per phase / total		
Harmonic 5 per	centage set point	off, 5 to 40 %		
lanne e per				

### **Control and monitoring** Description

Sepam performs all the control and monitoring functions required for electrical network operation:

■ the main control and monitoring functions are predefined and fit the most frequent cases of use. They are ready to use and are implemented by simple parameter setting after the necessary logic inputs / outputs are assigned.

■ the predefined control and monitoring functions can be adapted for particular needs using the SFT2841 software, which offers the following customization options: □ logic equation editor, to adapt and complete the predefined control and monitoring functions

□ creation of personalized messages for local annunciation

□ creation of personalized mimic diagrams corresponding to the controlled devices □ customization of the control matrix by changing the assignment of output relays,

LEDs and annunciation messages

■ with the Logipam option, Sepam can provide the most varied control and monitoring functions, programmed using the SFT2885 programming software that implements the Logipam ladder language.

#### **Operating principle**

The processing of each control and monitoring function may be broken down into 3 phases:

- acquisition of input data:
- □ results of protection function processing

□ external logic data, connected to the logic inputs of an optional MES120 input / output module

- Iocal control orders transmitted by the mimic-based UMI
- □ remote control orders (TC) received via the Modbus communication link
- actual processing of the control and monitoring function
- utilization of the processing results:
- □ activation o sent to the facility manager:
- by message and/or LED on the Sepam display and SFT2841 software
- by remote indication (TS) via the Modbus communication link
- by real-time indications on device status on the animated mimic diagram.

#### Logic inputs and outputs

The number of Sepam inputs / outputs must be adapted to fit the control and monitoring functions used.

The 5 outputs included in the Sepam series 80 base unit may be extended by adding 1, 2 or 3 MES120 modules with 14 logic inputs and 6 output relays.

After the number of MES120 modules required for the needs of an application is set, the logic inputs are assigned to functions. The functions are chosen from a list which covers the whole range of possible uses. The functions are adapted to meet needs within the limits of the logic inputs available. The inputs may also be inverted for undervoltage type operation.

A default input / output assignment is proposed for the most frequent uses.

EE0240

Maximum Sepam series 80 configuration with 3 MES120 modules: 42 inputs and 23 outputs.

### **Control and monitoring** Description of predefined functions

Each Sepam contains the appropriate predefined control and monitoring functions for the chosen application.

#### ANSI 94/69 - Circuit breaker/contactor control

Control of breaking devices equipped with different types of closing and tripping coils:

- circuit breakers with shunt or undervoltage trip coils
- latching contactors with shunt trip coils
- contactors with latched orders.
- The function processes all breaking device closing and tripping conditions, based on:
- protection functions
- breaking device status data
- remote control orders

■ specific control functions for each application (e.g. recloser, synchro-check). The function also inhibits breaking device closing, according to the operating conditions.

#### Automatic transfer (AT)

This function transfers busbar supply from one source to another. It concerns substations with two incomers, with or without coupling.

The function carries out:

- automatic transfer with a break if there is a loss of voltage or a fault
- manual transfer and return to normal operation without a break, with or without synchro-check
- control of the coupling circuit breaker (optional)
- selection of the normal operating mode

■ the necessary logic to ensure that at the end of the sequence, only 1 circuit breaker out of 2 or 2 out of 3 are closed.

The function is distributed between the two Sepam units protecting the two incomers. The synchro-check function (ANSI 25) is carried out by the optional MCS025 module, in conjunction with one of the two Sepam units.

Load shedding - Automatic restart

Automatic load regulation on electrical networks by load shedding followed by automatic restarting of motors connected to the network

#### Load shedding

The breaking device opens to stop motors in case of:

detection of a network voltage sag by the positive sequence undervoltage protection function  $\mathsf{ANSI}\,\mathsf{27D}$ 

receipt of a load shedding order on a logic input.

#### Automatic restart

The motors disconnected as a result of the network voltage sag are automatically restarted:


- after the return of network voltage is detected by the positive sequence
- undervoltage protection function ANSI 27D

and a time delay has run out, so as to stagger motor restarts.

#### **De-excitation**

Interruption of a synchronous generator's excitation supply and tripping of the generator breaking device in case of:

- detection of an internal generator fault
- detection of an excitation system fault
- receipt of a de-excitation order on a logic input or via the communication link.



Automatic transfer with synchro-check controlled by Sepam series 80.

### **Control and monitoring** Description of predefined functions

#### Genset shutdown

Shutdown of the driving machine, tripping of the breaking device and interruption of the generator excitation supply in case of:

detection of an internal generator fault

receipt of a genset shutdown order on a logic input or via the communication link.

#### **Control of capacitor banks**

This function controls 1 to 4 switches for capacitor steps, taking into account all the closing and tripping conditions determined by the ANSI 94/69 function for control of the switchgear.

Manual or automatic control, controlled by an external reactive-energy regulator.

#### **ANSI 68 - Logic discrimination**

This function provides:

■ perfect tripping discrimination with phase-to-phase and phase-to-earth shortcircuits, on all types of network

■ faster tripping of the breakers closest to the source (solving the drawback of conventional time discrimination).

Each Sepam is capable of:

■ sending a blocking input when a fault is detected by the phase overcurrent and earth fault protection functions, which may or may not be directional (ANSI 50/51, 50N/51N, 67 or 67N/67NC)

■ and receiving blocking inputs which inhibit protection tripping. A saving mechanism ensures continued operation of the protection in the event of a blocking link failure.

#### ANSI 86 - Latching / acknowledgement

The tripping outputs for all the protection functions and all the logic inputs can be latched individually. The latched information is saved in the event of an auxiliary power failure.

(The logic outputs cannot be latched.)

All the latched data may be acknowledged:

- locally, with the key
- remotely via a logic input
- or via the communication link.

The Latching/acknowledgement function, when combined with the circuit breaker/ contactor control function, can be used to create the ANSI 86 "Lockout relay" function.


#### Output relay testing

Each output relay is activated for 5 seconds, to make it simpler to check output connections and connected switchgear operation.

### **Control and monitoring** Description of predefined functions



Local indications on the Sepam front panel.



SFT2841: alarm history.

#### **ANSI 30 - Local annunciation**

#### LED indication

■ 2 LEDs, on the front and back of Sepam, indicate the unit operating status, and are visible when a Sepam without a UMI is mounted inside the LV compartment, with access to connectors:

□ green LED ON: Sepam on

□ red "key" LED: Sepam unavailable (initialization phase or detection of an internal failure)

- 9 yellow LEDs on the Sepam front panel:
- □ pre-assigned and identified by standard removable labels

□ the SFT2841 software tool may be used to assign LEDs and personalize labels.

#### Local annunciation on Sepam display

Events and alarms may be indicated locally on Sepam's advanced UMI or on the mimic-based UMI by:

- messages on the display unit, available in 2 languages:
- □ English, factory-set messages, not modifiable

□ local language, according to the version delivered (the language version is chosen when Sepam is set up)

■ the lighting up of one of the 9 yellow LEDs, according to the LED assignment, which is set using SFT2841.

#### Alarm processing

■ when an alarm appears, the related message replaces the current display and the related LED goes on.

The number and type of messages depend on the type of Sepam. The messages are linked to Sepam functions and may be viewed on the front-panel display and in the SFT2841 "Alarms" screen.

- to clear the message from the display, press the key
- after the fault has disappeared, press the key: the light goes off and Sepam is reset

■ the list of alarm messages remains accessible (△ key) and may be cleared by pressing the → key.

### **Control and monitoring** Description of predefined functions



Local control using the mimic-based UMI.

#### Local control using the mimic-based UMI

#### Sepam control mode

A key-switch on the mimic-based UMI is used to select the Sepam control mode. Three modes are available : Remote, Local or Test.

- In Remote mode:
- remote control orders are taken into account
- local control orders are disabled, with the exception of the circuit-breaker open order.
- In Local mode:
- remote control orders are disabled, with the exception of the circuit-breaker open order

■ local control orders are enabled.

- Test mode should be selected for tests on equipment, e.g. during preventivemaintenance operations:
- all functions enabled in Local mode are available in Test mode
- no remote indications (TS) are sent via the communication link.

The Logipam programming software can be used to customize control-mode processing.

#### View device status on the animated mimic diagram

For safe local control of devices, all information required by operators can be displayed simultaneously on the mimic-based UMI:

■ single-line diagram of the equipment controlled by Sepam, with an animated, graphic indication of device status in real time

the desired current, voltage and power measurements.

The local-control mimic diagram can be customized by adapting one of the supplied, predefined diagrams or by creating a diagram from scratch.

#### Local control of devices

All the devices for which opening and closing are controlled by Sepam can be controlled locally using the mimic-based UMI.

The most common interlock conditions can be defined be logic equations or by Logipam.

The sure and simple operating procedure is the following:

select the device to be controlled by moving the selection window using the keys
 or 
 Sepam checks whether local control of the selected device is authorized

and informs the operator (selection window with a solid line) ■ selection confirmation for the device to be controlled by pressing the key (the selection window flashes)

device control by pressing:

🗆 key 🤨: open order

□ or key ①: close order.


### **Control and monitoring** Adaptation of predefined functions using the SFT2841 software


The predefined control and monitoring functions can be adapted for particular needs using the SFT2841 software, which offers the following customization options: logic equation editor, to adapt and complete the predefined control and monitoring

- functions
- creation of personalized messages for local annunciation
- creation of custom mimic diagrams corresponding to the controlled devices

customization of the control matrix by changing the assignment of output relays, LEDs and annunciation messages.

#### **Operating principle**

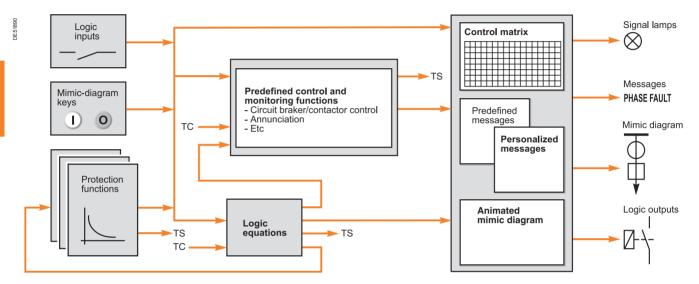



SFT2841: logic equation editor.

#### Logic equation editor

The logic equation editor included in the SFT2841 software can be used to: complete protection function processing:

- additional interlocking
- □ conditional inhibition/validation of functions
- □ etc.

 adapt predefined control functions: particular circuit breaker or recloser control sequences, etc.

Note that the use of the logic equation editor excludes the possibility of using the Logipam programming software.

A logic equation is created by grouping logic input data received from:

- protection functions
- logic inputs
- local control orders transmitted by the mimic-based UMI
- remote control orders

using the Boolean operators AND, OR, XOR, NOT, and automation functions such as time delays, bistables and time programmer.

Equation input is assisted and syntax checking is done systematically.

The result of an equation may then be:

- assigned to a logic output, LED or message via the control matrix
- transmitted by the communication link, as a new remote indication

 utilized by the circuit breaker/contactor control function to trip, close or inhibit breaking device closing

used to inhibit or reset a protection function.

### **Control and monitoring** Adaptation of predefined functions using the SFT2841 software

#### Personalized alarm and operating messages

The alarm and operating messages may be personalized using the SFT2841 software tool.

The new messages are added to the list of existing messages and may be assigned via the control matrix for display:

on the Sepam display

■ in the SFT2841 "Alarms" and "Alarm History" screens.

#### Local-control mimic diagram

The mimic-diagram editor in the SFT2841 software can be used to create a singleline diagram corresponding exactly to the equipment controlled by Sepam. Two procedures are available:

■ rework a diagram taken from the library of standard diagrams in the SFT2841 software

■ creation of an original diagram : graphic creation of the single-line diagram, positioning of symbols for the animated devices, insertion of measurements, text, etc.

Creation of a customized mimic diagram is made easy:

- library of predefined symbols: circuit breakers, earthing switch, etc.
- creation of personalized symbols.


A-+++0 Pa 24

SFT2841: control matrix.

EROAD

#### **Control matrix**


- The control matrix is a simple way to assign data from:
- protection functions
- control and monitoring functions
- logic inputs
- logic equations or Logipam program
- to the following output data:
- output relays
- 9 LEDs on the front panel of Sepam
- messages for local annunciation
- triggering of disturbance recording.




### **Control and monitoring** Customized functions using Logipam

The SFT2885 programming software (Logipam) can be used to enhance Sepam by programming specific control and monitoring functions.

Only the Sepam series 80 with a cartridge containing the Logipam SFT080 option can run the control and monitoring functions programmed by Logipam.

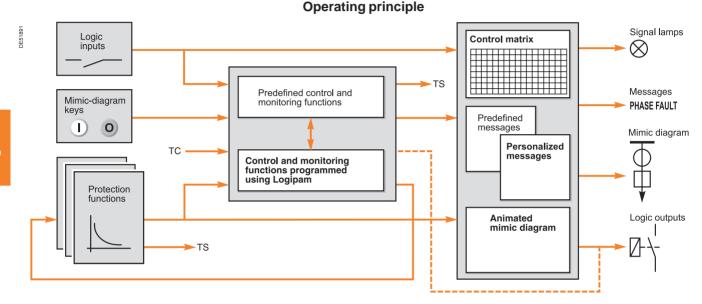





#### Logipam programming software

The Logipam SFT2885 programming software can be used to:

adapt predefined control and monitoring functions

■ program specific control and monitoring functions, either to replace the predefined versions or to create completely new functions, to provide all the functions required by the application.

It is made up of:

a ladder-language program editor used to address all Sepam data and to program complex control functions

a simulator for complete program debugging

■ a code generator to run the program on Sepam.

The ladder-language program and the data used can be documented and a complete file can be printed.

Offering more possibilities than the logic-equation editor, Logipam can be used to create the following functions :

- specific automatic transfer functions
- motor starting sequences.

It is not possible to combine the functions programmed by Logipam with functions adapted by the logic-equation editor in a given Sepam.

The Logipam program uses the input data from:

- protection functions
- logic inputs
- remote control orders
- Iocal control orders transmitted by the mimic-based UMI.

The result of Logipam processing may then be:

- assigned to a logic output, directly or via the control matrix
- assigned to a LED or message via the control matrix
- transmitted by the communication link, as a new remote indication
- used by the predefined control and monitoring functions
- used to inhibit or reset a protection function.

### Base unit Presentation

### Base units are defined according to the following characteristics:

- type of User-Machine Interface (UMI)
- working language
- type of base unit connector
- type of current sensor connector
- type of voltage sensor connector.



Sepam series 80 base unit with integrated advanced UMI.



Sepam series 80 base unit with mimic-based UMI.



Customized Chinese advanced UMI.

### **User-Machine Interface**

Two types of User-Machine Interfaces (UMI) are available for Sepam series 80 base units:

- mimic-based UMI
- advanced UMI.

The advanced UMI can be integrated in the base unit or installed remotely on the cubicle. Integrated and remote advanced UMIs offer the same functions.

A Sepam series 80 with a remote advanced UMI is made up of:

- a bare base unit without any UMI, for mounting inside the LV compartment
- a remote advanced UMI (DSM303)

□ for flush mounting on the front panel of the cubicle in the location most suitable for the facility manager

□ for connection to the Sepam base unit using a prefabricated CCA77x cord. The characteristics of the remote advanced UMI module (DSM303) are presented on page 162.

#### Comprehensive data for facility managers

All the data required for local equipment operation may be displayed on demand: display of all measurement and diagnosis data in numerical format with units and/or in bar graphs

- display of operating and alarm messages, with alarm acknowledgment and Sepam resetting
- display of the list of activated protection functions and the main settings of major protection functions
- adaptation of activated protection function set points or time delays in response to new operating constraints
- display of Sepam and remote module versions
- output testing and logic input status display
- display of Logipam data: status of variables, timers
- entry of 2 passwords to protect parameter and protection settings.

#### Local control of devices using the mimic-based UMI

The mimic-based UMI provides the same functions as the advanced UMI as well as local control of devices:

- selection of the Sepam control mode
- view device status on the animated mimic diagram
- Iocal opening and closing of all the devices controlled by Sepam.

#### **Ergonomic data presentation**

- keypad keys identified by pictograms for intuitive navigation
- menu-guided access to data
- graphical LCD screen to display any character or symbol

 excellent display quality under all lighting conditions : automatic contrast setting and backlit screen (user activated).

#### Working language

All the texts and messages displayed on the advanced UMI or on the mimic-based UMI are available in 2 languages:

- English, the default working language
- and a second language, which may be
- French
- □ Spanish
- □ another "local" language.

Please contact us regarding local language customization.

#### Connection of Sepam to the parameter setting tool

The SFT2841 parameter setting tool is required for Sepam protection and parameter setting.

A PC containing the SFT2841 software is connected to the RS 232 communication port on the front of the unit.

### **Base unit** Presentation

	Selecti	on guide	
Base unit	With remote advanced UMI	With integrated advanced UMI	With mimic-based UMI
	Decodor		
Functions			
Local indication			
Metering and diagnosis data	•	•	•
Alarms and operating messages	•	•	
List of activated protection functions			
Main protection settings			•
Version of Sepam and remote modules	•	•	
Status of logic inputs			
Logipam data	•	•	•
Switchgear status on the animated mimic diagram			•
Phasor diagram of currents or voltages			•
Local control			
Alarm acknowledgement	•		
Sepam reset			
Output testing			
Selection of Sepam control mode			-
Device open/close order			•
Characteristics Screen			
Size	128 x 64 pixels	128 x 64 pixels	128 x 240 pixels
Automatic contrast setting	•	•	•
Backlitscreen	•	•	•
Keypad			
Number of keys	9	9	14
Control-mode switch			Remote / Local / Test
LEDs			
Sepam operating status	<ul> <li>base unit: 2 LEDs visible on back</li> <li>remote advanced UMI: 2 LEDs visible on front</li> </ul>	2 LEDs, visible from front and back	2 LEDs, visible from front and back
Indication LEDs	9 LEDs on remote advanced UMI	9 LEDs on front	9 LEDs on front
Mounting			
	<ul> <li>bare base unit, mounted at the back of the compartment using the AMT880 mounting plate</li> <li>DSM303 remote advanced UMI module, flush mounted on the front of the cubicle and connected to the base unit with the CCA77x prefabricated cord</li> </ul>	Flush mounted on front of cubicle	Flush mounted on front of cubicle

### Base unit Presentation



Sepam series 80 memory cartridge and backup battery.

### Hardware characteristics

#### Removable memory cartridge

- The cartridge contains all the Sepam characteristics:
- all Sepam protection and parameter settings
- all the metering and protection functions required for the application
- predefined control functions
- functions customized by control matrix or logic equations
- functions programmed by Logipam (optional)
- personalized local-control mimic diagram
- accumulated energies and switchgear diagnosis values
- working languages, customized and otherwise.
- It may be made tamper-proof by lead sealing.

It is removable and easy to access on the front panel of Sepam to reduce maintenance time.

If a base unit fails, simply:

- switch off Sepam and unplug connectors
- retrieve original cartridge
- replace the faulty base unit by a spare base unit (without cartridge)
- load the original cartridge into the new base unit
- plug in the connectors and switch Sepam on again:

Sepam is operational, with all its standard and customized functions, without requiring any reloading of protection and parameter settings.

#### **Backup battery**

Standard lithium battery, 1/2 AA format, 3.6 Volts.

It allows the following data to be stored in the event of an auxiliary power outage: time-tagged event tables

- disturbance recording data
- peak demands, tripping context, etc
- date and time.

The battery presence and charge are monitored by Sepam.

The main data (e.g. protection and parameter settings) are saved in the event of an auxiliary power outage, regardless of the state of the battery.

#### Auxiliary power supply

DC power supply voltage from 24 to 250 V DC.

#### **Five relay outputs**

The 5 relay outputs O1 to O5 on the base unit must be connected to connector (A). Each output can be assigned to a predetermined function using the SFT2841 software.

O1 to O4 are 4 control outputs with one NO contact, used by default for the switchgear control function:

- O1: switchgear tripping
- O2: switchgear closing inhibition
- O3: switchgear closing
- O4: available.

O5 is an indication output used by default for the watchdog function and has two contacts, one NC and one NO.

### Base unit Presentation



### Main connector and voltage and residual current input connector

A choice of 2 types of removable, screw-lockable 20-pin connectors:

- CCA620 screw-type connectors
- or CCA622 ring lug connectors.

The presence of the connector is monitored.

#### Connector for additional voltage inputs (Sepam B83)

CCT640 connector, removable and screw-lockable. The presence of the CCT640 connector is monitored.

The presence of the CC 1640 connector is monitored

#### Phase current input connectors

Current sensors connected to removable, screw-lockable connectors according to type of sensors used:

■ CCA630 or CCA634 connector for 1 A or 5 A current transformers

or CCA671 connector for LPCT sensors.

The presence of these connectors is monitored.

### **Mounting accessories**

#### Spring clips

8 spring clips are supplied with the base unit to flush-mount Sepam in mounting plates 1.5 to 6 mm thick. Simple, tool-free installation.

#### AMT880 mounting plate

It is used to mount a Sepam without UMI inside the compartment with access to connectors on the rear panel.

Mounting used with remote advanced UMI module (DSM303).

#### AMT820 blanking plate

It fills in the space left when a standard model Sepam 2000 is replaced by a Sepam series 80.

### Spare base units

- The following spares are available to replace faulty base units:
- base units with or without UMI, without cartridge or connectors
- all types of standard cartridges, with or without the Logipam option.

#### AMT852 lead sealing accessory

The AMT852 lead sealing accessory can be used to prevent unauthorized modification of the settings of Sepam series 80 units with integrated advanced UMIs. The accessory includes:

a lead-sealable cover plate

the screws required to secure the cover plate to the integrated advanced UMI of the Sepam unit.

**Note:** the AMT852 lead sealing accessory can secured only to the integrated advanced UMIs of Sepam series 80 units Contact us to determine the serial number of the device on wich you can fit the lead sealing accessory.

Green LED: Sepam on.

9 yellow indication LEDs.

Graphical LCD screen. Display of measurements.

Display of alarm messages.

11 LED test (or move cursor down).

13 Display of Sepam and Logipam data.

diagnosis data.

cursor up).

settings.

16 Backup battery.

18 Door.

17 Memory cartridge.

14 Entry of 2 passwords. 15 RS 232 PC connection port.

Red LED: Sepam unavailable.

Label identifying the indication LEDs.

Sepam reset (or confirm data entry).

1

2

3

4 5


6

7


8

9

### **Base unit** Description

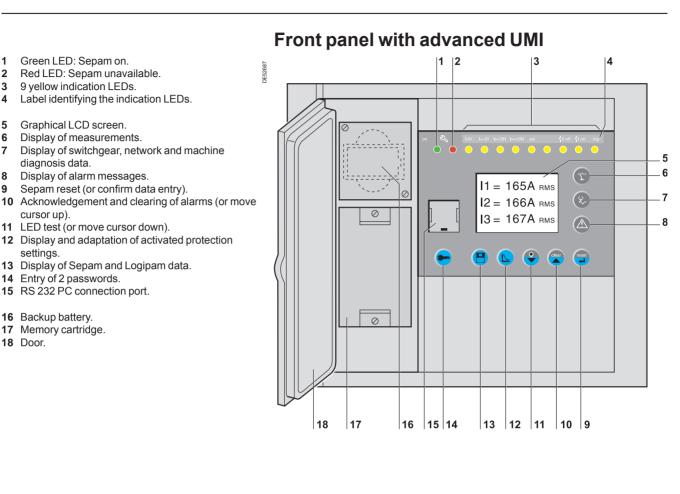

### Front panel with mimic-based UMI

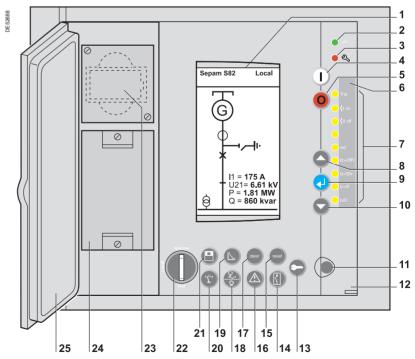

#### Graphical LCD screen. 1

- Green LED: Sepam on. 2
- Red LED: Sepam unavailable. 3
- Local close order. 4
- 5 Local open order.
- Label identifying the indication LEDs. 6
- 7 9 yellow indication LEDs.
- 8 Move cursor up
- Confirm data entry. 9
- 10 Move cursor down.
- 11 RS 232 PC connection port.
- 12 Transparent door.
- 13 Entry of 2 passwords.
- 14 Mimic-based UMI display.
- 15 Sepam reset.
- 16 Display of alarm messages.
- 17 Acknowledgement and clearing of alarms.
- 18 Display of switchgear and network diagnosis data (or LED test).
- 19 Display and adaptation of activated protection settings.
- 20 Display of measurements.
- 21 Display of Sepam and Logipam data.
- 22 Three-position key switch to select Sepam control mode.
- 23 Backup battery.
- 24 Memory cartridge.
- 25 Door.

## 3

### **Base unit** Description

3


4

(D2)

(D1)

(A)

5

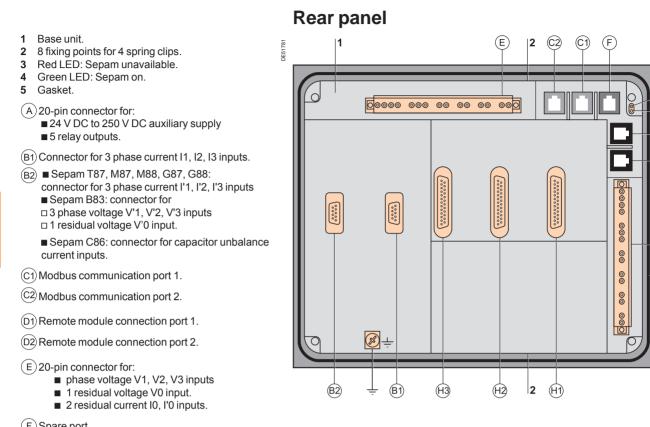

(F) Spare port.

(H1) Connector for 1st MES120 input/output module.

(H2) Connector for 2nd MES120 input/output module.

(H3) Connector for 3rd MES120 input/output module.

122

### **Base unit** Technical characteristics

Weight					
		Base unit with a	dvanced UMI	Base unit with	mimic-based UMI
Minimum weight (base unit witho	out MES120)	2.4 kg (5.29 lb)		3.0 kg (6.61 lb)	
Maximum weight (base unit with	3 MES120)	4.0 kg (8.82 lb)		4.6 kg (10.1 lb)	
Sensor inputs					
Phase current inputs		1 A or 5 A CT			
Input impedance		< 0.02 Ω			
Consumption		< 0.02 VA (1 A CT) < 0.5 VA (5 A CT)			
Continuous thermal withstand		4 In			
1 second overload		100 In			
Voltage inputs		Phase		Residual	
Input impedance		> 100 k Ω		> 100 k Ω	
Consommation		< 0.015 VA (100 V V	′T)	< 0.015 VA (100 VA)	VVT)
Continuous thermal withstand		240 V		240 V	
1-second overload		480 V		480 V	
Isolation of inputs in relation to other isolated groups		Enhanced		Enhanced	
Relay outputs					
Control relay outputs O1	to O4 and 0 x 0.1 (1)				
Voltage	DC	24/48 V DC	127 V DC	220 V DC	
	AC (47.5 to 63 Hz)				100 to 240 V AC
Continuous current		8A	8A	8A	8A
Breaking capacity	Resistive load	8A/4A	0.7 A	0.3 A	
	Load L/R < 20 ms	6A/2A	0.5A	0.2 A	
	Load L/R < 40 ms	4A/1A	0.2A	0.1 A	
	Resistive load				8A
	Load p.f. > 0.3				5A
Making capacity		< 15 A for 200 ms			
Isolation of outputs in relation to other isolated groups		Enhanced			
Annunciation relay output	it 05				
Voltage	DC	24/48 V DC	127 V DC	220 V DC	
0	AC (47.5 to 63 Hz)				100 to 240 V AC
Continuous current	· · ·	2A	2A	2A	2A
Breaking capacity	Load L/R < 20 ms	2A/1A	0.5A	0.15A	
· · ·	Load p.f. > 0.3				1A
Isolation of outputs in relation to other isolated groups		Enhanced			
Power supply					
Voltage		24 to 250 V DC	-20 % /	+10 %	
Maximum consumption		< 16 W			
Inrush current		< 10 A 10 ms			
Acceptable ripple content		12 %			
Acceptable momentary outages		100 ms			
Battery					
Format		1/2 AA lithium 3.6 V			
Service life		10 years Sepam en	•		
		8 years Sepam not e	energized		


8 years Sepam not energized (1) Relay outputs comptying with clause 6.7 of standard C 97.90 (30 A, 200 ms, 2000 operations)

### **Base unit Environmental characteristics**

Electromagnetic compatibility	Standard	Level / Class	Value
Disturbing field emission	IEC 60255-25		
	EN 55022	A	
Conducted disturbance emission	IEC 60255-25		
	EN 55022	A	
Immunity tests – Radiated disturbances			
mmunity to radiated fields	IEC 60255-22-3		10 V/m; 80 MHz - 1 GHz
	IEC 61000-4-3	III	10 V/m; 80 MHz - 2 GHz
	ANSI C37.90.2		35 V/m; 25 MHz - 1 GHz
Electrostatic discharge	IEC 60255-22-2		8 kV air; 6 kV contact
	ANSI C37.90.3		8 kV air; 4 kV contact
mmunity to magnetic fields at network frequency	IEC 61000-4-8	4	30 A/m (continuous) - 300 A/m (1-3 s
Immunity tests – Conducted disturbances			40.14
mmunity to conducted RF disturbances	IEC 60255-22-6		10 V
ast transient bursts	IEC 60255-22-4	A and B	4 kV; 2.5 kHz / 2 kV; 5 kHz
	IEC 61000-4-4	IV	4 kV; 2.5 kHz
MU a demond as a filled in a surger	ANSI C37.90.1		4 kV; 2.5 kHz
MHz damped oscillating wave	IEC 60255-22-1		2.5 kV CM; 1 kV DM
00 MHz damped oscillating wave	ANSI C37.90.1		2.5 kV CM; 2.5 kV DM
	IEC 61000-4-12 IEC 61000-4-5		2.5 kV CM; 1 kV DM 2 kV CM; 1 kV DM
Surges /oltage interruptions	IEC 60255-11		100 % during 100 ms
Mechanical robustness			5
	Standard	Level / Class	Value
In operation			
/ibrations	IEC 60255-21-1	2	1 Gn; 10 Hz - 150 Hz
	IEC 60068-2-6	Fc	2 Hz - 13.2 Hz; a = ±1 mm
Shocks	IEC 60255-21-2	2	10 Gn / 11 ms
Earthquakes	IEC 60255-21-3	2	2 Gn (horizontal axes)
De energiand			1 Gn (vertical axes)
De-energized			0.0. (0.1) (50.1)
/ibrations	IEC 60255-21-1	2	2 Gn; 10 Hz - 150 Hz
Shocks	IEC 60255-21-2	2	27 Gn / 11 ms
Jolts	IEC 60255-21-2	2	20 Gn / 16 ms
Climatic withstand	Standard	Level / Class	Value
In operation			
Exposure to cold	IEC 60068-2-1	Ad	-25 °C
Exposure to dry heat	IEC 60068-2-2	Bd	+70 °C
Continuous exposure to damp heat	IEC 60068-2-78	Cab	10 days; 93 % RH ; 40 °C
Salt mist	IEC 60068-2-52	Kb/2	6 days
nfluence of corrosion/Gas test 2	IEC 60068-2-60		21 days; 75 % RH; 25 °C; 0.5 ppm H₂S; 1 ppm SO₂
nfluence of corrosion/Gas test 4	IEC 60068-2-60		21 days; 75 % HR; 25 °C;
	120 00000 2 00		0.01 ppm H <sub>2</sub> S; 0.2 ppm SO <sub>2</sub> ;
			0.2 ppm NO <sub>2</sub> ; 0.01 ppm Cl <sub>2</sub>
In storage <sup>(3)</sup>			
emperature variation with specified variation rate	IEC 60068-2-14	Nb	-25 °C at +70 °C; 5 °C/min
Exposure to cold	IEC 60068-2-1	Ab	-25 °C
Exposure to dry heat	IEC 60068-2-2	Bb	+70 °C
Continuous exposure to damp heat	IEC 60068-2-78	Cab	56 days; 93 % RH; 40 °C
	IEC 60068-2-30	Db	6 days; 95 % RH; 55 °C
Safety	Standard	Level / Class	Value
	Stanuaru	Level / Glass	Value
Enclosure safety tests		IDE2	Other penale ID22
ront panel tightness	IEC 60529	IP52	Other panels IP20
Fire withstand	NEMA	Туре 12	650 °C with alow wire
Electrical safety tests	IEC 60695-2-11		650 °C with glow wire
.2/50 µs impulse wave			5 k) ((1)
	IEC 60255-5		$5 \text{ kV}^{(1)}$
Power frequency dielectric withstand	IEC 60255-5		$2 \text{ kV 1mn}^{(2)}$
	ANSI C37.90		1 kV 1 mn (indication output) 1.5 kV 1 mn (control output)
Certification			
e	ENISSO	-	
	EN 50263 harmonized standard	European directives: 89/336/EEC Electro 92/31/EEC Amendme 93/68/EEC Amendme 73/23/EEC Low Volta	ent
		□ 93/68/EEC Amendme	
	UL508 - CSA C22.2 n° 14		File E212533
		94-M91 / n° 0.17-00	File 210625


(1) Except for communication: 1 kVrms.
 (2) Except for communication: 1 kVrms.
 (3) Sepam must be stored in its original packing.
 (4) Iso > 0.1 Ino for the 50n/51n and 67n protection functions, with I0 calculated as the sum of the phase currents.

### **Base unit** Dimensions




Front view of Sepam.

### **Dimensions**




Side view of Sepam with MES120, flush-mounted in front panel with spring clips. Front panel: 1.5 mm (0.05 ln) to 6 mm (0.23 ln) thick.

Clearance for Sepam assembly and wiring.




A CAUTION HAZARD OF CUTS Trim the edges of the cut-out plates to remove any jagged edges.

Failure to follow this instruction can cause serious injury.



AMT880 mounting plate




Top view of Sepam with MES120, flush-mounted in front panel with spring clips. Front panel: 1.5 mm (0.05 ln) to 6 mm (0.23 ln) thick.

Assembly with AMT880 mounting plate

### mm in 214 *8.43* 141 5.55

Top view of Sepam with MES120, flush-mounted in front panel with spring clips. Mounting plate: 3 mm (0.11 ln) thick.

### **Base unit** Sepam series 80

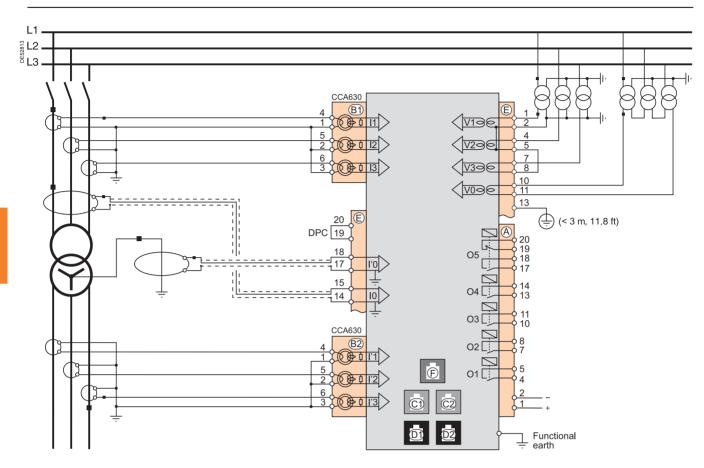

### Base unit Connection

Connector	Туре	Reference	Wiring
(A), (E)	Screw type	CCA620	<ul> <li>wiring with no fittings :         <ul> <li>1 wire with max. cross-section 0.2 to 2.5 mm² (≥ AWG 24-12) or 2 wires with max. cross-section 0.2 to 1 mm² (≥ AWG 24-16)</li> <li>stripped length: 8 to 10 mm</li> <li>wiring with fittings:</li> <li>recommended wiring with Telemecanique fittings:</li> <li>DZ5CE015D for 1 x 1.5 mm² wire (AWG 16)</li> <li>DZ5CE025D for 1 x 2.5 mm² wire (AWG 12)</li> <li>AZ5DE010D for 2 x 1 mm² wires (AWG 18)</li> <li>tube length: 8.2 mm (0.32 in)</li> <li>stripped length: 8 mm (0.31 in)</li> </ul> </li> </ul>
	6.35 mm ring lugs	CCA622	<ul> <li>6.35 mm ring or spade lugs (1/4")</li> <li>maximum wire cross-section of 0.2 to 2.5 mm² (≥ AWG 24-12)</li> <li>stripped length: 6 mm</li> <li>use an appropriate tool to crimp the lugs on the wires</li> <li>maximum of 2 ring or spade lugs per terminal</li> <li>tightening torque: 1.2 (13.27 lb-in)</li> </ul>
C1, C2	Green RJ45 plug		CCA612
(D1), (D2)	Black RJ45 plug		CCA770: L = 0.6 m (2 ft) CCA772: L = 2 m (6.6 ft) CCA774: L = 4 m (13.1 ft) CCA785 for MCS025 module: L = 2 m (6.6 ft)
Functional earth	Ring lug		Earthing braid, to be connected to cubicle grounding: ■ flat copper braid with cross-section ≥ 9 mm <sup>2</sup> ■ maximum length: 300 mm (11.8 in)
(B1), (B2)	4 mm ring lugs	CCA630, CCA634 for connection of 1 A or 5 A CTs	<ul> <li>wire cross-section 1.5 to 6 mm<sup>2</sup> (AWG 16-10)</li> <li>tightening torque: 1.2 Nm (13.27 lb-in)</li> </ul>
	RJ45 plug	CCA671, for connection of LPCT sensors	3 Integrated with LPCT sensor

### **Connection characteristics**

### 

### LOSS OF PROTECTION OR RISK OF NUISANCE TRIPPING

If the Sepam is no longer supplied with power or is in fail-safe position, the protection functions are no longer active and all the Sepam output relays are dropped out. Check that this operating mode and the watchdog relay wiring are compatible with your installation.


Failure to follow this instruction can result in equipment damage and unwanted shutdown of the electrical installation.

### 

#### HAZARD OF ELECTRIC SHOCK, ELECTRIC ARC OR BURNS

- Only qualified personnel should install this equipment. Such work should be performed and offer reading this action of instructions.
- performed only after reading this entire set of instructions.
- NEVER work alone.
- Turn off all power supplying this equipment before working on or inside it.
- Consider all sources of power, including the possibility of backfeeding.
- Always use a properly rated voltage sensing device to confirm that all power is off.
- Start by connecting the device to the protective earth and to the functional earth.
- Screw tight all terminals, even those not in use.
- Failure to follow these instructions will result in death or serious injury.

### **Base unit** Sepam B83

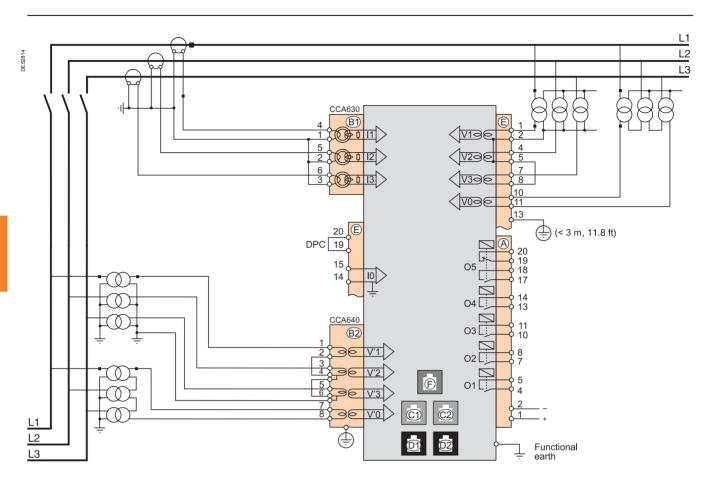

### **Connection characteristics**

Connector	Туре	Reference	Wiring
(B1)	4 mm ring lugs	CCA630, for connection of 1 A or 5 A CTs	1.5 to 6 mm <sup>2</sup> (AWG 16-10)
(B2)	Screw type	CCT640	VT wiring: same as wiring for the CCA620 Earthing connection: by 4 mm ring lug
For connectors A,	$\underline{E}, \underline{C1}, \underline{C2}, \underline{D1}, \underline{D2}, \underline{O}$ : see Pag	ge 127.	

### 

### LOSS OF PROTECTION OR RISK OF

NUISANCE TRIPPING If the Sepam is no longer supplied with power or is in fail-safe position, the protection functions are no longer active and all the Sepam output relays are dropped out. Check that this operating mode and the watchdog relay wiring are compatible with your installation.


Failure to follow this instruction can result in equipment damage and unwanted shutdown of the electrical installation.

### DANGER

- HAZARD OF ELECTRIC SHOCK, ELECTRIC ARC OR BURNS
- Only qualified personnel should install this equipment. Such work should be performed only after reading this entire set of instructions.
- NEVER work alone.
- Turn off all power supplying this equipment before working on or inside it.
- Consider all sources of power, including the possibility of backfeeding.
- Always use a properly rated voltage sensing device to confirm that all power is off.
- Start by connecting the device to the protective earth and to the functional earth.
- Screw tight all terminals, even those not in use.
- Failure to follow these instructions will result in death or serious injury.

Connection diagrams Sepam series 80

### Base unit Sepam C86

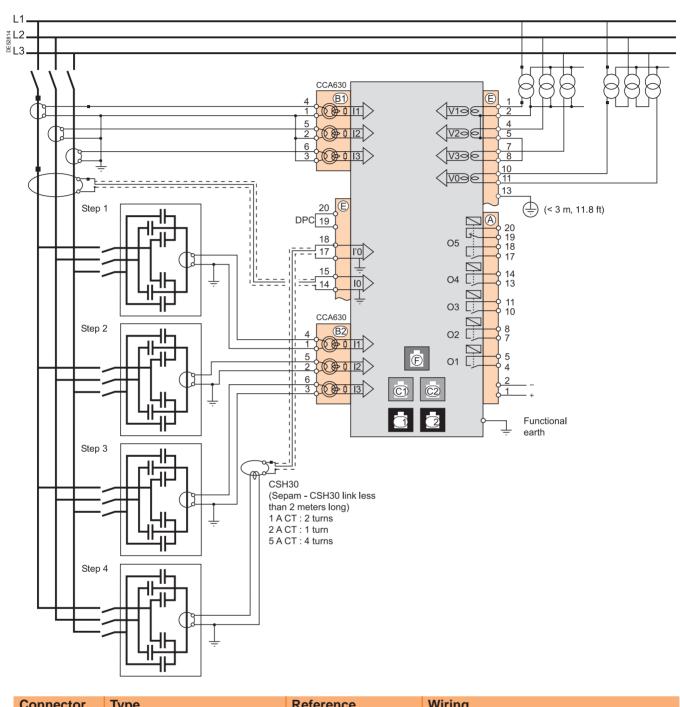


Connector	Туре	Reference	Wiring
(B1)	4 mm ring lugs	CCA630, for connection of 1 A or 5 A CTs	1.5 to 6 mm <sup>2</sup> (AWG 16-10)
	RJ45 plug	CCA671, for connection of 3 LPCT sensors	Integrated with LPCT sensor
<b>B</b> 2	4 mm ring lugs	CCA630, for connection of 1 A, 2A or 5 A CTs	1.5 to 6 mm <sup>2</sup> (AWG 16-10)
Functional earth	Ring lugs		Earthing braid, to be connected to cubicle grounding: ■ flat copper braid with cross-section ≥ 9 mm <sup>2</sup> ■ maximum length: 300 mm
For connectors		no 107	

3

### Base unit Phase current inputs

#### Variant 1: phase current measurement by 3 x 1 A or 5 A CTs (standard connection)




Connection of 3 x 1 A or 5 A sensors to the CCA630 connector.

The measurement of the 3 phase currents allows the calculation of residual current.

#### Parameters

T di diffeters		
Sensor type	5 A CT or 1 A CT	
Number of CTs	11, 12, 13	
Rated current (In)	1 A to 6250 A	

### Variant 2: phase current measurement by 2 x 1 A or 5 A CTs



Connection of 2 x 1 A or 5 A sensors to the CCA630 connector.


Measurement of phase 1 and 3 currents is sufficient for all protection functions based on phase current.

This arrangement does not allow the calculation of residual current, nor use of ANSI 87T and 87M differential protection functions on the Sepam T87, M87, M88, G87 and G88.

#### Parameters

Sensor type	5ACT or 1ACT	
Number of CTs	11, 13	
Rated current (In)	1 A to 6250 A	

#### Variant 3: phase current measurement by 3 LPCT type sensors



Connection of 3 Low Power Current Transducer (LPCT) type sensors to the CCA671 connector. It is necessary to connect 3 sensors; if only one or two sensors are connected, Sepam goes into fail-safe position.

Measurement of the 3 phase currents allows the calculation of residual current.

The In parameter, primary rated current measured by an LPCT, is to be chosen from the following values, in Amps: 25, 50, 100, 125, 133, 200, 250, 320, 400, 500, 630, 666, 1000, 1600, 2000, 3150.

Parameter to be set using the SFT2841 software tool, to be completed by hardware setting of the microswitches on the CCA671 connector.

- It is not possible to use LPCT sensors for the following measurements:
- phase-current measurements for Sepam T87, M88 and G88 with ANSI 87T

transformer differential protection (connectors B1 and B2)

- phase-current measurements for Sepam B83 (connector (B1))
- unbalance-current measurements for Sepam C86 (connector (B2)).

#### Parameters

Sensor type	LPCT	
Number of CTs	11, 12, 13	
Rated current (In)	25, 50, 100, 125, 133, 200, 250, 320, 400, 500, 630, 666, 1000, 1600, 2000 or 3150 A	

Note: Parameter In must be set twice:

- Software parameter setting using the advanced UMI or the SFT2841 software tool
- Hardware parameter setting using microswitches on the CCA671 connector

E52773

### Base unit Residual current inputs

#### Variant 1: residual current calculation by sum of 3 phase currents


#### Description

Residual current is calculated by the vector sum of the 3 phase currents I1, I2 and I3, measured by 3 x 1 A or 5 A CTs or by 3 LPCT type sensors. See current input connection diagrams.

#### Parameters

Residual current	rated residual current	Measuring range
Sum of 3 Is	In0 = In, CT primary current	0.01 to 40 In0 (minimum 0.1 A)

#### Variant 2: residual current measurement by CSH120 or CSH200 core balance CT (standard connection)




#### Description

Arrangement recommended for the protection of isolated or compensated neutral systems, in which very low fault currents need to be detected.

#### Parameters

Residual current	rated residual current	Measuring range
2 A rating CSH	In0 = 2 A	0.1 to 40 A
20 A rating CSH	In0 = 20 A	0.2 to 400 A

#### Variant 3: residual current measurement by 1 A or 5 A CTs and CCA634






Residual current measurment by 1 A or 5 A CTs

- Terminal 7: 1 A CT
- Terminal 8: 5 A CT


#### Parameters

Residual current	rated residual current	Measuring range
1 A CT	In0 = In, CT primary current	0.01 to 20 In0 (minimum 0.1 A)
5ACT	In0 = In, CT primary current	0.01 to 20 In0 (minimum 0.1 A)



### Base unit Residual current inputs

#### Variant 4: residual current measurement by 1 A or 5 A CTs and CSH30 interposing ring CT



#### Description


The CSH30 interposing ring CT is used to connect 1 A or 5 A CTs to Sepam to measure residual current:

CSH30 interposing ring CT connected to 1 A CT: make 2 turns through CSH primary


■ CSH30 interposing ring CT connected to 5 A CT: make 4 turns through CSH primary.

#### Parameters

Residual current	rated residual current	Measuring range
1 A CT	In0 = In, CT primary current	0.01 to 20 In0 (minimum 0.1 A)
5ACT	In0 = In, CT primary current	0.01 to 20 In0 (minimum 0.1 A)



#### Variant 5: residual current measurement by core balance CT with ratio of 1/n (n between 50 and 1500)



#### Description

The ACE990 is used as an interface between a MV core balance CT with a ratio of 1/n ( $50 \le n \le 1500$ ) and the Sepam residual current input. This arrangement allows the continued use of existing core balance CTs on the installation.

#### Parameters

i aramotoro		
Residual current	rated residual current	Measuring range
ACE990 - range 1 (0.00578 ≤ k ≤ 0.04)	In0 = Ik.n (1)	0.01 to 20 In0 (minimum 0.1 A)
ACE990 - range 2 (0.00578 ≤ k ≤ 0.26316)	In0 = Ik.n (1)	0.01 to 20 In0 (minimum 0.1 A)


(1) n = number of core balance CT turns

k = factor to be determined according to ACE990 wiring and setting range used by Sepam


### Connection diagrams Sepam series 80

### Phase voltage inputs Residual voltage input Main channels

### Variant 1: measurement of 3 phase-to-neutral voltages (3 V, standard connection)



### Phase voltage input connection variants Variant 2: measurement of 2 phase-to-phase voltages (2 U)

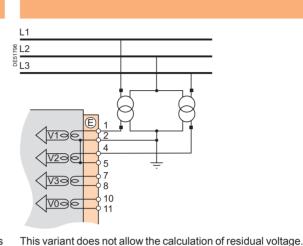


Measurement of the 3 phase-to-neutral voltages allows the calculation of residual voltage,  $V0\Sigma$ .


### 

This variant does not allow the calculation of residual voltage.

### Variant 5: measurement of residual voltage V0




### Variant 4: measurement of 1 phase-to-neutral voltage (1 V)



This variant does not allow the calculation of residual voltage.

### **Residual voltage input connection variants**

Variant 6: measurement of residual voltage Vnt in generator neutral point




### Phase voltage inputs Residual voltage input Additional channels for Sepam B83

## Additional phase voltage input connection variants


Variant 2: measurement of 2 phase-to-phase voltages (2 U')

Variant 1: measurement of 3 phase-to-neutral voltages (3 V', standard connection)




Measurement of the 3 phase-to-neutral voltages allows the calculation of residual voltage, V'0 $\Sigma$ .

### Variant 3: measurement of 1 phase-to-phase voltage (1 U')




This variant does not allow the calculation of residual voltage.




This variant does not allow the calculation of residual voltage.


### Variant 4: measurement of 1 phase-to-neutral voltage (1 V')



This variant does not allow the calculation of residual voltage.

### Additional residual voltage input connection






### Connection diagrams Sepam series 80

### Phase voltage inputs Additional channel for Sepam B80


## Connection to measure one additional voltage

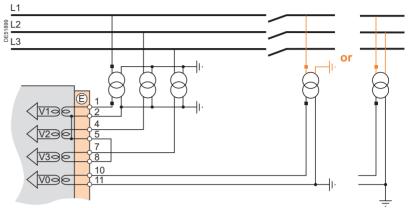

This connection should be used to measure:

■ three phase-to-neutral voltages V1, V2, V3 on busbars no. 1

■ one additional phase-to-neutral voltage V'1 (or one additional phase-to-phase voltage U'21) on busbars no. 2.

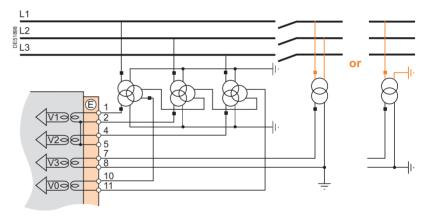

This connection should be used to measure:

■ two phase-to-phase voltages U21, U32 and one residual voltage V0 on busbars no. 1

■ one additional phase-to-phase voltage U'21 (or one additional phase-to-neutral voltage V'1) on busbars no. 2.

### Phase voltage inputs **Residual voltage input** Available functions

The availability of certain protection and metering functions depend on the phase and residual voltages measured by Sepam.

The table below gives the voltage input connection variants for which for each protection and metering function dependent on measured voltages is available. Example:

The directional overcurrent protection function (ANSI 67N/67NC) uses residual voltage V0 as a polarization value.

It is therefore operational in the following cases:

measurement of the 3 phase-to-neutral voltages and calculation of

 $V0\Sigma (3 V + V0\Sigma, variant 1)$ 

measurement of residual voltage V0 (variant 5).

The protection and metering functions which do not appear in the table below are available regardless of the voltages measured.

Phase voltages measured		<b>3 V + V0</b> Σ		2 U				1 U		1 V					
(connection variant)				(var. 1)			(var. 2)		1	(var. 3)			(var. 4)		
Residual voltage measured		_	VO	Vnt	_	V0	Vnt	-	VO	Vnt	_	VO	Vnt		
(connection variant)			(v. 5)			(v. 5)	(v. 6)		(v. 5)	(v. 6)		(v. 5)			
Protection functions dependent on voltag	es measured		(	(		(	()		(	(		(	(		
Directional phase overcurrent	67									1					
Directional earth fault	67N/67NC														
Directional active overpower	32P														
Directional reactive active overpower	32Q														
Directional active underpower	37P		•												
Field loss (underimpedance)	40														
Pole slip, phase shift	78PS														
Voltage-restrained overcurrent	50V/51V														
Underimpedance	21B														
Inadvertent energization	50/27														
100 % stator earth fault	64G2/27TN			•											
Overfluxing (V/Hz)	24									•	•				
Positive sequence undervoltage	27D														
Remanent undervoltage	27R							∎□Ø		•	∎□∅		•		
Undervoltage (L-L or L-N)	27							∎□∅			∎□∅				
Overvoltage (L-L or L-N)	59							∎□∅			∎□∅				
Neutral voltage displacement	59N														
Negative sequence overvoltage	47														
Overfrequency	81H							∎□∅			∎□∅				
Underfrequency	81L							∎□∅			∎□∅				
Rate of change of frequency	81R			-											
Measurements dependent on voltages me	asured														
Phase-to-phase voltage U21, U32, U13 or U'2	1, U'32, U'13							U21, U'21	U21	U21					
Phase-to-neutral voltage V1, V2, V3 or V'1, V'2	2, V'3			-							V1, V'1	V1, V'1	V1		
Residual voltage V0 or V'0															
Neutral point voltage Vnt															
Third harmonic neutral point or residual voltage	e														
Positive sequence voltage Vd or V'd / negative sequence voltage Vi or V'i				•											
Frequency								∎□Ø			∎□∅				
Active / reactive / apparent power: P, Q, S															
Peak demand power PM, QM										•					
Active / reactive / apparent power per phase : P1/P2/P3, Q1/Q2/Q3, S1/S2/S3		■ <sup>(1)</sup>	<b>(</b> 1)	<b>(</b> 1)		<b>(</b> 1)					P1/ Q1/S1	P1/ Q1/S1	P1/ Q1/S1		
Power factor		•						•		•					
Calculated active and reactive energy (±Wh, ±	VARh)														
Total harmonic distortion, voltage Uthd															
Phase displacement φ0, φ'0															
Phase displacement φ1, φ2, φ3															
Apparent positive sequence impedance Zd															
Apparent phase-to-phase impedances Z21, Z3	32, Z13	•													
Eunction available on main voltage channels															

Function available on main voltage channels.

□ Function available on Sepam B83 additional voltage channels. □ Function available on Sepam B80 additional voltage channel, according to the type of the additional voltage measured.

(1) If all three phase currents are measured.

### Guiding

**TOOLS** 

### merlin-gerin.com

This international site allows you to access all the Merlin Gerin products in just 2 clicks via comprehensive range data-sheets, with direct links to:

■ complete library: technical documents, catalogs, FAQs, brochures...

 selection guides from the e-catalog.
 product discovery

sites and their Flash animations.

You will also find illustrated overviews, news to which you can subscribe, the list of country contacts...



## The electrical installation guide

#### According to IEC 60364

This guide, part of the Guiding System, is the essential tool to "guide" you any time in your business: design office,

consultant

- contractor, panelbuilder
- teacher, trainer.

#### Comprehensive and concrete information on:

all the new technical solutions

all the components of an installation from a global point of view

all the IEC standards modifications

all the fundamental electrotechnical knowledge

 all the design stages, from medium to low voltage.



Ċ

Sepam series 20 Sepam series 40 Sepam series 80

## Additional modules and accessories

Introduction	7
Sepam series 20 and Sepam series 40	47
Sepam series 80	85
Software	141
Sepam software	141
SFT2841 setting and operating software	142
Function	142
SFT2841 connection to Sepam Adaptation of the predefined functions	144 145
SFT2826 disturbance recording data display software	146
SFT850 configuration software for IEC 61850 protocol	147
SFT2885 programming software - Logipam	148
SP 12005 programming Software - Logipan	140
Logic input / output modules	150
MES114 modules	150
Logic input / output assignment of Sepam series 20	152
Logic input / output assignment of Sepam series 40	153
MES120, MES120G, MES120H14 input / 6 output module	154
Presentation	154
Installation Logic input / output assignment	155 156
Remote modules	158
Selection guide and connection	158
MET148-2 Temperature sensor module	159
MSA141 Analog output module	161
DSM303 Remote advanced UMI module	162
MCS025Synchro-check module	164
Other modules	168
Sepam 100 LD	168
Presentation	168
High impedance differential protection	169
Sensors and surge limiters Description and connection	170 171
Characteristics and dimensions	173
Sepam 100 MI	174
Presentation	174
Block and connection diagrams Characteristics and dimensions	175 178
	170

Sepam series 20 Sepam series 40 Sepam series 80

## Additional modules and accessories

Communication accessories	179
Selection guide	179
Communication interfaces	180
Communication interface connection	180
ACE949-2 2-wire RS 485 network interface	181
ACE9594-wire RS 485 network interface	182
ACE937 Fiber optic interface	183
ACE969TP and ACE969FO Interfaces network Description Connection	<b>184</b> 186 187
Converters	189
ACE909-2RS 232 / RS 485 converter	189
ACE919CA and ACE919CC RS 485 / RS 485 converters	191
Sepam ECI850 server for IEC 61850	193
Ethernet EGX100 gateway	197
Ethernet EGX400 server	198
WPG software tool HTML page generator	201
Sensors	202
Selection guide	202
Voltage transformers	203
1 A / 5 A current transformers	204
LPCT type current sensors Test accessories	<b>207</b> 208
CSH120 and CSH200 Core balance CTs	210
CSH30 Interposing ring CT	212
ACE990 Core balance CT interface	213
Order form	217

### Sepam software

### Presentation

Three types of Sepam PC software are available:

- SFT2841 setting and operating software
- SFT2826 disturbance recording data display software
- SFT2885 programming software for the Sepam series 80 (Logipam)
- SFT850 advanced-configuration software for IEC 61850 protocol.

#### SFT2841 and SFT2826 software

SFT2841 and SFT2826 software is provided on the same CD-ROM as the Sepam documentation in PDF format.

#### PC connection cord

The CCA783 PC connection cord, to be ordered separately, is designed to connect a PC to the RS 232 port on the front panel of a Sepam unit in order to use the SFT2841 software in point-to-point connected mode.

The USB/RS232 TSXCUSB232 converter may be used with the CCA783 connection cord for connection to a USB port.

#### SFT2885 software

SFT2885 is available on a separate CD-ROM.

#### SFT850 software

SFT850 is available on a separate CD-ROM.

### Minimum configuration required

SF12041 and SF12020 \$	sonware
Operating systems	Microsoft 2000/XP
RAM	128 MB (32 MB for Windows 98)
Space on disk	120 MB

SFT2885	
Operating systems	Microsoft 2000/XP
RAM	64 MB
Space on disk	20 MB

### SFT850

••••••	
Operating systems	Microsoft 2000/XP
RAM	64 MB
Space on disk	40 MB

### **SFT2841 setting and operating software** Function

The SFT2841 software is the setting and operating tool for Sepam series 20, Sepam series 40 and Sepam series 80.

- It may be used:
- prior to commissioning and without connection to Sepam, to prepare Sepam protection and parameter settings
- during commissioning, on a PC connected point-to-point to the front panel Sepam:
- □ to load, unload and modify Sepam protection and parameter settings
- □ to obtain all measurements and useful information during commissioning
- during operation, on a PC connected to a set of Sepam relays via an E-LAN
- multipoint communication network:
- to manage the protection system
- □ to monitor the status of the electrical network
- $\hfill\square$  to run diagnostics on any incidents affecting the electrical network.

### Preparation of Sepam parameter and protection settings in unconnected mode

- configuration of Sepam and optional modules, and entry of general settings
- enabling/disabling of functions and entry of protection settings
- adaptation of predefined control and monitoring functions
- creation of personalized mimic diagrams for local display.

### Sepam commissioning via a point-to-point connection to the front panel

- access to all functions available in unconnected mode, after entering the protection-setting or parameter-setting password
- transfer of Sepam parameter and protection setting file, prepared in unconnected
- mode (downloading function), protected by the parameter-setting password display of all measurements and useful information during commissioning
- display of logic input, logic output and LED status
- test of logic outputs
- display of Logipam variables
- setting of Logipam parameters (configuration bits, timers, etc.)
- modification of passwords.


### Management of protection functions and network diagnostics with an E-LAN multipoint network connection

■ reading of all Sepam protection and parameter settings, modifications following


- entry of the protection-setting or parameter-setting password
- display of all the Sepam measurement data
- display of Sepam, switchgear and network diagnosis data
- display of time-tagged alarm messages
- retrieval of disturbance recording data.

#### Efficient, easy-to-use software


- menus and icons for fast, direct access to the data required
- guided navigation to go through all the data input screens in the natural order
- all data on the same function together in the same screen
- trilingual software: English, French, Spanish
- on-line help, with all the technical information needed to use
- and implement Sepam
- familiar file management in Microsoft Windows environment:
- □ all file management services included: copy / paste, save, etc.
- □ printing of parameter and protection settings in standard layout.



SFT2841: Sepam series 80 hardware configuration



SFT2841: output testing




SFT2841: alarm history

e Merlin Gerir


142

### Software


# SFT2841 setting and operating software Function




SFT2841: Sepam series 80 sensor parameter setting.



SFT2841: Sepam series 80 application, with protection function measurement origin.



SFT2841: protection settings.



SFT2841: Sepam diagnosis.

The table below gives the SFT2841 functions available for each of the 3 Sepam series: Sepam series 20, Sepam series 40 and Sepam series 80. **NC:** *function available in unconnected mode.* 

S: function available with SFT2841 connected via Sepam front panel.

E: function available with SFT2841 connected to Sepam via E-LAN communication network.


Functions	Se	ries	20	Se	ries	40	Series		
Management									
On-line help									
Management of parameter and protection setting files: creation, saving, downloading and uploading	•	•		•	•	•	•	•	I
Downloading and uploading of parameter and protection setting files			•			(1)			
Exporting of parameter and protection settings in a text file	•			•					
Printing of parameter and protection settings				•					
Modification of passwords, one for parameter setting and one for protection setting			•			•			
Sepam parameter setting									
Display of parameter settings				•					Τ
Hardware configuration and parameter entry protected by parameter setting password	•		•	•		•	•		T
Graphical parameter setting assistance									Γ
Standard configuration for IEC 61850 network				•					
Protection setting									
Display of protection settings				•					
Entry of protection settings, protected by protection setting password				•					
Definition of customized tripping curve									
Adaptation of the predefined function	S								
Display and modification of the control matrix									
Logic equation editing									
Number of instructions				100			200		
Number of dedicated remote indications				10	1	1	20	1	_
Display of logic equations									
Load the Logipam program							•		
Setting of Logipam parameters									
Assignment of LEDs on front				•					
Editing of user messages									
Number of user messages				30			100	1	
Editing of personalized mimic diagram									
Assistance in commissioning and op	erati	ng th	e ins	stalla	tion				
Display of all the Sepam measurement data									
Display of switchgear diagnosis assistance data									
Display of machine operating assistance data									
Display of time-tagged alarm messages									
Tripping context									Γ
Retrieval of disturbance recording files			•			•		•	
Display of Logipam variables									
Display of logic input/output status									
Output testing									
Sepam diagnosis									

(1) Except for logic equations and personalized messages.

# SFT2841 setting and operating software SFT2841 connection to Sepam


#### SFT2841 connection to the front panel of a Sepam

Connection of the PC RS232 serial port to the communication port on the front panel of Sepam series 20, Sepam series 40 or Sepam series 80 using the CCA783 cord or the USB/RS232 (TSXCUSB232) converter + CCA783.



#### SFT2841 connection to a set of Sepam relays

The SFT2841 can be connected to a set of Sepam relays, themselves connected to a E-LAN communication network in one of the three architectures presented below. These connections do not require any further software development work.

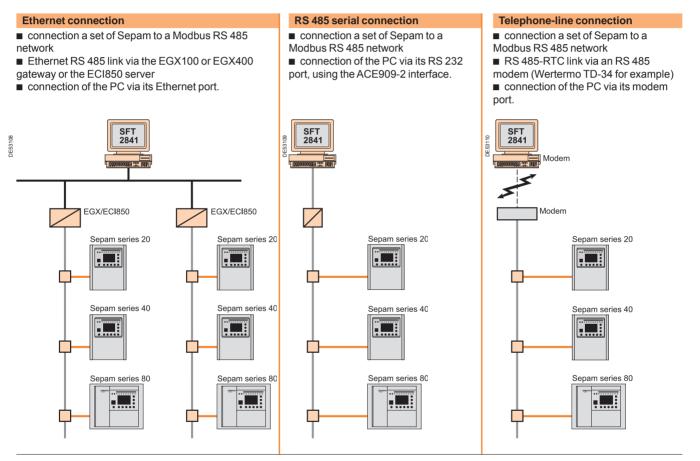

# Software

# SFT2841 setting and operating software Adaptation of the predefined functions

BB DA SOR DER0277 Deate Debte Set Ln 1, Col PE0.51 1 1 444 AND OR XOR NOT // . [] + .

SFT2841: logic equation editor.

# □ etc

#### Logic equation editor (Sepam series 40 and series 80)

The logic equation editor included in the SFT2841 software can be used to:

- complete protection function processing:
- □ additional interlocking
- □ conditional inhibition/validation of functions

adapt predefined control functions: particular circuit breaker or recloser control sequences, etc.

Note that the use of the logic equation editor excludes the possibility of using the Logipam programming software.

A logic equation is created by grouping logic input data received from:

- protection functions
- logic inputs
- Iocal control orders transmitted by the mimic-based UMI
- remote control orders

using the Boolean operators AND, OR, XOR, NOT, and automation functions such as time delays, bistables and time programmer.

Equation input is assisted and syntax checking is done systematically.

The result of an equation may then be:

- assigned to a logic output, LED or message from the control matrix
- transmitted by the communication link, as a new remote indication
- utilized by the circuit breaker/contactor control function to trip, close or inhibit breaking device closing
- used to inhibit or reset a protection function.

#### Alarms and operating messages (Sepam series 40 and series 80)

New alarm and operating messages may be created using the SFT2841 software. The new messages are added to the list of existing messages and may be assigned via the control matrix for display:

- on Sepam's advanced UMI
- in the SFT2841 "Alarms" and "Alarm History" screens.

#### Local-control mimic diagram (Sepam series 80)

The local-control mimic diagram displayed on the UMI can be personalized by adapting one of the supplied, predefined mimic diagrams or by creating a diagram from scratch

The mimic-diagram editor can be used to:

create a fixed, bitmap background (128 x 240 pixels) using a standard drawing tool create animated symbols or use predefined animated symbols to represent the electrotechnical devices or other objects


assign the logic inputs or internal status conditions that modify the animated

symbols. For example, the logic inputs for the circuit-breaker position must be linked to the circuit-breaker symbol to enable the display of the open and closed conditions


assign the logic outputs or internal status conditions that are activated when an

opening or closing order are issued for the symbol

display the current, voltage and power measurements on the mimic diagram.



SFT2841: mimic-diagram editor.




SFT2841: control matrix.

#### **Control matrix**

The control matrix is used for simple assignment of data from:

- protection functions
- control and monitoring functions
- logic inputs
- logic equations or the Logipam program
- to the following output data:
- Ioaic outputs
- 9 LEDs on the front of Sepam
- messages for local display
- triggering of disturbance recording.

# SFT2826 disturbance recording data display software



SFT2826: analysis of a disturbance data record.

# **Function**

The SFT2826 software is used to display, analyze and print disturbance data recorded by Sepam.

It uses COMTRADE (IEEE standard: Common format for transient data exchange for power systems) files.

#### Transfer of disturbance recording data

Before they are analyzed by SFT2826, the disturbance recording data must be transferred from Sepam to the PC:

- by the SFT2841 software
- or by the Modbus communication link.

#### Analysis of disturbance recording data

- selection of analog signals and logic data for display
- zoom and measurement of time between events
- display of all numerical values recorded
- exporting of data in file format
- printing of curves and/or numerical values recorded.

# **Characteristics**

- The SFT2826 software comes with the SFT2841 software:
- 4 languages: English, French, Spanish, Italian
- on-line help with description of software functions.

# SFT850 configuration software for IEC 61850 protocol

# Function

The SFT850 software is used to easily create, modify and consult the SCL (Substation Configuration Language) configuration files for the IEC 61850 communication protocol:

 CID (Configured IED description) file for configuration of a device connected to an IEC 61850 network

 SCD (Substation Configuration Description) file for IEC 61850 configuration of substation equipment.

The SFT850 software supplements the standard IEC 61850 configuration created with the SFT2841 software in cases where the configuration must be precisely adapted to system requirements.

#### Adding or deleting equipment

The SFT850 software can be used to add or delete connected equipment in the IEC 61850 configuration. If a Sepam unit is added, the software uses the supplied ICD (IED capability description) file to start configuration.

#### **Equipment connection**

The SFT850 software describes the data for equipment connection to the network.

#### Editing the equipment configuration

The configuration of a given device described in a CID or SCD file can be modified: add, modify or delete datasets. A dataset is used to group data and optimise communication

add, modify or delete RCBs (Report Control Block). A Report Control Block defines dataset transmission conditions

add, modify or delete GCBs (Goose Control Block). A Goose Control Block defines how data is exchanged between Sepam units

modify dead measurement bands. This parameter is used to optimise communication in that measurements are transmitted only if they have changed significantly.

#### **Generating CID files**

The SFT850 software can generate the CID file for each device on the basis of an SCD file.

# SFT2885 programming software - Logipam

# Function

The SFT2885 programming software (called Logipam) is intended exclusively for the Sepam series 80 and can be used to:

adapt predefined control and monitoring functions

• program specific control and monitoring functions, either to replace the predefined versions or to create completely new functions, to provide all the functions required by the application.

It is made up of:

■ a ladder-language program editor used to address all Sepam data and to program complex control functions

- a simulator for complete program debugging
- a code generator to run the program on Sepam.

The ladder-language program and the data used can be documented and a complete file can be printed.

# Only the Sepam series 80 with a cartridge containing the Logipam SFT080 option can run the control and monitoring functions programmed by the Logipam SFT2885 software.


The complete Logipam software is made up of the executable program run by Sepam and the source program that can be modified by the Logipam SFT2885 programming software.

The SFT2841 setting and operating software, required for implementation of the Logipam program, offers the following functions:

 association of the complete Logipam program with the Sepam parameter and protection settings


■ loading and unloading of Logipam program, parameters and settings in the Sepam cartridge

- running of the functions programmed with Logipam:
- □ display of the status of Logipam internal bits
- □ setting of Logipam parameters: configuration bits, timers, etc.

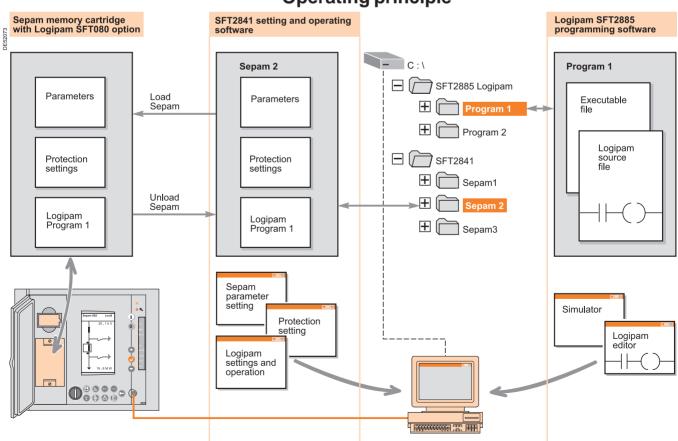

# Operating principle

# SFT2885 programming software - Logipam



# Characteristics

#### Program structure

- A ladder-language program is made up of a series of rungs executed sequentially:
- maximum 1000 lines with 9 contacts and 1 coil maximum per line
- with a maximum total number of 5000 contacts and coils.
- Comments may be made for each line.

#### Sections

The program can be broken down into sections and subsections to clarify the structure and facilitate reading. It is possible to set up three levels of sections. Comments may be added for each section.

Execution of each section can be subjected to conditions.

#### Variable editor

Each variable is defined by an invariable identifier and can be linked to a name or a comment.

The programmer can decide to work directly with the identifiers or with the linked names.

The list of the variables used and the cross references may be consulted during programming.

### Graphic elements in the ladder language

The graphic elements are the instructions in the ladder language:

- NO and NC contacts
- rising and falling-edge detection contacts
- direct or negated coils
- set and reset coils
- coils and contacts linked to timers, counters and clocks.

#### Available resources

#### Sepam variables

All the data used by Sepam functions can be addressed by Logipam:

all logic inputs and outputs

all remote-control orders and remote indications

(the remote-control orders and remote indication used in the Logipam program are no longer used by the predefined functions)

- all protection-function inputs and outputs
- all inputs and outputs for the predefined control and monitoring functions
- all inputs and outputs for symbols in the mimic-based UMI
- all system data.

#### Logipam internal variables

64 configuration bits to parameter program processing, settable via the SFT2841 software and the display

- 128 bits used by the control matrix to control LEDs, messages and logic outputs
- 128 internal bits that are saved
- 512 internal bits that are not saved.

#### Logipam functions

- 60 timers that can be set for a rising edge (TON) or a falling edge (TOF)
- 24 incremental counters with adjustable thresholds
- 4 clocks for a given week.

#### **Debugging tools**

The Logipam software offers a complete set of tools for program debugging:

step-by-step or continuous program execution to simulate the programmed functions

- color animation of the rungs and all program variables
- grouping in a table of all program variables requiring monitoring.

#### **Documentation**


The application file can be printed in part or in whole.

The application file can be personalized : front page, title block, general description of the program, etc.





SFT2885: variable editor.



SFT2885: program debugging.

# Logic input / output modules

# **MES114** modules



10 input/4 output MES114 module.

# **Function**

The 4 outputs included on the Sepam series 20 and 40 may be extended by adding an optional MES114 module with 10 inputs and 4 outputs, available in 3 versions:

- MES114: 10 DC inputs voltage from from 24 V DC to 250 V DC
   MES114E: 10 inputs, voltage 110-125 V AC or V DC
- MES114F: 10 inputs, voltage 220-250 V AC or V DC.

#### **Characteristics** MEDAAA

MES11	4 modu	le				
Weight		0.28 kg (0.6	617 lb)			
Operating temperatur	e	-25 °C to +70	) °C (-13 °Fto	+158 °F)		
Environme characteris		Same charac	cteristics as S	Sepam base	units	
Logica	l inputs	<b>MES114</b>	<b>MES114</b>	E	<b>MES114</b>	F
Voltage		24 to 250 V DC	110 to 125 V DC	110 V AC	220 to 250 V DC	220 to 240 V AC
Range		19.2 to 275 V DC	88 to 150 VV DC	88 to 132 V AC	176 to 275 V DC	176 to 264 V AC
Frequency		/	/	47 to 63 Hz	: /	47 to 63 Hz
Typical con	sumption	3 mA	3 mA	3 mA	3 mA	3 mA
Typical swith threshold	tching	14 V DC	82 V DC	58 V AC	154 V DC	120 V AC
Input limit	At state 0	≥ 19 V DC	≥ 88 V DC	≥88 V AC	≥176 V DC	≥ 176 V AC
voltage	At state 1	≤6 V DC	≤ 75 V DC	≤22 V AC	≤ 137 V DC	≤48 V AC
Isolation of other isolat	inputs from ed groups	Enhanced	Enhanced	Enhanced	Enhanced	Enhanced
Isolation be inputs	etween	Enhanced	Enhanced	Enhanced	Enhanced	Enhanced


#### O11 control relay output

Voltage	DC	24 / 48 V D0	C 127 V DC	220 V DC	250 V CC	
	AC (47.5 to 63 Hz)	-	-	-	-	100 to 240 V AC
Continuous current		8 A	8A	8 A	8 A	8 A
Breaking capacity	Resistive load	8/4A	0.7 A	0.3 A	0.2 A	8 A
	Load L/R < 20 ms	6/2A	0.5 A	0.2 A	-	-
	Load L/R < 40 ms	4/1A	0.2 A	0.1 A	-	-
	Load cos φ >0.3	-	-	-	-	5A
Making capacity		< 15 A for 20	00 ms			
Isolation of outputs from other isolated groups	Enhanced					
Isolation between outputs	Enhanced					
012 to 014 in	dication r	elay out	put			
Voltage	DC	24 / 48 V D0	C 127 V DC	220 V DC	250 V DC	
	AC (47.5 to 63 Hz)	-	-	-	-	100 to 240 V AC
Continuous current		2 A	2A	2A	2A	2A
Breaking capacity	Resistive	2/1A	0.6 A	0.3 A	0.2 A	-

Breaking capacity	Resistive load	2/1A	0.6 A	0.3 A	0.2 A	-
	Load L/R < 20 ms	2/1A	0.5 A	0.15 A	-	-
	Load cos φ >0.3	-	-	-	-	1A
Making capacity		< 15 A for	200 ms			
Isolation of outputs in relation to other isolated groups	Enhanced					
Isolation between outputs	Enhanced					

# Logic input / output modules

# **MES114 modules**

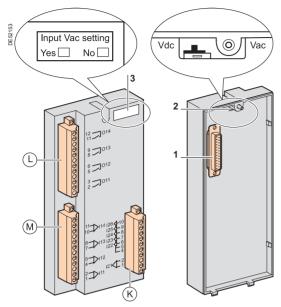

## Description

- (L), (M) and (K) : 3 removable, lockable screw-type connectors
- (L): connectors for 4 relay outputs:
- O11: 1 control relay output
- O12 to O14: 3 annunciation relay outputs
- M : connectors for 4 independent logic inputs I11 to I14
- (K): connectors for 6 logic inputs:
- I21: 1 independent logic input
- I22 to I26: 5 common point logic inputs.
- 1 25-pin sub-D connector to connect the module to the base unit.
- 2 Voltage selector switch for MES114E and MES114F module inputs, to be set to:
- V DC for 10 DC voltage inputs (default setting)
- VAC for 10 AC voltage inputs.

 ${\bf 3}$  Label to be filled in to indicate the chosen parameter setting for MES114E and MES114F input voltages.


The parameter setting status can be accessed in the "Sepam Diagnosis" screen of the SFT2841 software tool.

Parameter setting of the inputs for AC voltage (V AC setting) inhibits the "operating time measurement" function.



# Assembly

- 1. Insert the 2 pins on the MES module into the slots 1 on the base unit.
- 2. Flatten the module up against the base unit to plug it into the connector **2**.
- 3. Tighten the mounting screw 3.

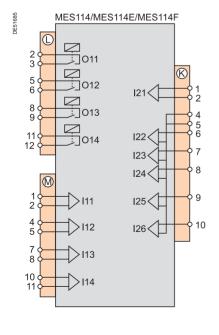

## Connection

The inputs are potential-free and the DC power supply source is external.



#### HAZARD OF ELECTRIC SHOCK, ELECTRIC ARC OR BURNS

• Only qualified personnel should install this equipment. Such work should be performed only after reading this entire set of instructions and checking the technical characteristics of the device.

- NEVER work alone.
- Turn off all power supplying this equipment before working on or inside it.
- Consider all sources of power, including the possibility of backfeeding.
- Always use a properly rated voltage sensing device to confirm that all power is off.
- Screw tight all terminals, even those not in use.

Failure to follow these instructions will result in death or serious injury.

Wiring of connectors (L), (M) and (K) :

- Wiring with no fittings:
- □ 1 wire with maximum cross-section 0.2 to 2.5 mm<sup>2</sup> (AWG 24-12)
- $\hfill\square$  or 2 wires with maximum cross-section 0.2 to 1 mm² (AWG 24-18)
- □ stripped length: 8 to 10 mm (0.315 to 0.39 in)
- Wiring with fittings:
- □ terminal 5, recommended wiring with Telemecanique fitting:
- DZ5CE015D for 1 wire 1.5 mm<sup>2</sup> (AWG 16)
- DZ5CE025D for 1 wire 2.5 mm<sup>2</sup> (AWG 12)
- AZ5DE010D for 2 wires 1 mm<sup>2</sup> (AWG 18)
- $\Box$  tube length: 8.2 mm (0.32 in)
- □ stripped length: 8 mm (0.31 in).

# Logic input / output assignment of Sepam series 20

The use of the preset control and monitoring functions requires exclusive parameter setting and particular wiring of the inputs according to their application and the type of Sepam.

The advanced UMI or the SFT2841 software may be used to assign inputs and set the control and monitoring function parameters.

Since an input may only be assigned to a single function, not all the functions are available at the same time.

Example: if the logic discrimination function is used, the switching of groups of settings function may not be used.

Functions	S20	S23	T20	T23	M20	B21 - B22	Assignment
Logic inputs							
Open position	=	•	•	•		•	111
Closed position	•	•	•				l12
Logic discrimination, receive blocking input	•		•				I13
Switching of groups of settings A/B	-						
External reset	•	•	•				114
External tripping 4 <sup>(1)</sup>	-			•	•	•	
External tripping 1 <sup>(1)</sup>	•	•	<b>(</b> 2)	(2)		•	121
External network synchronization	-				•	•	
External tripping 2 <sup>(1)</sup>	•		<b>(</b> 3)	<b>(</b> 3)			122
Motor re-acceleration					•		
External tripping 3 <sup>(1)</sup>	•		<b>(</b> 4)	<b>(</b> 4)		•	123
Buchholz alarm <sup>(1)</sup> (Buchholz alarm message)							
Rotor rotation detection					•		
Thermistor tripping <sup>(1)</sup>				•	•		
Inhibit earth fault protection		•					
End of charging position	•	•	-	•			124
Thermostat alarm <sup>(1)</sup> (thermostat alarm message)			•	•			
Thermistor alarm <sup>(1)</sup>			-	•	•		
External tripping 5 and 50BF activation (1)							
Inhibit remote control, excluding TC1 <sup>(1)</sup>	•	•	-	•	•	•	125
Inhibit remote control, including TC1 <sup>(1)</sup>	-	•	•	•	•	•	
SF6-1			•				
SF6-2	•	•	•	•	•	•	126
Change of thermal settings			-	•	•		
Inhibit thermal overload			•	•			
Inhibit recloser	=	•					
Logic outputs							
Tripping	•						01
Inhibit closing							O2
Watchdog	•						04
Close order		•	•				011

#### Table of input/output assignment by application

Note: all of the logic inputs are available via the communication link and are accessible in the SFT2841 control matrix for other non predefined applications.

(1) These inputs have parameter setting with the prefix "NEG" for undervoltage type operation.

(2) Buchholz/Gas trip message.

(3) Thermostat trip message.

(4) Pressure trip message.

# Logic input / output assignment of Sepam series 40

Inputs and outputs may be assigned to predefined control and monitoring functions using the SFT2841 software, according to the uses listed in the table below. ■ all the logic inputs, whether or not assigned to predefined functions, may be used for the SFT2841 customization functions according to specific application needs: □ in the control matrix, to link inputs to output relays, LED indications or display messages

in the logic equation editor, as logic equation variables

the control logic of each input may be inverted for undervoltage type operation.

Functions	S40, S41	S42	T40, T42	M41	G40	Assignment
Logic inputs			/			
Open position						111
Closed position						112
Logic discrimination, receive blocking input 1						Free
Logic discrimination, receive blocking input 2	-					Free
Switching of groups of settings A/B						113
External reset						Free
External tripping 1	•					Free
External tripping 2						Free
External tripping 3						Free
Buchholz/gas tripping						Free
Thermostat tripping						Free
Pressure tripping		1				Free
Thermistor tripping						Free
Buchholz/gas alarm						Free
Thermostat alarm	-					Free
Pressure alarm	-					Free
Thermistor alarm						Free
End of charging position	•					Free
Inhibit remote control	•	•				Free
SF6	•		•		•	Free
nhibit recloser	•					Free
External synchronization	•	•		•		121
nhibit thermal overload			•		•	Free
Switching of thermal settings				•		Free
Motor re-acceleration				•		Free
Rotor rotation detection				•		Free
Inhibit undercurrent				•		Free
Inhibit closing	•	•		•		Free
Open order	•		•		•	Free
Close order	•		•		•	Free
Phase voltage transformer fuse melting	•		•		•	Free
Residual voltage transformer fuse melting	•		•		•	Free
External positive active energy counter	•		•		•	Free
External negative active energy counter	•		•		•	Free
External positive reactive energy counter	•	•	•		•	Free
External negative reactive energy counter	•	•	•		•	Free
Logic outputs						
Tripping		•			-	01
Inhibit closing	•	•	•		•	02
Watchdog	•	•	•		•	O4
Close order	•	•				O11

Note: all of the logic inputs are available via the communication link and are accessible in the SFT2841 matrix for other non predefined applications.

# Logic input / output modules

# MES120, MES120G, MES120H 14 input / 6 output module Presentation



## **Function**

The 5 output relays included on the Sepam series 80 base unit may be extended by adding 1, 2 or 3 MES120 modules with 14 DC logic inputs and 6 outputs relays, 1 control relay output and 5 indication relay outputs.

Two modules are available for the different input supply voltage ranges and offer different switching thresholds:

■ MES120, 14 inputs 24 V DC to 250 V DC with a typical switching threshold of 14 V DC

■ MES120G, 14 inputs 220 V DC to 250 V DC with a typical switching threshold of 155 V DC

MES120H, 14 inputs 110 V DC to 125 V DC with a typical switching threshold of 82 V DC.

# **Characteristics**


#### MES120 14 input / 6 output module.

MEGADO / MEGADOC / MEGADOLL

G/MES120H modules					
	0,38 kg (0,83 lb)				
	-25 °C to +70 °C (	-13 °F to +158 °F	=)		
S	Same characteris	tics as Sepam ba	ase units		
	<b>MES120</b>	MES	120G	MES120H	
	24 à 250 V DC	220 to 2	250 V DC	110 to 125 V DC	
	19.2 à 275 V DC	170 to 2	275 V DC	88 to 150 V DC	
	3 mA	3 mA		3 mA	
	14 V DC	155 V D	C	82 V DC	
At state 0	< 6 V DC	< 144 V	DC	< 75 V DC	
At state 1	> 19 V DC	> 170 V	DC	> 88 V DC	
isolated groups	Enhanced	Enhanc	ed	Enhanced	
out Ox01					
DC	24/48 V DC	127 V DC	220 V DC	250 V DC	
AC (47.5 to 63 Hz)	-	-	-	-	100 à 240 V AC
	8 A	8A	8 A	8A	8 A
Resistive load	8/4A	0.7 A	0.3 A	0.2 A	8 A
Load L/R < 20 ms	6/2A	0.5A	0.2 A	-	-
Load L/R < 40 ms	4/1A	0.2A	0.1 A	-	-
Load p.f > 0.3	-	-	-	-	5 A
	< 15 A for 200 ms				
isolated groups	Enhanced				
y input Ox02 to Ox06					
Continue	24/48 V DC	127 V DC	220 V DC	250 V DC	
Alternative (47.5 à 63 Hz)	-	-	-	-	100 to 240 V AC
·	2 A	2A	2 A	2A	2 A
	At state 0 At state 1 isolated groups <b>but Ox01</b> DC AC (47.5 to 63 Hz) Resistive load Load L/R < 20 ms Load L/R < 40 ms Load D/R < 40 ms Load p.f > 0.3 isolated groups <b>y input Ox02 to Ox06</b> Continue	0,38 kg (0,83 lb)           -25 °C to +70 °C (           s           Same characteris           MES120           24 à 250 V DC           19.2 à 275 V DC           3mA           14 V DC           At state 0           4 t state 0           4 t state 1           > 19 V DC           isolated groups           Enhanced           DC           AC (47.5 to 63 Hz)           -           8A           Resistive load           8/4 A           Load L/R < 20 ms	0,38 kg (0,83 lb)           -25 °C to +70 °C (-13 °F to +158 °F           s         Same characteristics as Sepam be           MES120         MES           24 à 250 V DC         220 to 2           19.2 à 275 V DC         170 to 2           3 mA         3 mA           14 V DC         155 V DC           At state 0         <6 V DC	0,38 kg (0,83 lb)           -25 °C to +70 °C (-13 °F to +158 °F)           s         Same characteristics as Sepam base units           MES120         MES120G           24 à 250 V DC         220 to 250 V DC           19.2 à 275 V DC         170 to 275 V DC           3 mA         3 mA           14 V DC         155 V DC           At state 0         < 6 V DC	0,38 kg (0,83 lb)           -25 ° C to +70 ° C (-13 °F to +158 °F)           s         Same characteristics as Sepam base units           MES120         MES120G         MES120H           24 à 250 V DC         220 to 250 V DC         110 to 125 V DC           19.2 à 275 V DC         170 to 275 V DC         88 to 150 V DC           3mA         3mA         3mA           14 V DC         155 V DC         82 V DC           At state 0         < 6 V DC

2A 2/1A Continuous current Load L/R < 20 ms Breaking capacity

Load p.f > 0.3 Isolation of inputs from other isolated groups

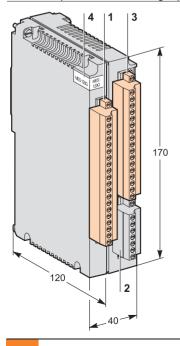

# Description

Enhanced

- 3 removable, lockable screw-type connectors.
- 1 20-pin connector for 9 logic inputs:

0.5A

- Ix01 to Ix04: 4 independent logic inputs
- Ix05 to Ix09: 5 common point logic inputs.
- 2 7-pin connector for 5 common point logic inputs Ix10 à Ix14.

0.15 A

0.2 A


1 A

- 3 17-pin connector for 6 relay outputs:
- Ox01: 1 control relay output
- Ox02 to Ox06 : 5 indication relay outputs.
- Addressing of MES120 module inputs / outputs:
- x = 1 for the module connected to H1
- x = 2 for the module connected to H2
- x = 3 for the module connected to H3.
- 4 MES120G, MES120H identification label (MES120 modules have no labels).

Installation of the second MES120 module, connected to base unit connector H2.

# Logic input / output modules

# MES120, MES120G, MES120H 14 input / 6 output module Installation



## Assembly

- Installation of an MES120 module on the base unit
- insert the 2 pins on the MES module into the slots 1 on the base unit
- push the module flat up against the base unit to plug it into the connector H2
- partially tighten the two mounting screws 2 before locking them.
- MES120 modules must be mounted in the following order:
- if only one module is required, connect it to connector H1
- if 2 modules are required, connect them to connectors H1 and H2

■ if 3 modules are required (maximum configuration), the 3 connectors H1, H2 and H3 are used

Installation of the second MES120 module, connected to base unit connector H2

# Connection

The inputs are potential-free and the DC power supply source is external. 


#### DANGER

- HAZARD OF ELECTRIC SHOCK, ELECTRIC ARC OR BURNS
- Only qualified personnel should install this equipment. Such work should be
- performed only after reading this entire set of instructions and checking the ■ technical characteristics of the device.
- NEVER work alone.
- Turn off all power supplying this equipment before working on or inside it.
- Consider all sources of power, including the possibility of backfeeding.
- Always use a properly rated voltage sensing device to confirm that all power ■is off.
- Screw tight all terminals, even those not in use.

Failure to follow these instructions will result in death or serious injury.

#### Wiring of connectors

- wiring without fittings:
- □ 1 wire with maximum cross-section 0.2 to 2.5 mm<sup>2</sup> (≥ AWG 24-12)
- □ or 2 wires with maximum cross-section 0.2 to 1 mm<sup>2</sup> (≥ AWG 24-16)
- $\Box$  stripped length: 8 to 10 mm (0.31 to 0.39 in)
- wiring with fittings:
- □ recommended wiring with Telemecanique fittings:
- DZ5CE015D for one 1.5 mm<sup>2</sup> wire (AWG 16)
- DZ5CE025D for one 2.5 mm<sup>2</sup> wire (AWG 12)
- AZ5DE010D for two 1 mm<sup>2</sup> wires (AWG 18)
- $\Box$  tube length: 8.2 mm (0.32 in)
- □ stripped length: 8 mm (0.31 in).

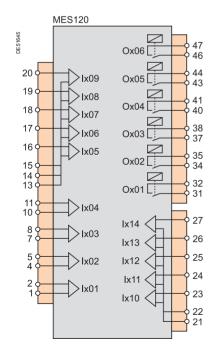

# MES120, MES120G, MES120H 14 input / 6 output module Logic input / output assignment

Inputs and outputs may be assigned to predefined control and monitoring functions using the SFT2841 software, according to the uses listed in the table below. The control logic of each input may be inverted for undervoltage type operation. All the logic inputs, whether or not assigned to predefined functions, may be used for the customization functions according to specific application needs:

in the control matrix (SFT2841 software), to connect an input to a logic output, a LED on the front of Sepam or a message for local indication on the display
 in the logic equation editor (SFT2841 software), as logic equation variables

■ in Logipam (SFT2885 software) as input variables for the program in ladder language.

							-							
Functions	S80	S81	S82	S84	<b>T</b> 81	T82	M87	M81	G87	G82	<b>B80</b>	<b>B83</b>	C86	Assignment
						T87		M88		G88				
Tripping / contactor control														O1
Inhibit closing														O2 by default
Closing					•		•		•		•		-	O3 by default
Watchdog														O5
Logic discrimination, blocking send 1														O102 by default
Logic discrimination, blocking send 2									•					O103 by default
Genset shutdown										-				Free
De-excitation										•				Free
Load shedding							-	-						Free
AT, closing of NO circuit breaker					•					•	•			Free
AT, closing of coupling														Free
AT, opening of coupling					•					•	•			Free
Tripping of capacitor step (1 to 4)													•	Free
Tripping of capacitor step (1 to 4)														Free

#### Logic output assignment table

Note: The logic outputs assigned by default may be freely reassigned.

#### Assignment table for logic inputs common to all applications

Functions	S80	S81	S82		T81	T82	M87		G87					Assignment
T unctions	300	301	302	304	101		10107		607			005	000	Assignment
						<b>T87</b>		M88		G88				
Closed circuit breaker		-			•	-	•		•		•			1101
Open circuit breaker														1102
Synchronization of Sepam internal clock via external pulse	-			•	•		•	-	•	•	•		•	1103
Switching of groups of settings A/B	•				•				•				•	Free
External reset														Free
Earthing switch closed	•						•		•		•		•	Free
Earthing switch open	•				•				•		•		•	Free
External trip 1														Free
External trip 2	•						•		•		•			Free
External trip 3							•				•			Free
End of charging position														Free
Inhibit remote control (Local)	•						•		•		•		•	Free
SF6 pressure default							•				•			Free
Inhibit closing														Free
Open order	•						•		•		•		•	Free
Close order	•				•				•		•		•	Free
Phase VT fuse blown														Free
V0 VT fuse blown	•						•		•		•		•	Free
External positive active energy meter							•				•			Free
External negative active energy meter														Free
External positive reactive energy meter	•								•		•		•	Free
External negative reactive energy meter														Free
Racked out circuit breaker	•				•				•				•	Free
Switch A closed	•								•		•		•	Free
Switch A open					•		•				•			Free
Switch B closed														Free
Switch B open	•								•		•			Free
Closing-coil monitoring														Free

# Logic input / output modules

# MES120, MES120G, MES120H 14 input / 6 output module Logic input / output assignment

Functions	600	C04							c inpu					Accient
Functions	S80	581	582	584	181	T82	M87	M81 M88	G87	G82 G88	880	B83	C86	Assignment
Inhibit recloser	•													Free
Inhibit thermal overload														Free
Switching of thermal settings										•				Free
Blocking reception 1	•									•				Free
Blocking reception 2										•				Free
Buchholz trip										•				Free
Thermostat trip					•			•		•				Free
Pressure trip					•					•				Free
Thermistor trip										•				Free
Buchholz alarm					•			•		•				Free
Thermostat alarm					•					•				Free
Pressure alarm					•									Free
Thermistor alarm					•			•		•				Free
Rotor speed measurement														1104
Rotor rotation detection														Free
Motor re-acceleration														Free
Load shedding request														Free
Inhibit undercurrent														Free
Priority genset shutdown										•				Free
De-excitation										•				Free
Close enable (ANSI 25)														Free
Inhibit opposite-side remote control (local)														Free
Inhibit remote-control coupling (local)														Free
Coupling open														Free
Coupling closed														Free
Opposite side open														Free
Opposite side closed														Free
Selector set to Manual (ANSI 43)														Free
Selector set to Auto (ANSI 43)														Free
Selector set to Circuit breaker (ANSI 10)														Free
Selector set to Coupling (ANSI 10)			-		-	-			-	-	-	-		Free
Opposite-side circuit breaker disconnected				-						-		-		Free
Coupling circuit breaker disconnected	-	-	-	-	-	-			-	-	-	-		Free
Coupling close order			-	-	-	-			-	-	-	-		Free
Opposite-side voltage OK	-		-	-	-	-			-	-	-	-		Free
	-	-	-	-	-	-			-	-	-	-		
Inhibit closing of coupling			-			-			-	-	-	-		Free
Automatic closing order		-	-	-		-			-	-	-	-		Free
External closing order 1											-	-		Free
External closing order 2											-	-		Free
Additional phase voltage transformer fuse blown											-	-		Free
Additional V0 voltage transformer fuse blown	·													Free
Capacitor step 1 open												-		Free
Capacitor step 1 closed													-	Free
· · · · · · · · · · · · · · · · · · ·													-	Free
Capacitor step 2 open													-	
Capacitor step 2 closed													-	Free
Capacitor step 3 open													-	Free
Capacitor step 3 closed													-	Free
Capacitor step 4 open													-	Free
Capacitor step 4 closed													-	Free
Step 1 opening order													•	Free
Step 2 opening order														Free
Step 3 opening order													-	Free
Step 4 opening order													•	Free
Step 1 closing order	<u> </u>				<u> </u>								•	Free
Step 2 closing order					<u> </u>								•	Free
Step 3 closing order													•	Free
Step 4 closing order	<u> </u>				<u> </u>								•	Free
Step 1 external trip	<u> </u>				<u> </u>								•	Free
Step 2 external trip					<u> </u>									Free
Step 3 external trip	<u> </u>				<u> </u>									Free
Step 4 external trip													•	Free
Capacitor step 1 VAR control														Free
Capacitor step 2 VAR control														Free
Capacitor step 3 VAR control														Free
Capacitor step 4 VAR control														Free
External capacitor step control inhibit														Free
Manual severites step several														Free
Manual capacitor step control							1				1			1100



# Selection guide and connection

## Selection guide

4 remote modules are proposed as options to enhance the Sepam base unit functions:

■ the number and type of remote modules compatible with the base unit depend on the Sepam application

■ the DSM303 remote advanced UMI module is only compatible with base units that do not have integrated advanced UMIs.


				eries 20	Sepa	am series 40 Sepam series 8			
			S2x, B2x	T2x, M2x	S4x	T4x, M4x, G4x	S8x, B8x	T8x, G8x	M8x, C8x
MET148-2	Temperature sensor module	See page 159	0	1	0	2	0	2	2
MSA141	Analog output module	See page 161	1	1	1	1	1	1	1
DSM303	Remote advanced UMI module	See page 162	1	1	1	1	1	1	1
MCS025	Synchro-check module	See page 164	0	0	0	0	1	1	0
Number of of remote r	sets of interlinked modules / maxi nodules	1 set of 3 int modules	erlinked	1 set o module	f 3 interlinked es	5 modules split between 2 sets of interlinked modules			

# **A**ATTENTION

#### HAZARD OF NON-OPERATION

The MCS025 module must ALWAYS be connected with the special CCA785 cord, supplied with the module and equipped with an orange RJ45 plug and a black RJ45 plug.

#### Failure to follow this instruction can cause equipment damage.

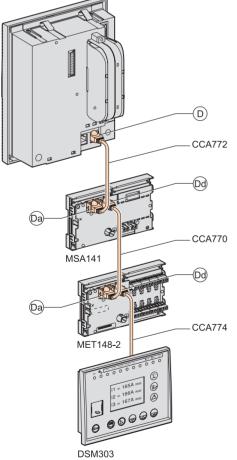

Example of inter-module linking on Sepam series 20.

# Connection

#### **Connection cords**

Different combinations of modules may be connected using cords fitted with 2 black RJ45 connectors, which come in 3 lengths:

- CCA770: length = 0.6 m (2 ft)
- CCA772: length = 2 m (6.6 ft)
- CCA774: length = 4 m (13.1 ft).

The modules are linked by cords which provide the power supply and act as functional links with the Sepam unit (connector (D) to connector (Da), (Dd) to (Da), ...).

#### **Rules on inter-module linking**

#### linking of 3 modules maximum

DSM303 and MCS025 modules may only be connected at the end of the link.


#### Maximum advisable configurations

#### Sepam series 20 and Sepam series 40: just 1 set of interlinked modules

Base	Cord	Module 1	Cord	Module 2	Cord	Module 3
DE51770						00000 00000
Series 20	CCA772	MSA141	CCA770	MET148-2	CCA774	DSM303
Series 40	CCA772	MSA141	CCA770	MET148-2	CCA774	DSM303
Series 40	CCA772	MSA141	CCA770	MET148-2	CCA772	MET148-2
Series 40	CCA772	MET148-2	CCA770	MET148-2	CCA774	DSM303

#### Sepam series 80: 2 sets of interlinked modules

Sepam series 80 has 2 connection ports for remote modules, (D1) and (D2). Modules may be connected to either port.

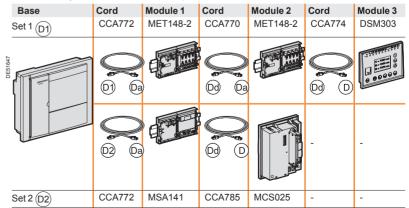



# Remote modules

# MET148-2 Temperature sensor module



MET148-2 Temperature sensor module

#### **Function**

The MET148-2 module can be used to connect 8 temperature sensors (RTDs) of the same type:


- Pt100, Ni100 or Ni120 type RTDs, according to parameter setting
- 3-wire temperature sensors

A single module for each Sepam series 20 base unit, to be connected by one of the CCA770 (0.6 or 2 ft), CCA772 (2 m or 6.6 ft) or CCA774 (4 m or 13.1 ft) cords
 2 modules for each Sepam series 40 or series 80 base unit, to be connected by CCA770 (0.6 or 2 ft), CCA772 (2 m or 6.6 ft) or CCA774 (4 m or 13.1 ft) cords
 The temperature measurement (e.g. in a transformer or motor winding) is

- utilized by the following protection functions:
- Thermal overload (to take ambient temperature into account)
- Temperature monitoring.

# Characteristics

0.2 kg (0.441 lb)						
On symmetrical DIN rail						
-25 °C to +70 °C (-13 °F to +158 °F)						
Same characteristics as Sepa	am base units					
Pt100	Ni100 / Ni120					
None	None					
ent injected in RTD 4 mA 4 mA						
	On symmetrical DIN rail -25 °C to +70 °C (-13 °F to +1 Same characteristics as Sepa Pt100 None					



(1) 70 mm (2.8 in) with CCA77x cord connected.

# **Description and dimensions**

A Terminal block for RTDs 1 to 4.

(B) Terminal block for RTDs 5 to 8.

Da) RJ45 connector to connect the module to the base unit with a CCA77x cord Dd) RJ45 connector to link up the next remote module with a CCA77x cord

(according to application).

 $(\pm)$  Grounding/earthing terminal.

- Jumper for impedance matching with load resistor (Rc), to be set to:
   ➡, if the module is not the last interlinked module (default position)
   Rc, if the module is the last interlinked module.
- 2 Jumper used to select module number, to be set to:
  - MET1: 1st MET148-2 module, to measure temperatures T1 to T8 (default position)
    - MET2: 2nd MET148-2 module, to measure temperatures T9 to T16 (for Sepam series 40 and series 80 only).

# MET148-2 Temperature sensor module

# Connection

# A DANGER

#### HAZARD OF ELECTRIC SHOCK, ELECTRIC ARC OR BURNS

• Only qualified personnel should install this equipment. Such work should be performed only after reading this entire set of instructions and checking the technical characteristics of the device.

NEVER work alone.

N°5

- Check that the temperature sensors are isolated from dangerous voltages.
- Failure to follow these instructions will result in death or serious injury.

#### Connection of the earthing terminal

By tinned copper braid with cross-section  $\ge 6 \text{ mm}^2$  (AWG 10) or cable with cross-section  $\ge 2.5 \text{ mm}^2$  (AWG 12) and length  $\le 200 \text{ mm}$  (7.9 in), fitted with a 4 mm (0.16 in) ring lug.

Check the tightness (maximum tightening torque 2.2 Nm or 19.5 lb-in).

#### Connection of RTDs to screw-type connectors

- 1 wire with cross-section 0.2 to 2.5 mm<sup>2</sup> (AWG 24-12)
- or 2 wires with cross-section 0.2 to 1 mm<sup>2</sup> (AWG 24-18).
- Recommended cross-sections according to distance:
- Up to 100 m (330 ft)  $\geq$  1 mm<sup>2</sup> (AWG 18)
- Up to 300 m (990 ft)  $\geq$  1.5 mm<sup>2</sup> (AWG 16)
- Up to 1 km (0.62 mi)  $\geq$  2.5 mm<sup>2</sup> (AWG 12)
- Maximum distance between sensor and module: 1 km (0.62 mi).

#### Wiring precautions

■ It is preferable to use shielded cables.

The use of unshielded cables can cause measurement errors which vary in degree according to the level of surrounding electromagnetic disturbance

- Only connect the shielding at the MET148-2 end, in the shortest manner possible,
- to the corresponding terminals of connectors (A) and (B)
- Do not connect the shielding at the RTD end.


#### Accuracy derating according to wiring

The error Dt is proportional to the length of the cable and inversely proportional to the cable cross-section:

$$\Delta t(^{\circ}C) = 2 \times \frac{L(km)}{S(mm^2)}$$

- ±2.1°C/km for 0.93 mm<sup>2</sup> cross-section (AWG 18)
- ±1°C/km for 1.92 mm<sup>2</sup> cross-section (AWG 14).





MET148-2

# Remote modules

# MSA141 Analog output module



MSA141 analog output module.

# **Function**

The MSA141 module converts one of the Sepam measurements into an analog signal:

- selection of the measurement to be converted by parameter setting
- 0-10 mA, 4-20 mA, 0-20 mA analog signal according to parameter setting
   scaling of the analog signal by setting minimum and maximum values of the
- converted measurement.

Example: the setting used to have phase current 1 as a 0-10 mA analog output with a dynamic range of 0 to 300 A is:


- □ minimum value = 0
- □ maximum value = 3000

■ a single module for each Sepam base unit, to be connected by one of the CCA770 (0.6m or 2 ft), CCA772 (2m or 6.6 ft) or CCA774 (4m or 13.1 ft) cords.


The analog output can also be remotely managed via the communication network.

# Characteristics

MSA141 module							
Weight	0.2 kg (0.441 lb)						
Assembly	On symm	etrical DIN rail					
Operating temperature	-25 °C to -	+70 °C (-13 °F to	+158 °F)				
Environmental characteristics	Same cha	racteristics as Se	pam base units				
Analog output							
Current	4-20 mA,	0-20 mA, 0-10 m	A				
Scaling	Minimum	value					
(no data input checking)	Maximum	value					
Load impedance	< 600 Ω (i	ncluding wiring)					
Accuracy	0.5 %						
Measurements	Unit	Series 20	Series 40	Series 80			
available							
Phase and residual currents	0.1 A	•	•				
Phase-to-neutral and phase-to- phase voltages	1 V	•	•	•			
Frequency	0.01 Hz	•	•	•			
Thermal capacity used	1%	•	•	•			
Temperatures	1°C						
Active power	0.1 kW						
Reactive power	0.1 kvar						
Apparent power	0.1 kVA						
Power factor	0.01						
Remote setting via communication link							



(1) 70 mm (2.8 in) with CCA77x cord connected



# **Description and dimensions**

- (A) Terminal block for analog output.
- (Da) RJ45 socket to connect the module to the base unit with a CCA77x cord.
- (Dd) RJ45 socket to link up the next remote module with a CCA77x cord
- (according to application).
- $(\pm)$  Earthing terminal.
- 1 Jumper for impedance matching with load resistor (Rc), to be set to:
  - B, , if the module is not the last interlinked module (default position)
  - Rc, if the module is the last interlinked module.

## Connection

#### Connection of the earthing terminal

By tinned copper braid with cross-section  $\ge 6 \text{ mm}^2$  (AWG 10) or cable with cross-section  $\ge 2.5 \text{ mm}^2$  (AWG 12) and length  $\le 200 \text{ mm}$  (7.9 in), equipped with a 4 mm (0.16 in) ring lug.

Check the tightness (maximum tightening torque 2.2 Nm or 19.5 lb-in).

#### Connection of analog output to screw-type connector

- 1 wire with cross-section 0.2 to 2.5 mm<sup>2</sup> (AWG 24-12)
- or 2 wires with cross-section 0.2 to 1 mm<sup>2</sup> (AWG 24-18).

#### Wiring precautions

- It is preferable to use shielded cables
- Use tinned copper braid to connect the shielding at least at the MSA141 end.

Merlin Gerin

# DSM303 Remote advanced UMI module



DSM303 remote advanced UMI module.

# **Function**

When associated with a Sepam that does not have its own advanced user-machine interface, the DSM303 offers all the functions available on a Sepam integrated advanced UMI.

It can be installed on the front panel of the cubicle in the most suitable operating location:

- reduced depth < 30 mm (1.2 in)
- a single module for each Separm, to be connected by one of the CCA772 (2 m or 6.6 ft) or CCA774 (4 m or 13.1 ft) cords.

The module cannot be connected to Sepam units with integrated advanced UMIs.


# **Characteristics**

DSM303 module	
Weight	0.3 kg (0.661 lb)
Assembly	Flush-mounted
Operating temperature	-25 °C to +70 °C (-13 °F to +158 °F)
Environmental characteristics	Same characteristics as for Sepam base units

# DSM303 Remote advanced UMI module

# **Description and dimensions**

The module is simply flush-mounted and secured by its clips. No additional screw-type fastening is required.

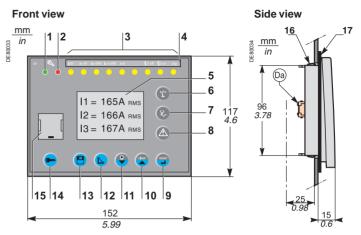

- 1 Green LED: Sepam on.
- 2 Red LED:
  - steadily on: module unavailable
  - flashing: Sepam link unavailable.
- 3 9 yellow LEDs.
- 4 Label identifying the LEDs.5 Graphic LCD screen.
- 6 Display of measurements.
- 7 Display of switchgear, network and machine diagnosis data.
- 8 Display of alarm messages.
- 9 Sepam reset (or confirm data entry).
- 10 Alarm acknowledgment and clearing (or move cursor up).
- 11 LED test (or move cursor down).
- **12** Access to protection settings.
- 13 Access to Sepam parameters.
- 14 Entry of 2 passwords.
- **15** PC connection port.
- **16** Mounting clip.
- 17 Gasket to ensure NEMA 12 tightness
  - (gasket supplied with the DSM303 module, to be installed if necessary).
- (ba) RJ45 lateral output connector to connect the module to the base unit with a CCA77x cord.

Cut-out for flush-mounting (mounting plate thickness < 3 mm or 0.12 in)

# **A**CAUTION

HAZARD OF CUTS


Trim the edges of the cut-out plates to remove any jagged edges.

Failure to follow this instruction can cause serious injury.

# 98.5±0,5 3.88 144±0,2 5.67

# Connection

Da RJ45 socket to connect the module to the base unit with a CCA77x cord. The DSM303 module is always the last interlinked remote module and it systematically ensures impedance matching by load resistor (Rc). 4



# MCS025 Synchro-check module



## **Function**

The MCS025 module checks the voltages upstream and downstream of a circuit breaker to ensure safe closing (ANSI 25).

It checks the differences in amplitude, frequency and phase between the two measured voltages, taking into account dead line/busbar conditions. Three relay outputs may be used to send the close enable to several Sepam series 80 units.

The circuit-breaker control function of each Sepam series 80 unit will take this close enable into account.

The settings for the synchro-check function and the measurements carried out by the module may be accessed by the SFT2841 setting and operating software, similar to the other settings and measurements for the Sepam series 80.

The MCS025 module is supplied ready for operation with:

■ the CCA620 connector for connection of the relay outputs and the power supply

■ the CCT640 connector for voltage connection

■ the CCA785 cord for connection between the module and the Sepam series 80 base unit.

4

MCS025 synchro-check module.

# **Characteristics**


MCS025 module								
Weight								
Assembly		With the AMT840 ac	With the AMT840 accessory					
Operating temperature		-25 °C to +70 °C (-1	3 °F to +158 °F)					
Environmental characteristics		Same characteristic	s as Sepam base units					
Voltage inputs								
Impédance d'entrée		> 100 kΩ						
Consommation		< 0.015 VA (VT 100 V	/)					
Tenue thermique permanente		240 V						
Surcharge 1 seconde		480 V						
Relay outputs								
Relay outputs O1 and O2								
Voltage	DC	24/48 V DC	127 V DC	220 V DC				
	AC (47.5 to 63 Hz)				100 à 240 V AC			
Continuous current		8 A	8 A	8 A	8A			
Breaking capacity	Resistive load	8A/4A	0.7 A	0.3A				
	Load L/R < 20 ms	6A/2A	0.5A	0.2 A				
	Load L/R < 40 ms	4A/1A	0.2 A	0.1 A				
	Resistive load				8A			
	Load p.f. > 0.3				5A			
Making capacity		< 15 ms for 200 ms						
Isolation of outputs from other other isolated groups		Enhanced						
Relay outputs O3 and O4	(O4 not used)							
Voltage	DC	24/48 V DC	127 V DC	220 V DC				
	AC (47.5 to 63 Hz)				100 to 240 V AC			
Continuous current		2A	2 A	2 A	2A			
Breaking capacity	Load L/R < 20 ms	2A/1A	0.5 A	0.15 A				
	Load p.f. > 0.3				5A			
Isolation of outputs from other other isolated groups		Enhanced						
Power supply								
Voltage		24 to 250 V DC, -20 % / +10 %		110 to 240 V AC, -20 % / + 0 % 47.5 to 63 Hz				
Maximum consumption		6 W		9 VA				
Inrush current		< 10 A for 10 ms		< 15 A for one half period				
Acceptable momentary outages		10 ms		10 ms				




# Remote modules

# MCS025 Synchro-check module

- 1 MCS025 module
- A CCA620 20-pin connector for:
  - auxiliary power supply4 relay outputs:
  - 4 Telay outputs.
     O1, O2, O3: close enable.
  - □ 01, 02, 03. close el □ 04: not used
- (B) CCT640 connector (phase-to-neutral or phase-tophase) for the two input voltages to be synchronized
- C RJ45 connector, not used
- (D) RJ45 connector for module connection to the Sepam series 80 base unit, either directly or via another remote module.
- 2 Two mounting clips
- 3 Two holding pins for the flush-mount position
- 4 CCA785 connection cord

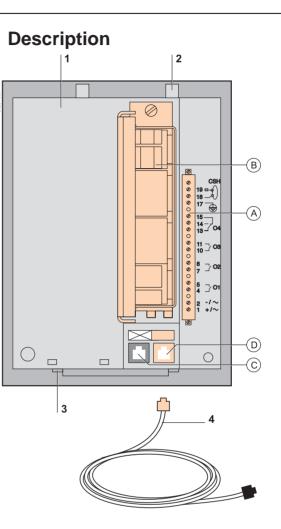


# MCS025 Synchro-check module




MCS025.

Δ




Dimensions



# Assembly with AMT840 mounting plate


The MCS025 module should be mounted at the back of the compartment using the AMT840 mounting plate.



Connector	Туре	Reference	Wiring
A	Screw-type	CCA620	<ul> <li>Wiring with no fittings:</li> <li>1 wire with maximum cross-section 0.2 to 2.5 mm<sup>2</sup> (&gt;AWG 24-12) or 2 wires with cross-section 0.2 to 1 mm<sup>2</sup> (&gt;AWG 24-16)</li> <li>stripped length: 8 to 10 mm (0.31 à 0.39 in)</li> <li>Wiring with fittings:</li> <li>recommended wiring with Telemecanique fittings:</li> <li>DZ5CE015D for 1 wire 1.5 mm2 (AWG 16)</li> <li>DZ5CE025D for 1 wire 2.5 mm2 (AWG 12)</li> <li>AZ5DE010D for 2 x 1 mm<sup>2</sup> wires (AWG 18)</li> <li>tube length: 8.2 mm (0.32 in)</li> <li>stripped length: 8 mm (0.31 in)</li> </ul>
В	Screw-type	CCT640	VT wiring: same as wiring of the CCA620 Earthing connection: by 4 mm (0.15 in) ring lug
D	Orange RJ45 connector		<ul> <li>CCA785, special prefabricated cord supplied with the MCS025 module:</li> <li>orange RJ45 connector for connection to port D on the MCS025 module</li> <li>black RJ45 connector for connection to the Sepam series 80 base unit, either directly or via another remote module.</li> </ul>

# Caractéristiques de raccordement

# MCS025 Synchro-check module

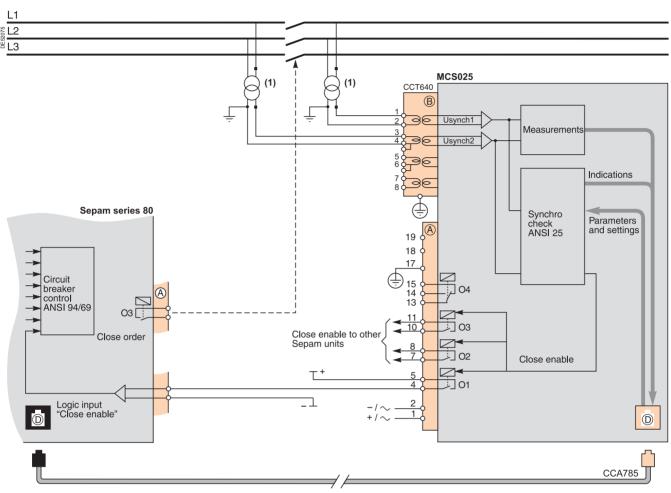

(1) Phase-to-phase or phase-to-neutral connection.

# **ATTENTION**

HAZARD OF NON-OPERATION The MCS025 module must ALWAYS be connected with the special CCA785 cord, supplied with the module and equipped with an orange RJ45 plug and a black RJ45 plug.

Failure to follow this instruction can cause equipment damage.

# 

#### HAZARD OF ELECTRIC SHOCK, ELECTRIC ARC OR BURNS

• Only qualified personnel should install this equipment. Such work should be performed only after reading this entire set of instructions and checking the technical characteristics of the device.

- NEVER work alone.
- Turn off all power supplying this equipment before working on or inside it.
- Consider all sources of power, including the possibility of backfeeding.
- Always use a properly rated voltage sensing device to confirm that all power is off.
- Screw tight all terminals, even those not in use.
- Failure to follow these instructions will result in death or serious injury.


4

# Other modules

# Sepam 100 LD Presentation




Sepam 100 LD



Sepam 100 LD: front panel.

# **Operation curve**



Sepam 100 LD is a high impedance differential relay. It provides restricted earth fault, busbar and machine protection.

#### **Advantages**

- stability with respect to external faults
- sensitivity to internal faults
- speed (typical response time: 15 ms to 5 ls)
- outputs with or without latching
- Iocal and remote acknowledgment
- high level of immunity to electromagnetic interference.

#### Description

- Sepam 100 LD is available in 4 versions:
- single-phase for restricted earth protection
- three-phase for busbar and machine protection
- 50 or 60 Hz
- 50 Hz single-phase: 100 LD X 51
- 50 Hz three-phase: 100 LD X 53
- 60 Hz single-phase: 100 LD X 61
- 60 Hz three-phase: 100 LD X 63.
- The front of Sepam 100 LD includes:
- 2 signal lamps:
- □ power "on" indicator
- □ latching "trip" indicator indicating output relay tripping
- protection setting dial
- "reset" button for acknowledging output relays and the "trip" indicator. When the button is activated, the "trip" indicator undergoes a lamp test.
- The back of Sepam 100 LD includes: input/output connectors:
- □ an 8-pin connector for toroid inputs and remote acknowledgment
- □ an 8-pin connector for "tripping" outputs and power supply
- □ a 4-pin connector for "tripping" outputs
- a microswitch used to configure the relay "with" or "without" latching. Sepam 100 LD has:
- 1 or 3 current inputs with a common point according to whether it is a single-phase or three-phase version
- a logic input (isolated) for remote acknowledgment
- "tripping" output relay with 5 contacts (3 normally open contacts and 2 normally closed contacts).

Sepam 100 LD operates in 5 voltage ranges (please specify when ordering):

- 24-30 V DC
- 48-125 V DC
- 220-250 V DC
- 100-127 VAC
- 220-240 VAC.

Sepam 100 LD is associated with a stabilization plate (or 3 plates) with variable resistance, enabling operation with 1 A or 5 A transformers.

# **Parameter setting**

Microswitch SW1, accessible on the back of Sepam 100 LD, is used to choose "with" or "without" latching.





With latching:




# **Sepam 100 LD** High impedance differential protection

# Settings

Settings	Setting values				
Setting current Is	5 to 40 % In by steps of 5 % In				
	40 to 80 % In by steps of 10 % In				
	The dial on the front of the device	is used for setting			
Stabilizing resistor plate	Rs = 0 $\Omega$ to 68 $\Omega$	P = 280 W			
	Rs = 0 $\Omega$ to 150 $\Omega$	P = 280 W			
	Rs = 0 $\Omega$ to 270 $\Omega$	P = 280 W			
	Rs = 0 $\Omega$ to 470 $\Omega$	P = 180 W			
	Rs = 0 $\Omega$ to 680 $\Omega$	P = 180 W			
Accuracy / performance					
Setting	±5 %				
Pickup (%)	93 % ±5 %				
Response time	≤ 10 ms for I ≥ 10 Is				
	≤ 16 ms for I ≥ 5 Is				
	≤25 ms for I≥2 Is				
Memory time	≤30 ms				

# Sepam 100 LD Sensors and surge limiters



n: p: Rf1, Rf2:	CT transformation ratio Number of CTs Wiring resistance on either side of Rs Rf = max (Rf1, Rf2)
R1,Rp:	CT secondary resistances
	R = max (R1,Rp)
Rs:	Stabilizing resistor
RI:	Surge limiter
icc:	Maximum external short-circuit
	current in CT secondary winding
is:	Protection setting (A)
if:	Current in RI
i <sub>m</sub> 1, i <sub>m</sub> p:	CT magnetizing currents
Vk1, Vkp:	CT knee-point voltages
,	Vk = min (Vk1,, Vkp)
	·····(·····()

# Specifying the sensors

#### **Current transformers**

To ensure the stability and sensitivity of Sepam 100 LD, the stabilization resistor and characteristics of the current transformers (CTs) are calculated as follows.

#### Choice of current transformers

■ all the CTs must have the same transformation ratio n

the knee-point voltages are chosen so that:

Vk > 2 x (R + Rf) x icc

#### Choice of stabilizing resistor

 $\frac{\mathbf{R} + \mathbf{R} \mathbf{f}}{\mathbf{i} \mathbf{s}} \times \mathbf{i} \mathbf{c} \mathbf{c} < \mathbf{R} \mathbf{s} \le \frac{\mathbf{V} \mathbf{k}}{\mathbf{2} \times \mathbf{i} \mathbf{s}}$ 

#### Surge limiter

The approximate voltage developed by a CT in the event of an internal fault is: V =  $2\sqrt{22 \times Vk \times (icc \times (R + Rf + Rs) - Vk)}$ 

If the value exceeds 3 kV, it is necessary to add an RI surge limiter in parallel with the relay and stabilizing resistor in order to protect the CTs (see: surge limiter).

#### Protection sensitivity

The CTs consume magnetizing current and the surge limiter, when installed, creates fault current. The minimum residual primary current detected by the protection is therefore:

 $Id = n x (i_m 1 + ... i_m p + if + is)$ 

#### with

i<sub>m</sub>1, ...imp are read on the CT magnetization curves at V = Rs x is
 if is the total earth leakage current of the surge limiter for Vs = Rs x is, i.e. the sum of the earth leakage currents of the N limiter units installed in parallel: if = N x ib (see: surge limiter).

# **Surge limiter**

If the calculations have shown that it is necessary to install a surge limiter in parallel with the relay and Rs to protect the CTs, it is determined as follows.

#### Choice

#### Standard references

■ the surge limiters on offer consist of limiter blocks which are independent of each other. Each block accepts a maximum current of 40 A RMS for 1 s. By installing the blocks in parallel, it is possible to obtain the appropriate limiter for the application.

there are two standard references:
 a single module, comprising one block

□ a triple module, comprising three independent blocks which are aligned.


#### Calculation of the number of blocks per phase

According to i, max. RMS short-circuit current in the secondary winding of a CT, the number of blocks required per phase is calculated:  $N \ge \frac{I}{40}$ 

- for a three-phase relay, N triple modules should be ordered
- for a single-phase relay, N blocks, made up of triple and single modules.


#### Earth leakage current

A limiter block accepts a max. steady state voltage of 325 V RMS and presents an earth fault current lb:

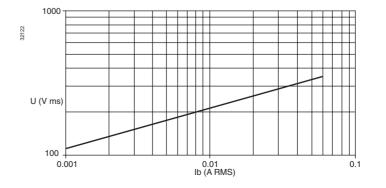

# Sepam 100 LD Description and connection

# **Rear panel**

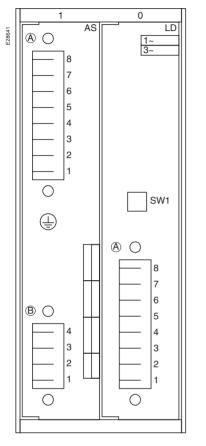


#### (A): 8-pin CCA608 connector

(toroid and remote reloading inputs); screw terminal wiring with 0.6 to 2.5 mm<sup>2</sup> wires, each terminal being capable of receiving two 1.5 mm<sup>2</sup> wires.


(A): 8-pin CCA608 connector

(power supply and "annunciation and tripping" outputs); screw terminal wiring with 0.6 to 2.5 mm<sup>2</sup> wires, each terminal being capable of receiving two 1.5 mm<sup>2</sup> wires.

(B): CCA604 connector ("annunciation" outputs); screw terminal wiring with 0.6 to 2.5 mm<sup>2</sup> wires, each terminal being capable of receiving two 1.5 mm<sup>2</sup> wires.




# Functional and connection diagram

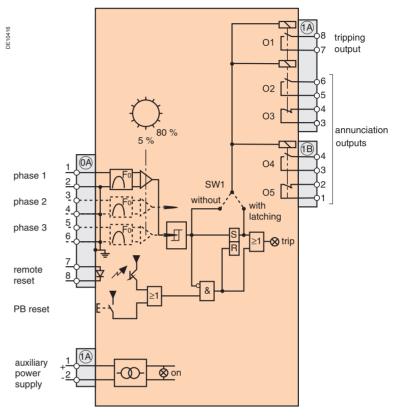

Note: only 0A1 and 0A2 terminals are available in the single-phase version.

#### Terminal identification

Each terminal is identified by 3 characters.



: ground terminal

# Connection of the tabilization plate

Connection of CTs and surge limiters:

- 5 A rating: between terminals 1-2 and 3-4
- 1 A rating: between terminals 1-2 and 5-6
- items 1 to 6: clamp screw connections for 6 mm2 wire
- items 1, 2: secondary of CSH30 core balance CT, connected to <sup>(A)</sup>.
- Wire to be used:
- sheathed, shielded wire
- min. cross-section 0.93 mm2 (AWG 18) (max. 2.5 mm²)
- resistance load per unit length < 100 mW/m
- min. dielectric strength: 1000 V
- max. length: 2 m.

Connect the wire shielding in the shortest way possible to (A).


The shielding is grounded in Sepam 100 LD. Do not ground the wire by any other means.

Press the wire against the metal frame of the cubicle to improve immunity to radiated interference.

# Other modules


# Sepam 100 LD Description and connection

**Example 1** (N = 2 blocks per phase): 2 triple modules for a three-phase relay.




Connection of the surge limiter

- single unit = outputs with screw M10
   triple unit = outputs with holes ø 10.4 (see "installation").
- **Example 2** (N = 2 blocks per phase): 2 single modules for a single-phase




DE10408

**Example 3** (N = 4 blocks per phase 1 triple module + 1 single module for a single-phase relay.




# Restricted earth protection (single-phase) 1 A CT

DF10409

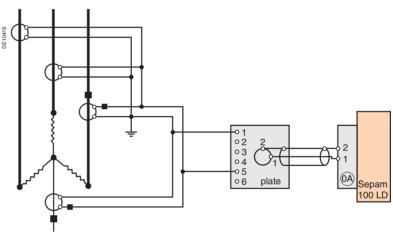

Busbar protection (three-phase) 5 A CT - with surge limiters

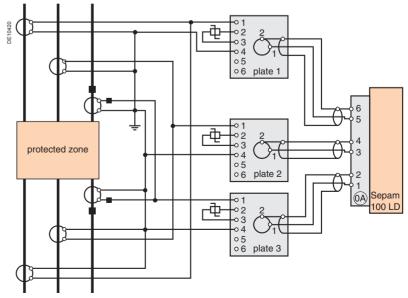




Δ


# Sepam 100 LD Characteristics and dimensions

Analog inputs (with	n plate)				
Constant current		10 In			
3 sec. current		500 In			
Entrée logique (réa	rmement à distance)				
Voltage		24/250 V DC	127/240 V AC		
Maximum power consu	mption	3.5 W	3.7 VA		
Logic outputs					
Constant current		8A			
Voltage		24/30 V DC	48 V DC	127 V DC/V AC	220 V DC/V A0
Breaking capacity	Resistive dc load	7 A	4A	0.7 A	0.3 A
(contact 01)	Resistive ac load			8A	8 A
Breaking capacity	Resistive dc load	3.4 A	2A	0.3 A	0.15 A
(contacts 02 to 05)	Resistive ac load			4 A	4 A
Power supply					
	Range	Consumption when inactive	Max. cons	sumption Inrush	current
24/30 V DC	±20 %	2.5 W	6 W	< 10 A	for 10 ms
48/125 V DC	±20 %	3 W	6 W	< 10 A	for 10 ms
220/250 V DC	-20 % +10 %	4 W	8 W	< 10 A	for 10 ms
100/127 V AC	-20 % +10 %	6 VA	10 VA	< 15 A	for 10 ms
220/240 V AC	-20 % +10 %	12 VA	16 VA	< 15 A	for 10 ms
Operating frequency		47.5 à 63 Hz			
Environmental	characteristics				
Climatic					
Operation		IEC 60068-2		-5 °C to	o 55 °C
Storage		IEC 60068-2		-25 °C	to 70 °C
Damp heat		IEC 60068-2		95 % to	o 40 °C
Influence of corrosion		IEC 60654-4	Class I		
Mechanical					
Degree of protection		IEC 60529	IP 41	On from	nt
Vibrations		IEC 60255-21-1	Class I		
Shocks and bumps		IEC 60255-21-2	Class I		
Earthquakes		IEC 60255-21-3	Class I		
Fire		IEC 60695-2-1		Gloww	vire
<b>Electrical insulatio</b>	n				
Power frequency		IEC 60255-5		2 kV - 1	1 mn
1.2/ 50 μs impulse wave	9	IEC 60255-5		5 kV	
Electromagnetic co	ompatibility				
Immunity to radiation		IEC 60255-22-3	Class X	30 V/m	1
Electrostatic sicharges		IEC 60255-22-2	Class III		
Single-direction transie	nts	IEC 61000-4-5			
Damped 1 MHz wave		IEC 60255-22-1	Class III		
5 ns fast transients		IEC 60255-22-4	Class IV		


Note: "C€" marking on our product guarantees their conformity to European directives.

#### Dimensions





#### Platine de stabilisation

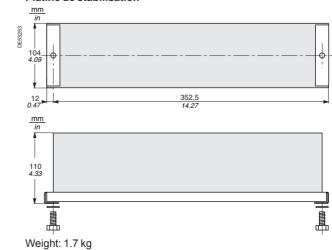


Weight: 1.9 kg

# Sepam 100 MI Presentation





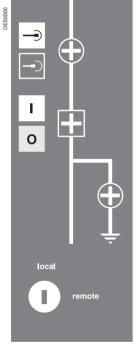

Front of Sepam 100MI-X03.



Device closed



Disconnector.

#### designed for control cubicles or cabinets ■ which may be used individually or together with Sepam 2000 and Sepam series 20/40/80 units.

**Function** 

Each module is suited to a particular indication and local control application.

The Sepam 100MI range includes 14 indication and local control modules:

- The right unit is chosen from the 14 types of Sepam 100MI according to:
- cubicle single-line diagram
- devices whose positions are to be indicated
- required local control functions.

The 14 types of Sepam 100MI are presented in detail in the pages which follow.

## Advantages

■ includes all the animated mimic elements for viewing breaking and disconnection device status

- compact size and easy installation
- reduced cabling
- standardization and consistency with Sepam range.

# Description

The front of Sepam 100MI includes the following, according to type:

- a mimic diagram showing the cubicle single-line diagram, with devices symbolized
- red and green signal lamp blocks to indicate the position of each device:
- □ red vertical bar showing device closed
- green horizontal bar showing device open
- local or remote control selector switch with lock
- circuit breaker open control pushbutton (KD2), active in local or remote mode
- circuit breaker close control pushbutton (KD1), active in local mode only

■ 2 circuit breaker connect (KS1) and disconnect (KS2) control pushbuttons, active in local or remote mode.

There is a 21-pin connector on the back of Sepam 100MI for the connection of:

- supply voltage
- device position indication inputs
- circuit breaker control (open/close and disconnect) outputs.

Sepam 100MI operates with 2 power supply ranges (to be indicated in order):

- 24/30 V AC/DC
- 48/127 V AC/DC.


Note: In the Sepam 100MI mimics on the pages which follow, the position indicators of each device are identified as follows:

- LVi: green indicator showing device number "i " in open position.
- LRI: red indicator showing device number "i" in closed position. These markings do no appear on the front of the device.



Circuit breaker

# Sepam 100 MI Block and connection diagrams

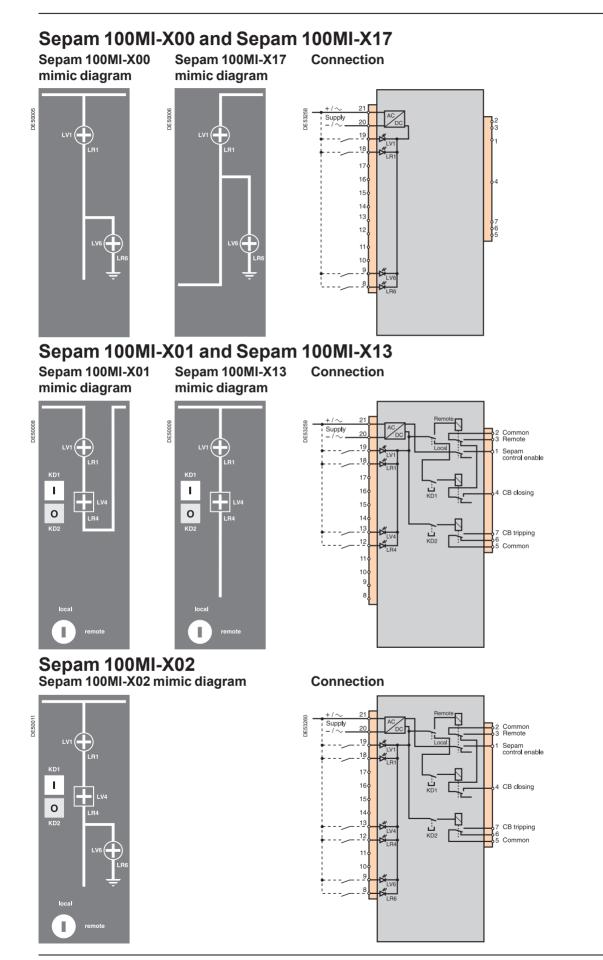

4

# Sepam 100 MI Block and connection diagrams

Commor Remote

Sepam control enable

CB closing

CB tripping Common

Plug in control

Plug out control


## Sepam 100MI-X16 and Sepam 100MI-X18 Sepam 100MI-X16 Sepam 100MI-X18 Connection


Sepam 100MI-X1 mimic diagram

DE50013

I

0





-i KD1

L KD2

KS1


Ν

U


0

Г


Sepam 100MI-X03 Sepam 100MI-X03 mimic diagram



Sepam 100MI-X22 Sepam 100MI-X22 mimic diagram



Connection



DE50000

--)

I.


0

╋


# Sepam 100 MI Block and connection diagrams


# Sepam 100MI-X14


Sepam 100MI-X14 mimic diagram



Sepam 100MI-X15 Sepam 100MI-X15 mimic diagram







# Sepam 100MI-X10, Sepam 100MI-X11 and Sepam 100MI-X12

Sepam 100MI-X10 mimic diagram


DE50020


I.

ο


╉

Sepam 100MI-X11 mimic diagram Sepam 100MI-X12 Connection mimic diagram





Sepam 1 mimic d





4


Other modules


# Sepam 100 MI Characteristics and dimensions

The state of the state						
Electrical ch	aracteristics					
Logic inputs						
Voltage		24/30 V	48/127	V		
Max. consumption p	er input	35 mA	34 mA			
Logic outputs (r	elays)					
Voltage		24/30 V	48/127	V		
Permissible rated cu	urrent	8 A				
Breaking capacity	DC resistive load	4 A	0,3 A			
	AC resistive load	8 A	8 A			
Number of on-load o	operations	10000	10000			
Power supply						
Auxiliary power sour DC or AC current (50 or 60 Hz)	rce	24 to 30 V, -20 % 48 to 127 V, -20 %				
Consumption		24 to 30 V: 7.7 VA max. (at 33 V) 48 V: 4 VA 110 V: 18 VA				
Environment	tal characterist	tics				
Climatic						
Operation		IEC 60068-2		-10 °C to +70 °C		
Storage		IEC 60068-2	-25 °C to +70 °C			
Damp heat		IEC 60068-2		95 % to 40 °C		
Mechanical						
Degree of protectior	ı	IEC 60529	IP51	Front plate		
Vibrations		IEC 60255-21-1	Class I			
Shocks		IEC 60255-21-2	Class I			
Seismic tests		IEC 60255-21-3	Class I			
Fire		NFC 20455	Glow wire 650	°C		
Dielectric						
Power frequency		IEC 60255-4 <sup>(1)</sup>		2 kV - 1 mn		
1.2/50 μs impulse w	ave	IEC 60255-4 <sup>(1)</sup>		5 kV		
Electromagnetic						
Radiation		IEC 60255-22-3	Class X	30 V/m		
Electrostatic dischar	rge	IEC 60255-22-2	Class III			
Damped 1 MHz way	-	IEC 60255-22-1	Class III			
5 ns fast transients	-	IEC 60255-22-4	Class IV			
	8 and amondod in 107					

(1) Published in 1978 and amended in 1979. The "C €" marking on our products guarantees their conformity to European directives.

#### Dimensions

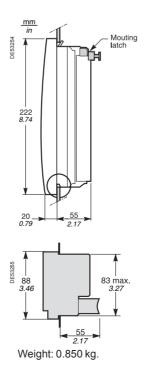

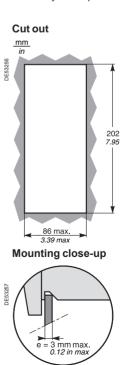

e Merlin Gerin

4

# **Selection guide**

There are 2 types of Sepam communication accessories:

communication interfaces, which are essential for connecting Sepam to the communication network

converters and oth er accessories, as options, which are used for complete implementation of the communication network.

# **Communication-interface selection guide**

		ACE949-2	ACE959	ACE937	ACES	969TP	ACES	969FO	ACE850TP (4)	ACE850FO (4)
Type of netwo	rk									
		S-LAN or E-LAN <sup>(1)</sup>	S-LAN or E-LAN <sup>(1)</sup>	S-LAN or E-LAN <sup>(1)</sup>	S-LAN	E-LAN	S-LAN	E-LAN	S-LAN and E-LAN	S-LAN and E-LAN
Protocol										
Modbus RTU		•			(3)	•	(3)	-		•
DNP3					(3)		(3)			
IEC 60870-5-103					(3)		(3)			
Modbus TCP/IP									(3)	(3)
IEC 61850									(3)	<b>(</b> 3)
Physical inter	face									
RS 485	2-wire					-				
	4-wire		•							
Fiber optic ST	Star			•						
	Ring						(2)			
10/100 base T	1 port									
100 base FX	1 port									
Power supply										
CC		Fournie par Sepam	Fournie par	Fournie par	24 to 25	0 V	24 to 25	50 V	24 to 250 V	24 to 250 V
CA	CA		Sepam	Sepam	110 to 2	40 V	110 to 2	40 V	110 to 240 V	110 to 240 V
See details on	page	182	183	184	185		189			

(1) Only one connection possible, S-LAN or E-LAN.

(2) Except with the Modbus protocol.
(3) Not simultaneously (1 protocol per application).
(4) Soon available for Sepam series 40 and series 80.

# **Converter selection guide**

	ACE909-2	ACE919CA	ACE919CC	EGX100	EGX400	EC1850
Converter						
Physical interface	1 port RS 232	1 port RS 485 port 2-wire	1 port RS 485 port 2-wire	1 Ethernet port 10/100 base T	2 Ethernet ports 10/100 base T 100 base F	1 Ethernet port 10/100 base T
Modbus RTU	(1)	(1)	(1)			
CEI 60870-5-103	(1)	(1)	<b>(</b> 1)			
DNP3	(1)	(1)	(1)			
Modbus TCP/IP				•	•	
CEI 61850						•
To Sepam						
Physical interface	1 port RS 485 2-wire	1 port RS 485 2-wire	1 port RS 485 2-wire	1 port RS 485 2-wire or 4-wire	2 ports RS 485 2-wire or 4-wire	1 port RS 485 2-wire or 4-wire
Distributed power supply RS 485	•	•	•			
Modbus RTU	(1)	(1)	<b>(</b> 1)		•	•
CEI 60870-5-103	(1)	(1)	(1)			
DNP3	(1)	(1)	(1)			
Alimentation						
DC			24 to 48 V	24 V	24 V	24 V
AC	110 to 220 V AC	11to à 220 V AC			100 to 240 V AC (with adapter)	
See details on page	190	192	192	198	199	

(1) The supervisor protocol is the same as the Sepam protocol.

Note: All these interfaces accept the E-LAN protocol.

## Communication interfaces Communication interface connection


## CCA612 connection cord


#### **Plugging into Sepam**

Cord used to connect a communication interface to a Sepam base unit:

- Length = 3 m (9.8 ft)
- Fitted with 2 green RJ45 plugs.

#### Sepam series 20 and Sepam series 40



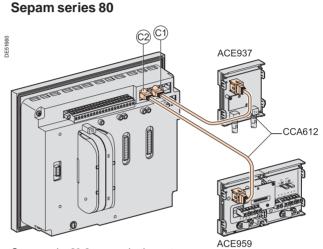

Sepam series 20 and Sepam series 40: 1 communication port.

Sepam series 80: 2 communication ports.

## **Connection to the communication network**

RS 485 network cable	2-wire	4-wire		
RS 485 medium	1 shielded twisted pair	2 shielded twisted pairs		
Distributed power supply	1 shielded twisted pair	1 shielded twisted pair		
Shielding	Tinned copper braid, coverage > 65%			
Characteristic impedance	120 Ω			
Gauge	AWG 24			
Resistance per unit length	< 100 Ω/km (62.1 Ω/mi)			
Capacitance between conductors	< 60 pF/m (18.3 pF/ft)			
Capacitance between conductor and shielding	< 100 pF/m (30.5 pF/ft)			
Maximum length	1300 m (4270 ft)			

Fiber optic				
Fiber type		Graded-index multimode silica		
Wavelength		820 nm (invisib	le infra-red)	
Type of connector		ST (BFOC bay	onet fiber optic connecto	r)
Fiber optic	Numerical	Maximum	Minimum optical	Maximum
diameter (µm)	aperture (NA)	attenuation (dBm/km)	power available (dBm)	fiber length
50/125	0.2	2.7	5.6	700 m (2300 ft)
62.5/125	0.275	3.2	9.4	1800 m (5900 ft)
100/140	0.3	4	14.9	2800 m (9200 ft)
200 (HCS)	0.37	6	19.2	2600 m (8500 ft)


Δ

## Communication interfaces ACE949-2


## ACE949-2 2-wire RS 485 network interface



ACE949-2 2-wire RS 485 network connection interface.



(1) 70 mm (2.8 in) with CCA612 cord connected



#### Function

- The ACE949-2 interface performs 2 functions:
- Electrical interface between Sepam and a 2-wire RS 485 communication
- network

20

25

Main network cable branching box for the connection of a Sepam with a CCA612 cord.

## Characteristics

ACE949-2 module			
Weight		0.1 kg (0.22 lb)	
Assembly		On symmetrical DIN rail	
Operating temperature		-25°C to +70°C (-13°F to	+158°F)
Environmental characteristics		Same characteristics as S	Sepam base units
2-wire RS 485 elect	trical	interface	
Standard		EIA 2-wire RS 485 differe	ential
Distributed power supply	External, 12 V DC or 24 V DC ±10%		/ DC ±10%
Power consumption 16 mA in receiving mode			
		40 mA maximum in sending mode	
Maximum length o	Maximum length of 2-wire RS 485 network		
with standard cabl	е		
Number of Sepam units	Maximum length with 12 V DC power supply		Maximum length with 24 V DC power supply
5	320 m (1000 ft)		1000 m (3300 ft)
10	180 m (590 ft)		750 m (2500 ft)

450 m (1500 ft)

375 m (1200 ft)

## **Description and dimensions**

- (A) and (B) Terminal blocks for network cable
- ©RJ45 socket to connect the interface to the base unit with a CCA612 cord

160 m (520 ft)

125 m (410 ft)

- (+) Grounding/earthing terminal
- Link activity LED, flashes when communication is active (sending or receiving in progress).
- 2 Jumper for RS 485 network line-end impedance matching with load resistor (Rc =  $150 \Omega$ ), to be set to:
  - 🕵, if the module is not at one end of the network (default position)
  - Rc, if the module is at one end of the network.
- 3 Network cable clamps (inner diameter of clamp = 6 mm or 0.24 in).

## Connection

Connection of network cable to screw-type terminal blocks (A) and (B)

■ Connection of the earthing terminal by tinned copper braid with cross-section  $\ge 6 \text{ mm}^2$  (AWG 10) or cable with cross-section  $\ge 2.5 \text{ mm}^2$  (AWG 12) and length  $\le 200 \text{ mm}$  (7.9 in), fitted with a 4 mm (0.16 in) ring lug.


- Check the tightness (maximum tightening torque 2.2 Nm or 19.5 lb-in).
- The interfaces are fitted with clamps to hold the network cable and recover shielding at the incoming and outgoing points of the network cable:
- □ the network cable must be stripped
- □ the cable shielding braid must be around and in contact with the clamp
- The interface is to be connected to connector (C) on the base unit using a CCA612 cord (length = 3 m or 9.8 ft, green fittings)
- The interfaces are to be supplied with 12 V DC or 24 V DC.

4


## ACE959 4-wire RS 485 network interface



ACE959 4-wire RS 485 network connection interface.



(1) 70 mm (2.8 in) with CCA612 cord connected.

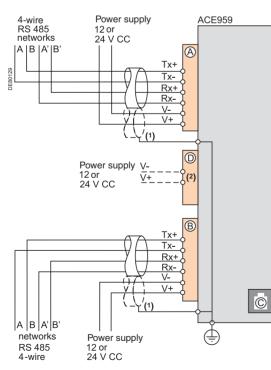

(1) Distributed power supply with separate wiring or included in the shielded cable (3 pairs).

(2) Terminal block for connection of the distributed power supply module.

#### **Function**

The ACE959 interface performs 2 functions:

Electrical interface between Sepam and a 4-wire RS 485 communication network
 Main network cable branching box for the connection of a Sepam with a CCA612 cord.

## Characteristics

#### ACE959 module Weight 0.2 kg (0.441 lb) On symmetrical DIN rail Assembly Operating temperature -25°C to +70°C (-13°F to +158°F) Environmental characteristics Same characteristics as Sepam base units 4-wire RS 485 electrical interface Standard EIA 4-wire RS 485 differential Distributed power supply External, 12 V DC or 24 V DC ±10% Power consumption 16 mA in receiving mode 40 mA maximum in sending mode

## Maximum length of 4-wire RS 485 network with standard cable

with standard cable				
Number of Sepam units	Maximum length with 12 V DC power supply	Maximum length with 24 V DC power supply		
5	320 m (1000 ft)	1000 m (3300 ft)		
10	180 m (590 ft)	750 m (2500 ft)		
20	160 m (520 ft)	450 m (1500 ft)		
25	125 m (410 ft)	375 m (1200 ft)		

## **Description and dimensions**

- (A) and (B) Terminal blocks for network cable
- CRJ45 socket to connect the interface to the base unit with a CCA612 cord
- (D) Terminal block for a separate auxiliary power supply (12 V DC or 24 V DC)
- (⊥)Grounding/earthing terminal
- 1 Link activity LED, flashes when communication is active (sending or receiving in progress).
- 2 Jumper for 4-wire RS 485 network line-end impedance matching with load resistor (Rc = 150  $\Omega$ ), to be set to:
  - 🔆, if the module is not at one end of the network (default position)
  - Rc, if the module is at one end of the network.
- 3 Network cable clamps (inner diameter of clamp = 6 mm or 0.24 in).

## Connection

- Connection of network cable to screw-type terminal blocks (A) and (B)
- Connection of the earthing terminal by tinned copper braid with

cross-section  $\ge 6$  mm<sup>2</sup> (AWG 10) or cable with cross-section  $\ge 2.5$  mm<sup>2</sup> (AWG 12) and length  $\le 200$  mm (7.9 in), fitted with a 4 mm (0.16 in) ring lug.

- Check the tightness (maximum tightening torque 2.2 Nm or 19.5 lb-in).
- The interfaces are fitted with clamps to hold the network cable and recover shielding at the incoming and outgoing points of the network cable:
- □ the network cable must be stripped
- □ the cable shielding braid must be around and in contact with the clamp
- The interface is to be connected to connector C on the base unit using a CCA612 cord (length = 3 m or 9.8 ft. green fittings)
- The interfaces are to be supplied with 12 V DC or 24 V DC
- The ACE959 can be connected to a separate distributed power supply (not

included in shielded cable). Terminal block  $\bigodot$  is used to connect the distributed power supply module.

Merlin Geri

## **ACE937 Fiber optic interface**



ACE937 fiber optic connection interface

#### **A**CAUTION HAZARD OF BLINDING

Never look directly into the end of the fiber optic. Failure to follow this instruction can cause serious injury.

## **Function**

The ACE937 interface is used to connect Sepam to a fiber optic communication star system.

This remote module is connected to the Sepam base unit by a CCA612 cord.

## Characteristics

ACE937 mc	odule			
Weight		0.1 kg (0.22 lb)		
Assembly		On symmetric	al DIN rail	
Power supply		Supplied by Se	epam	
Operating tempera	ature	-25°C to +70°0	C (-13°F to +158°F)	
Environmental cha	aracteristics	Same characte	eristics as Sepam base ur	iits
<b>Fiber optic</b>	interface			
Fiber type		Graded-index	multimode silica	
Wavelength		820 nm (invisible infra-red)		
Type of connector		ST (BFOC bay	onet fiber optic connecto	r)
Fiber optic diameter (µm)	Numerical aperture (NA)	Maximum ttenuation (dBm/km)	Minimum optical power available (dBm)	Maximum fiber length
50/125	0.2	2.7	5.6	700 m (2300 ft)
62.5/125	0.275	3.2	9.4	1800 m (5900 ft)
100/140	0.3	4	14.9	2800 m (9200 ft)
200 (HCS)	0.37	6	19.2	2600 m (8500 ft)

Maximum length calculated with:

Minimum optical power available

Maximum fiber attenuation

Losses in 2 ST connectors: 0.6 dBm

Optical power margin: 3 dBm (according to IEC 60870 standard).


#### Example for a 62.5/125 µm fiber

Lmax = (9.4 - 3 - 0.6)/3.2 = 1.8 km (1.12 mi)

## **Description and dimensions**


(C) RJ45 socket to connect the interface to the base unit with a CCA612 cord.

- 1 Link activity LED, flashes when communication is active (sending or receiving in progress).
  - Rx, female ST type connector (Sepam receiving).
- 2
- 3 Tx, female ST type connector (Sepam sending).



DE80037

(1) 70 mm (2.8 in) with CCA612 cord connected.



#### Connection

■ The sending and receiving fiber optic fibers must be equipped with male ST type connectors

■ Fiber optics screw-locked to Rx and Tx connectors.

The interface is to be connected to connector (C) on the base unit using a CCA612 cord (length = 3 m or 9.8 ft, green fittings).

## ACE969TP and ACE969FO Interfaces network



ACE969TP communication interface.



#### **Function**

The ACE969 multi-protocol communication interfaces are for Sepam series 20, Sepam series 40 and Sepam series 80.

They have two communication ports to connect a Sepam to two independent communication networks:

The S-LAN (Supervisory Local Area Network) port is used to connect Sepam to a communication network dedicated to supervision, using one of the three following protocols:

. IEC 60870-5-103

- DNP3
- □ Modbus RTU.

The communication protocol is selected at the time of Sepam parameter setting. The E-LAN (Engineering Local Area Network) port, reserved for Sepam remote parameter setting and operation using the SFT2841 software.

There are two versions of the ACE969 interfaces, which are identical except for the S-LAN port:

■ ACE969TP (Twisted Pair), for connection to an S-LAN network using a 2-wire RS 485 serial link

■ ACE969FO (Fiber Optic), for connection to an S-LAN network using a fiber-optic connection (star or ring).

The E-LAN port is always a 2-wire RS485 type port.

## Communication interfaces ACE969TP and ACE969FO Interfaces network

Characte	ristics					
ACE969 mo	dule					
Technical char						
Weight		0.285 kg (0.628 lb)				
Assembly		On symmetrical DIN rail				
Operating temperat	ture	-25°C to +70°C (-1	13°F to +1	58°F)		
Environmental chai	racteristics	Same characteris	tics as Se	oam base	units	
Power supply						
Voltage		24 to 250 V DC		110 to 2		
Range		-20%/+10%		-20%/+1	10%	
Maximum consump	otion	2 W		3 VA		
Inrush current		< 10 A 100 µs				
Acceptable ripple c		12% 20 ms				
Acceptable momen						
	85 communio	cation ports				
Electrical inter	face					
Standard		EIA 2-wire RS 485				
Distributed power s		External, 12 V DC		C±10%		
Power consumptior	1	16 mA in receiving	,			
Max. number of Se	namunite	40 mA in sending	noue			
	th of 2-wire RS					
Number of Separ		With distributed	nowersu	nnlv		
Number of Separ	ii anits	12 V DC	power su	24 V DC		
5		320 m (1000 ft)			, (3300 ft)	
10		180 m (590 ft)		750 m (2	, ,	
20		130 m (430 ft)		450 m (*	,	
25		125 m (410 ft)		375 m (*	,	
Fiber optic	communicati	ion port			,	
Fiber optic inte						
Fiber type	inace	Graded-index mu	ltimode sil	ica		
Wavelength		820 nm (invisible i		ica		
Type of connector		· · · · ·	ST (BFOC bayonet fiber optic connector)			
	th of fiber optic					
Fiber diameter	Numerical	Attenuation	Minimu	m	Maximum fiber	
(µm)	aperture (NA)	(dBm/km)	optical j availabl (dBm)		length	
50/125	0.2	2.7	5.6		700 m (2300 ft)	
62.5/125	0.275	3.2	9.4		1800 m (5900 ft)	
100/140	0.3	4	14.9		2800 m (9200 ft	
200 (HCS)	0.37	6	19.2		2600 m (8500 ft	
<ul> <li>Maximum fiber</li> <li>Losses in 2 ST</li> <li>Optical power</li> <li>Example for a 62</li> </ul>	al power availab r attenuation connectors: 0.6	dBm according to IEC 6	60870 sta	ındard).		
Dimensio		. /				
mm in ACE969TP						

<u>144</u> 5.67

DE80043

52 2.04

## ACE969TP and ACE969FO Interfaces network Description


## ACE969 communication interfaces

- 1 Grounding/earthing terminal using supplied braid
- 2 Power-supply terminal block
- 3 RJ45 connector to connect the interface to the base unit with a CCA612 cord
- 4 Green LED: ACE969 energized
- 5 Red LED: ACE969 interface status
   LED off = ACE969 set up and communication operational
  - LED flashing = ACE969 not set up or setup incorrect
  - LED remains on = ACE969 has faulted
- 6 Service connector: reserved for software upgrades7 E-LAN 2-wire RS485 communication port
- (ACE969TP and ACE969FO)
- 8 S-LAN 2-wire RS485 communication port (ACE969TP)
- 9 S-LAN fiber-optic communication port (ACE969FO).
- 1 2-wire RS485 network terminal block:
   2 black terminals: connection of RS485 twistedpair (2 wires)
  - 2 green terminals: connection of twisted-pair for distributed power supply
- 2 Indication LEDs: ■ flashing Tx LED: Sepam sending
  - flashing Rx LED: Sepam receiving.
- 3 Clamps and recovery of shielding for two network cables, incoming and outgoing (inner diameter of clamp = 6 mm)
- 4 Fixing stud for network cable ties
- 5 Jumper for RS485 network line-end impedance matching with load resistor (Rc =  $150 \Omega$ ), to be set to:

Rc, if the interface is not at the line end (default position)

Rc, if the interface is at the line end.


- Indication LEDs:
   flashing Tx LED: Sepam sending
  - flashing Rx LED: Sepam receiving.
- a nashing (X LLD. Separi receiving).
   2 Rx, female ST-type connector (Separ receiving)
- 3 Tx, female ST-type connector (Sepam receiving).

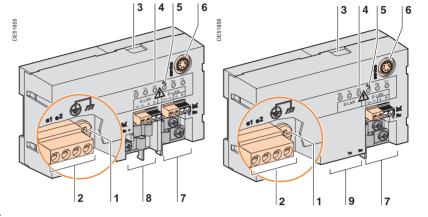

## 2-wire RS485 communication ports


Port S-LAN (ACE969TP)

Port E-LAN (ACE969TP or ACE969FO)

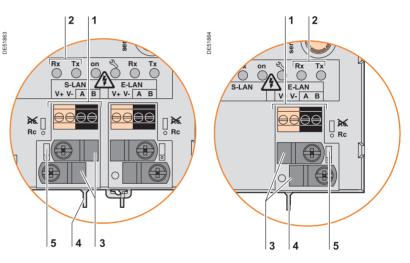

## Fiber-optic communication port

Port S-LAN (ACE969FO)



## ACE969TP and ACE969FO Interfaces network Connection

#### Power supply and Sepam

■ The ACE969 interface connects to connector C on the Sepam base unit using a CCA612 cord (length = 3 m or 9.84 ft, green RJ45 fittings)

■ The ACE969 interface must be supplied with 24 to 250 V DC or 110 to 230 V AC.

## A DANGER

#### HAZARD OF ELECTRIC SHOCK, ELECTRIC ARC OR BURNS


• Only qualified personnel should install this equipment. Such work should be performed only after reading this entire set of instructions and checking the technical characteristics of the device.

- NEVER work alone.
- Turn off all power supplying this equipment before working on or inside it.
- Consider all sources of power, including the possibility of backfeeding.
- Always use a properly rated voltage sensing device to confirm that all power is off.


Start by connecting the device to the protective earth and to the functional earth.

Screw tight all terminals, even those not in use.

Failure to follow these instructions will result in death or serious injury.

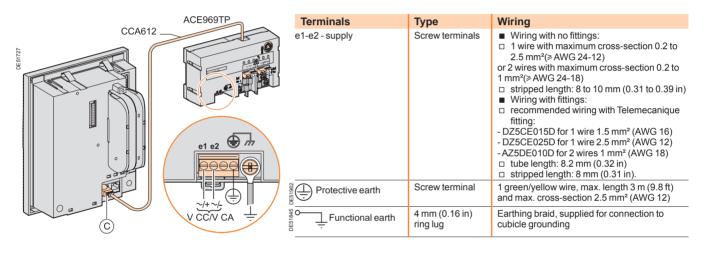


## ACE969TP and ACE969FO Interfaces network Connection

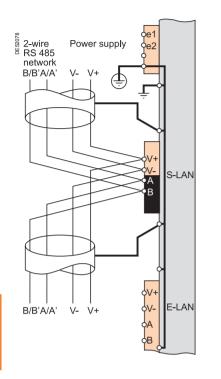

## 2-wire RS 485 communication ports (S-LAN or E-LAN)

- Connection of RS 485 twisted pair (S-LAN or E-LAN) to black terminals A and B Connection of twisted pair for distributed power supply to green terminals V+ and
- V-
- The interfaces are fitted with clamps to hold the network cable and recover shielding at the incoming and outgoing points of the network cable:
- □ the network cable must be stripped
- □ the cable shielding must be around and in contact with the clamp
- □ shielding continuity of incoming and outgoing cables is ensured by the electrical continuity of the clamps
- All cable clamps are linked by an internal connection to the earthing terminals of the ACE969 interface (protective and functional earthing), i.e. the shielding of the RS 485 cables is earthed as well
- On the ACE969TP interface, the cable clamps for the S-LAN and E-LAN RS 485 networks are earthed.

#### Optic star connection



## Fiber optic communication port (S-LAN)

## A CAUTION

HAZARD OF BLINDING

Never look directly into the fiber optic.

Failure to follow this instruction can cause serious injury.

The fiber optic connection can be made:

- point-to-point to an optic star system
- in a ring system (active echo).
- The sending and receiving fiber optic fibers must be equipped with male ST type connectors.

The fiber optics are screw-locked to Rx and Tx connectors.

## ACE909-2 RS 232 / RS 485 converter



## Function

The ACE909-2 converter is used to connect a master/central computer equipped with a V24/RS 232 type serial port as a standard feature to stations connected to a 2-wire RS 485 network.

Without requiring any flow control signals, after the parameters are set, the ACE909-2 converter performs conversion, network polarization and automatic dispatching of frames between the master and the stations by two-way simplex (half-duplex, single-pair) transmission.

The ACE909-2 converter also provides a 12 V DC or 24 V DC supply for the distributed power supply of the Sepam ACE949-2, ACE959 or ACE969 interfaces. The communication settings should be the same as the Sepam and supervisor communication settings.

ACE909-2 RS 232/RS 485 converter.

#### A DANGER

#### HAZARD OF ELECTRIC SHOCK, ELECTRIC ARC OR BURNS

Only qualified personnel should install this equipment. Such work should be performed only after reading this entire set of instructions and checking the technical characteristics of the device.

NEVER work alone.

■ Turn off all power supplying this equipment before working on or inside it. Consider all sources of power, including the possibility of backfeeding.

Always use a properly rated voltage sensing device to confirm that all power is off.

Start by connecting the device to the protective earth and to the functional earth.


 Screw tight all terminals, even those not in use.
 Failure to follow these instructions will result in death or serious injury.


## Characteristics

#### **Mechanical characteristics**


Weight	0.280 kg (0.617 l	b)	
Assembly	On symmetrical or asymmetrical DIN rail		
Electrical characteristics			
Power supply	110 to 220 V AC :	£ 10%, 47 to 63 Hz	
Galvanic isolation between ACE power supply and frame, and between ACE power supply and interface supply	2000 Vrms, 50 H	z, 1 min	
Galvanic isolation between RS 232 and RS 485 interfaces	1000 Vrms, 50 H	z, 1 min	
Protection by time-delayed fuse 5 mm x 20 mm (0.2 in x 0.79 in)	1 A rating		
<b>Communication and Sepam int</b>	erface distri	buted supply	
Data format	11 bits: 1 start, 8	data, 1 parity, 1 stop	
Transmission delay	< 100 ns		
Distributed power supply for Sepam interfaces	12 V DC or 24 V DC		
Maximum number of Sepam interfaces with distributed supply	12		
<b>Environmental characteristics</b>			
Operating temperature	-5°C to +55°C (+2	23°F to +131°F)	
Electromagnetic compatibility	IEC	Value	
	standard		
Fast transient bursts, 5 ns	60255-22-4	4 kV with capacitive coupling in common mode 2 kV with direct coupling in common mode 1 kV with direct coupling in differential mode	
1 MHz damped oscillating wave	60255-22-1	1 kV common mode 0.5 kV differential mode	
1.2/50 µs impulse waves	60255-5	3 kV common mode	

## ACE909-2 RS 232 / RS 485 converter





Male 9-pin sub-D connector supplied with the ACE909-2.

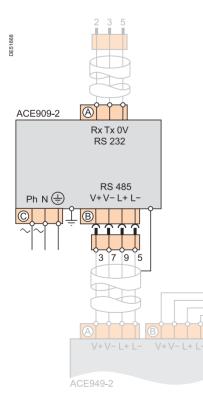

## **Description and dimensions**

- (A) Terminal block for RS 232 link limited to 10 m (33 ft).
- (B) Female 9-pin sub-D connector to connect to the 2-wire RS 485 network, with distributed power supply.
- 1 screw-type male 9-pin sub-D connector is supplied with the converter. (C) Power-supply terminal block
- 1 Distributed power supply voltage selector switch, 12 V DC or 24 V DC.
- 2 Protection fuse, unlocked by a 1/4 turn.
- 3 LEDs:
  - ON/OFF: on if ACE909-2 is energized
    - Tx: on if RS 232 sending by ACE909-2 is active
    - Rx: on if RS 232 receiving by ACE909-2 is active.
- 4 SW1, parameter setting of 2-wire RS 485 network polarization and line impedance matching resistors.

Function	SW1/1	SW1/2	SW1/3
Polarization at 0 V via Rp -470 $\Omega$	ON		
Polarization at 5 V via Rp +470 $\Omega$		ON	
2-wire RS 485 network impedance matching by 150 $\Omega$ resistor			ON

5 SW2, parameter setting of asynchronous data transmission rate and format (same parameters as for RS 232 link and 2-wire RS 485 network).

(					
Rate (bauds)	SW2/1	SW2/2	SW2/3		
1200	1	1	1		
2400	0	1	1		
4800	1	0	1		
9600	0	0	1		
19200	1	1	0		
38400	0	1	0		
Format				SW2/4	SW2/5
With parity check				0	
Without parity check				1	
1 stop bit (compulsory for Sepam)					0
2 stop bits					1

#### Converter configuration when delivered

- 12 V DC distributed power supply
- 11-bit format, with parity check
- 2-wire RS 485 network polarization and impedance matching resistors activated.

## Connection

#### RS 232 link

- To 2.5 mm<sup>2</sup> (AWG 12) screw type terminal block (A)
- Maximum length 10 m (33 ft)
- Rx/Tx: RS 232 receiving/sending by ACE909-2
- OV: Rx/Tx common, do not earth.

#### 2-wire RS 485 link with distributed power supply

- To connector (B) female 9-pin sub-D
- 2-wire RS 485 signals: L+, L-
- Distributed power supply: V+ = 12 V DC or 24 V DC, V- = 0 V.

#### Power supply

- To 2.5 mm<sup>2</sup> (AWG 12) screw type terminal block (C)
- Reversible phase and neutral
- Earthed via terminal block and metal case (ring lug on back of case).



## ACE919CA and ACE919CC RS 485 / RS 485 converters



ACE919CC RS 485/RS 485 converter.

#### A DANGER

#### HAZARD OF ELECTRIC SHOCK, ELECTRIC ARC OR BURNS

Only qualified personnel should install this equipment. Such work should be performed only after reading this entire set of instructions and checking the technical characteristics of the device.

NEVER work alone.

■ Turn off all power supplying this equipment before working on or inside it. Consider all sources of power, including the possibility of backfeeding.

- Always use a properly rated voltage sensing device to confirm that all power is off.
- Start by connecting the device to the

protective earth and to the functional earth.Screw tight all terminals, even those not in

use. Failure to follow these instructions will result

in death or serious injury.

## Function

The ACE919 converters are used to connect a master/central computer equipped with an RS 485 type serial port as a standard feature to stations connected to a 2-wire RS 485 network.

Without requiring any flow control signals, the ACE919 converters perform network polarization and impedance matching.


The ACE919 converters also provide a 12 V DC or 24 V DC supply for the distributed power supply of the Sepam ACE949-2, ACE959 or ACE969 interfaces. There are 2 types of ACE919 converter:


- ACE919CC, DC-powered
- ACE919CA, AC-powered.

#### Characteristics Mechanical characteristics


#### 0.280 kg (0.617 lb) Weight Assembly On symmetrical or asymmetrical DIN rail **Electrical characteristics ACE919CA ACE919CC** 110 to 220 V AC ±10%, 47 to 63 Hz 24 to 48 V DC ±20% Power supply Protection by time-delayed fuse 5 mm x 20 mm 1 A rating 1 A rating (0.2 in x 0.79 in) Galvanic isolation between ACE power supply 2000 Vrms, 50 Hz, and frame, and between ACE power supply 1 min and interface supply Communication and Sepam interface distributed supply Data format 11 bits: 1 start, 8 data, 1 parity, 1 stop Transmission delay < 100 ns Distributed power supply for Sepam 12 V DC or 24 V DC interfaces Maximum number of Sepam interfaces with 12 distributed supply **Environmental characteristics** Operating temperature -5°C to +55°C (+23°F to +131°F) **Electromagnetic compatibility IEC** standard Value Fast transient bursts. 5 ns 60255-22-4 4 kV with capacitive coupling in common mode 2 kV with direct coupling in common mode 1 kV with direct coupling in differential mode 60255-22-1 1 MHz damped oscillating wave 1 kV common mode 0.5 kV differential mode 1.2/50 µs impulse waves 60255-5 3 kV common mode 1 kV differential mode

## ACE919CA and ACE919CC RS 485 / RS 485 converters





Male 9-pin sub-D connector supplied with the ACE919.

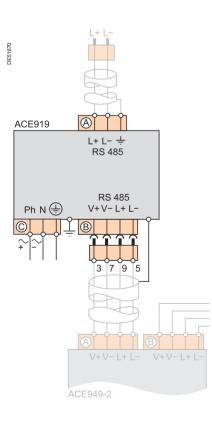

## **Description and dimensions**

- (A) Terminal block for 2-wire RS 485 link without distributed power supply.
- B Female 9-pin sub-D connector to connect to the 2-wire RS 485 network, with distributed power supply.
  - 1 screw-type male 9-pin sub-D connector is supplied with the converter.
- C Power supply terminal block.
- 1 Distributed power supply voltage selector switch, 12 V DC or 24 V DC.
- 2 Protection fuse, unlocked by a 1/4 turn.
- 3 ON/OFF LED: on if ACE919 is energized.
- 4 SW1, parameter setting of 2-wire RS 485 network polarization and line impedance matching resistors.

Function	SW1/1	SW1/2	SW1/3
Polarization at 0 V via Rp -470 $\Omega$	ON		
Polarization at 5 V via Rp +470 $\Omega$		ON	
2-wire RS 485 network impedance matching by 150 $\Omega$ resistor			ON

#### Converter configuration when delivered

- 12 V DC distributed power supply
- 2-wire RS 485 network polarization and impedance matching resistors activated.

#### Connection

- 2-wire RS 485 link without distributed power supply
- To 2.5 mm<sup>2</sup> (AWG 12) screw type terminal block (A)
- L+, L-: 2-wire RS 485 signals
- Shielding

#### 2-wire RS 485 link with distributed power supply

- To connector (B) female 9-pin sub-D
- 2-wire RS 485 signals: L+, L-
- Distributed power supply: V+ = 12 V DC or 24 V DC, V- = 0 V.

#### Power supply

- To 2.5 mm<sup>2</sup> (AWG 12) screw type terminal block C
- Reversible phase and neutral (ACE919CA)
- Earthed via terminal block and metal case (ring lug on back of case).

# Sepam ECI850 server for IEC 61850



Sepam ECI850 server for IEC 61850.

#### **Function**

The ECI850 connects Sepam series 20, Sepam series 40 and Sepam series 80 units to an Ethernet network using the IEC 61850 protocol.

It acts as the interface between the Ethernet/IEC 61850 network and a Sepam RS485/Modbus network.

Two PRI surge arresters (cat. no. 16595) are supplied with the ECI850 to protect its power supply.

## Characteristics


Characteristics	
ECI850 module	
Technical characteristics	
Weight	0.17 kg (0,37 lb)
Assembly	On symmetrical DIN rail
Power supply	
Voltage	24 V DC (±10 %) supplied by a class 2 supply
Maximum consumption	4 W
Dielectric strength	1.5 kV
<b>Environmental characteristi</b>	cs
Operating temperature	-25 °C to +70 °C (-13 °F to +158 °F)
Storage temperature	-40 °C to +85 °C (-40 °F to +185 °F)
Relative humidity	5 to 95 % (without condensation) at +55 °C (131 °F)
Pollution degree	Class 2
Degree of protection	IP30
Electromagnetic compatibil	ity
Emission tests	
Emission (radiated and conducted)	EN 55022/EN 55011/FCC Class A
Immunity tests – Radiated disturba	nces
Electrostatic discharge	EN 61000-4-2
Radiated radio-frequency fields	EN 61000-4-3
Magnetic fields at power frequency	EN 61000-4-8
Immunity tests – Conducted distur	bances
Fast transient bursts	EN 61000-4-4
Surges	EN 61000-4-5
Conducted disturbances, induced by radio- frequency fields	EN 61000-4-6
Safety	
International	CEI 60950
United States	UL 508/UL 60950
Canada	cUL (in compliance with CSA C22.2, no. 60950)
Australia / New Zealand	AS/NZS 60950
Certification	
Europe	CE
2-wire/4-wire RS485 commu	nication ports
Electrical interface	
Standard	EIA 2-wire/4-wire RS485 differential
Max. number of Sepam units	8
Maximum length of 2-wire/4-wire R	S485 network
Number of Sepam units	Maximum length
5	1000 m (3300 ft)
8	750 m (2500 ft)
Ethernet communication po	rt
Number of ports	1
Type of port	10/100 Base Tx
Protocols	HTTP, FTP, SNMP, SNTP, ARP, SFT, IEC 61850 TCP/IP
Transmission rate	10/100 Mbits/s

## Sepam ECI850 server for IEC 61850

## **Characteristics (cont.)**

PRI surge arrester	
Electrical characteristics	
Utilisation voltage	12 to 48 V
Full discharge current	10 kA (8/20 µs wave)
Rated discharge current	5 kA (8/20 μs wave)
Level of protection	70 V
Response time	< 25 ms
Mechanical operation indicator	
White	Normal operation
Red	Arrester must be replaced
Connection	
Tunnel terminals	Wires with maximum cross-section of 0.5 to 2.5 mm <sup>2</sup> (AWG 24-12)

## Description

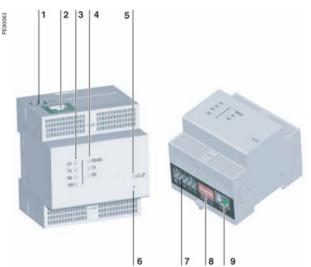

#### **RS485 network setup**

The RS485 setup switches are used to select the network-polarisation (bias) and line-impedance matching resistors and the type of RS485 network (2-wire/4-wire). The default settings are for a 2-wire RS485 with network-polarization and lineimpedance matching resistors.

Line-impedance matching using resistors	SW1	SW2	SW3	SW4	SW5	SW6
2-wire RS485	OFF	ON				
4-wire RS485	ON	ON				
Polarisation (bias)	SW1	SW2	SW3	SW4	SW5	SW6
at 0 V			ON			
at 5 V				ON		
RS485 network type	SW1	SW2	SW3	SW4	SW5	SW6
2-wire					ON	ON
4-wire					OFF	OFF


#### Ethernet link set-up

The TCSEAK0100 configuration kit can be used to connect a PC to the ECI850 to set up the Ethernet link.

- □ On: RS485 mode
- □ Off: RS232 mode
- flashing TX LED: ECI850 sending
- flashing RX LED: ECI850 receiving
- 3 Ethernet LEDs:
  - green LK LED on: link to network activated

I ↓ LED: Power on and maintenance


- flashing green Tx LED: ECI850 sending
- flashing green Rx LED: ECI850 receiving
- green 100 LED:
- □ On: transmission rate = 100 Mbit/s
- □ Off: transmission rate = 10 Mbit/s
- 4 10/100 Base Tx port for Ethernet connection via RJ45 connector
- 5 24 V DC connection
- 6 Reset button
- 7 RS485 connector
- 8 RS485 setup switches
- 9 RS232 connector



RS485 network setup.

# Sepam ECI850 server for IEC 61850

## Dimensions

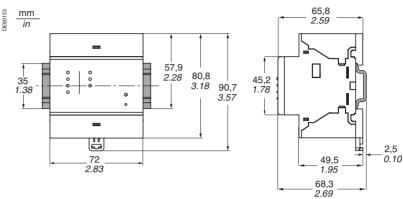

## **A** CAUTION

#### TO AVOID DAMAGING THE ECI850


- Connect the two PRI surge arresters as indicated
- in the diagrams below.
- Check the quality of the earthing conductors connected to the surge arresters.

The equipment may be damaged if these instructions are not followed.

#### Connection


- Connect the supply and the RS485 twisted pair using the  $\leq$  2.5 mm<sup>2</sup> cable ( $\geq$  AWG 12).
- Connect the 24 V DC supply and earth to inputs 1, 5 and 3 on the PRI surge arresters supplied with the ECI850.
- Connect outputs 2 and 6 of PRI surge arresters (cat. no. 16595) to the and + terminals on the terminal block with black screws.
- Connect the RS485 twisted pair (2 or 4 wires) to the terminals (RX+ RX- or RX+ RX-TX+ TX-) on the terminal block with black screws.
- Connect the shielding of the RS485 twisted pair to the ↔ terminal on the terminal block with black screws.
- Connect the Ethernet cable to the green RJ45 connector.

#### 2-wire RS485 network

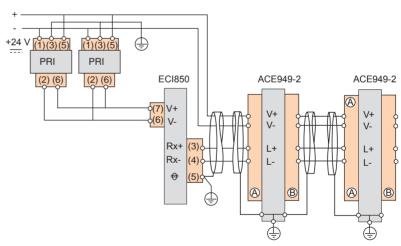

#### 4-wire RS485 network


Merlin Gerin

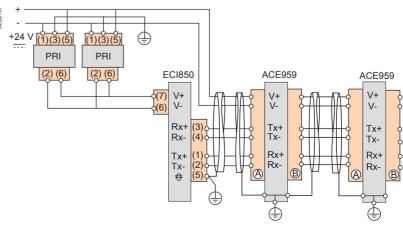



## Sepam ECI850 server for IEC 61850

Architecture example The diagram below shows an example of a communication architecture using the ECI850.

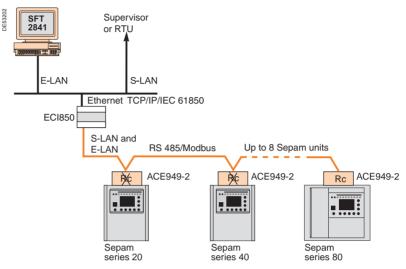

Note: Rc = line-impedance matching resistor.


## **Ethernet EGX100 gateway**

## Readyarent



#### Function

The EGX100 serves as an Ethernet gateway for PowerLogic<sup>®</sup> System devices and for any other communicating devices utilizing the Modbus protocol. The EGX100 gateway offers complete access to status and measurement information provided by the connected devices, for example, via the System Manager<sup>™</sup> Software (SMS) installed on a PC.

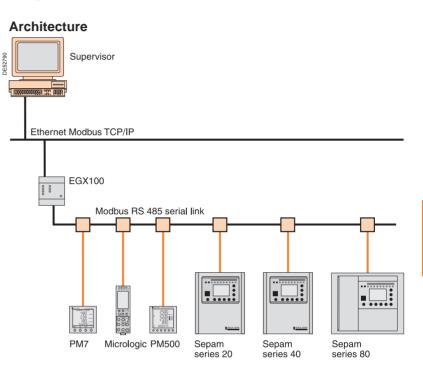

#### Setup

#### Setup via an Ethernet network

Once connected to an Ethernet network, the EGX100 gateway can be accessed by a standard internet browser via its IP address to:

- specify the IP address, subnet mask, and gateway address of the EGX gateway
- configure the serial port parameters (baud rate, parity, protocol, mode, physical interface, and timeout value)
- create user accounts
- create or update the list of the connected products with their Modbus
- communication parameters
- configure IP filtering to control access to serial devices
- access Ethernet and serial port diagnostic data
- update the firmware.

#### Setup via a serial connection

Serial setup is carried out using a PC connected to the EGX100 via an RS232 link. This setup:

- specifies the IP address, subnet mask, and gateway address of the EGX gateway
- specifies the language used for the setup session.

## Ethernet EGX400 server

## Web-enabled Power & Control



Ethernet EGX400 gateway.

#### **Function**

The EGX400 server is used as an Ethernet coupler for Sepam, the PowerLogic devices and for any other communicating devices operating under the Modbus RS 485 protocol.

It contains HTML pages (set up using the WPG software tool) that can be accessed using a standard internet browser. The HTML pages are used to display the information provided by the devices connected to the server.

#### Supervisor and internet browser

- The EGX400 server makes it possible to implement two types of user interface:
- supervision software

a standard internet browser providing access to the main information organised in predefined HTML pages.

These two approaches, supervisor and internet browser, are complementary:

the supervisor offers complete access to all information, but requires specific software

the HTML pages offer partial access to the main information via any PC connected to the network.

# Architecture



....

Setup

#### Initial setup

The initial setup is carried out using a PC connected to the EGX400 via an RS232 link. This setup:

Micrologic

Sepam series 20

Sepam series 40

- specifies the IP address of the EGX gateway
- selects the type of Ethernet port (wire or optic fiber)

PM800


■ lists the connected products with their Modbus communication parameters.

#### Setup via the Ethernet network

Once connected to the Ethernet network, the EGX400 server can be accessed by a standard internet browser via its IP address to:


- create or update the list of the connected products with their Modbus communication parameters
- update the firmware.

## **Ethernet EGX100 gateway** Ethernet EGX400 server



- 24 Vdc power connection.
- 2 10/100 Base TX (802.3af) port for connection to Ethernet via an RJ45 connector. Ethernet and serial indication LEDs.
- 3 4
- Power/Status LED.
- 5 Reset button.6 RS485 connection.
- 7 Dip switches for biasing, termination, and 2-wire/4-wire
- jumpers. 8 RS232 connection.

#### EGX400





- Power connector. 1
- Ethernet indication LEDs. 2
- 3 10/100 Base TX port for connection to Ethernet via an
- R/45 connector.
  100 Base FX port for connection to Ethernet via fiber optic cable (LC connector).
- COM1: terminal block for RS485 serial link. 5
- 6 COM1 indication LEDs.
- COM2: terminal block for RS485 serial link. 7
- 8 COM2 indication LEDs.
- Dip-switches for setup of COM1 and COM2 ports bias and termination. 9
- 10 COM2: Sub D-9 connector for the RS232 serial link.


#### **Characteristics**

Characteristics		
	EGX100	EGX400
Weight	170 g	700 g
Dimensions (H x W x D)	91 x 72 x 68 mm	25 x 190 x 115 mm
Mounting	Din rail	Symmetrical or asymmetrical DIN rail Front or side position
Power-over-Ethernet (PoE)	Class 3	None
Power supply	24 V DC if not using PoE	24 V DC 100-240 V AC/24 V DC adapter supplied
Operating temperature	-25 °C to +70°C	-30 °C to +80 °C
Humidity rating	5 % to 95 % relative humidity (without condensation) at +55 °C	5 % to 95 % relative humidity (without condensation) at +40 °C
Regulatory/standards c	ompliance for electromagn	etic interference
Emissions (radiated and conducted)	EN 55022/EN 55011/ FCC class A	EN 55022/FCC class A
Immunity for industrial environments:	EN 61000-6-2	EN 61000-6-2
- electrostatic discharge	EN 61000-4-2	EN 61000-4-2
- radiated RF	EN 61000-4-3	EN 61000-4-3
- electrical fast transients	EN 61000-4-4	EN 61000-4-4
- surge	EN 61000-4-5	EN 61000-4-5
- conducted RF	EN 61000-4-6	EN 61000-4-8
- power frequency magnetic field	EN 61000-4-8	EN 61000-4-11
Regulatory/standards c	ompliance for safety	
International (CB scheme)	IEC 60950	
USA	UL508/UL60950	UL508
Canada	cUL (complies with CSA C22.2, no. 60950)	cUL (complies with CSA C22.2, no. 14-M91)
Europe	EN 60950	
Australia/New Zealand	AS/NZS25 60950	
Serial ports		
Number of ports	1	2
Types of ports	RS232 or RS485 (2-wire or 4- wire), depending on settings	COM1: RS485 (2-wire or 4-wire) COM2: RS232 or RS485 (2-wire or 4-wire), depending on settings
Protocol	Modbus RTU/ASCII PowerLogic <sup>®</sup> (SY/MAX)	Modbus RTU/ASCII PowerLogic <sup>®</sup> (SY/MAX)
Maximum baud rate	38400 or 57600 baud depending on settings	38400 baud
Maximum number of directly connected devices	32	32 per port, 64 in all
Ethernet port		
Number of ports	1	2
Types of ports	One 10/100 base TX (802.3af) port	One 10/100 base TX port One 100 base FX port (multimode optic fiber)
Protocol	HTTP, SNMP, FTP, Modbus TCP/IP	HTTP, SNMP, SMTP, SNTP, FTP, Modbus TCP/IP
Baud rate	10/100 MB	10/100 MB
Web server		
Memory for custom HTML pages	None	16 MB

## Ethernet EGX100 gateway Ethernet EGX400 server

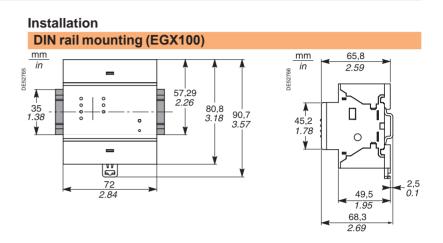

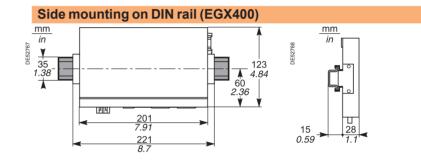


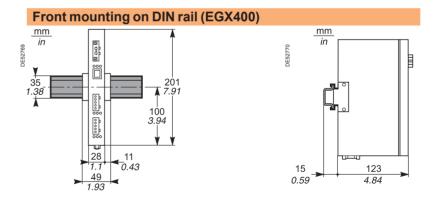


## WPG software tool HTML page generator

Hurlin Garle Agears D	Schneider	Unit Sub A2			
	enconc.	Monitoring	Dispecta	Internetice	
ingle Desice Pages Select a device	Circuit Summa	ry			10-15-200
	Transformer	Ph.A	PLB	Ph.C	Fan Status
Chronit	Model 98	22	33	32	OFF
Demand Current Power	Circuit	FMS Current (Amps) 3 phase Avg.	Real Power (KW)	Power Factor	Breaker
Energy	Type P	269	99	1.00	closed
	CM2450	95	74	0.88 lag	
	CM2000	425	1490	0.46 lag	
	CM4000-4	22	9	0.93 lag	
	CM4000-40	110	42	0.93 lag	
	Separn M41	409	-6723	+0.5	
	Sepam 520	874			closed
	PM620	0	0	1.00	-
	PM650	69	-8	0.32 lag	
	PM500	55	12.39	0.59	
	PM300	82	-85540	-0.63	****
	PM850	222	115	0.59 lag	
	Energy Meter	1.07	0.08	0.63	-

HTML page with summary information on all the equipment in a switchboard.



Single device operating information HTML page.



Single device HTML page showing historical data.

#### Function

Very easy to use, the WPG software tool generates  $\mbox{HTML}$  pages for the EGX400 server. It is used to:

- select the devices connected to the server
- transfer the HTML pages corresponding to the selected devices to the server.

The WPG tool can set up HTML pages for the following devices:

- Sepam series 20, Sepam series 40, Sepam series 80 and Sepam 2000
- Masterpact equipped with Micrologic A, P and H control units
- Power Meter PM500, PM700 and PM800
- Circuit Monitor Series 2000, 3000 and 4000.

The WPG tool is PC software that can be used in three languages, French, Spanish and English.

To obtain WPG, contact your Schneider Electric representative.

#### **HTML** pages

Following transfer, the EGX400 contains HTML pages that can be used to remotely monitor equipment under secure conditions.

- 1<sup>st</sup> service level based on the summary pages.
- 2<sup>nd</sup> service level based on specific pages for each type of device.

#### Summary pages

Five summary pages are available for overall monitoring of the switchboard. They present the main measurements recorded by the devices connected to the server.

- Page 1
- □ 3-phase average rms current
- □ active power
- power factor
- □ circuit-breaker position
- Page 2
- □ rms current per phase
- Page 3
- demand current per phase
- Page 4
- demand power
- peak power
- time-stamping data
- Page 5
- □ active power
- □ reactive power

□ date and time of last reset of energy meters.

#### Specific pages for each device

A number of specific pages present detailed information on each device for in-depth analysis, e.g.:

- operating information:
- □ instantaneous current per phase
- demand current per phase
- active and reactive power
  - □ average voltage (phase-to-neutral and phase-to-phase)
  - □ maximum unbalance
  - □ power factor
  - □ frequency
- event information:
- minimum and maximum current values
- maximum demand current
- □ date and time of last reset
- historical data:

□ recording over 38 days of three user-selectable parameters (energy by default), every 15, 30 or 60 minutes, with graphic display and data export to an Excel file.

201

## **Selection guide**

#### Phase current sensors

- Two types of sensor may be used with Sepam to measure phase current:
- 1 A or 5 A current transformers
- LPCT (Low Power Current Transducer) type current sensors.

#### **Selection guide**

1 A or 5 A current sensors are:

- to be sized case by case: accuracy, electrical characteristics, etc.
- defined according to the IEC 60044-1 standard.

#### The LPCT type current sensors are:

simple to size: a given LPCT sensor is suitable for the measurement of different rated currents: for example, the CLP1 sensor measures rated currents of 25 to 1250 A

■ defined according to the IEC 60044-8 standard

(rated secondary voltage = 22.5 mV).

#### **Residual current sensors**

The residual current value may be obtained using different sensors and assemblies, which are chosen according to the required performance (measurement accuracy and earth fault protection sensitivity).

- Residual current may be:
- measured by a specific CSH120 or CSH200 core balance CT

■ measured by a core balance CT with a ratio of 1/n ( $50 \le n \le 1500$ ), with an ACE990 adapter.

calculated by Sepam from the vector sum of the 3 phase currents.

#### Selection guide

Measurement sensors	Accuracy	Recommended minimum set point	Easy assembly
CSH120 or CSH200 core balance CT	***	>1A	*
1 or 3 x 1 A or 5 A CT+ CSH30	**	0.10 InCT (DT) 0.05 InCT (IDMT)	**
Core balance CT + ACE990	**	0.10 InCT (DT) 0.05 InCT (IDMT)	** revamping * new
3 phase CT (I0 calculated by Sepam)	*	0.30 InCT (DT) <sup>(1)</sup> 0.10 InCT (IDMT) <sup>(1)</sup>	***

(1) Recommended minimum set point for ANSI 50N/51N function with H2 restraint: 0.10 InCT (DT) or 0.05 InCT (IDMT).

It is advisable not to set the earth fault protection functions below the recommended minimum set point to avoid any risk of unwanted tripping caused by oversensitive detection of residual current or false residual current due to the saturation of a CT. Lower settings may be used to trigger alarms.

## Voltage transformers

05873



VRQ3 without fuses.



VRQ3 with fuses.

#### **Function**

Sepam may be connected to any standard voltage transformer with a rated secondary voltage of 100 V to 220 V.

Schneider Electric offers a range of voltage transformers:

to measure phase-to-neutral voltages: voltage transformers with one insulated MV terminal

■ to measure phase-to-phase voltages: voltage transformers with two insulated MV terminals

with or without integrated protection fuses.

Consult us for more information.

## Connection

The voltage transformers connect to Sepam:

■ directly, for Sepam series 40 and Sepam series 80

■ or via the CCT640 connector for Sepam B21, B22 and the additional voltage inputs for Sepam B83.

The table below presents the different connection possibilities for voltage transformers to Sepam.

	Sepam B21 and B22	Sepam series 40	Sepam series 80	
Number of voltage inputs	4	3	4 main	4 additional <sup>(1)</sup>
Intermediate connector	CCT640	-	-	CCT640
Sepam connector	В	E	E	B2

(1) Sepam B83 only.

when voltage transformers are connected directly to the E connector on Sepam, four transformers built into the Sepam base unit ensure matching and isolation between the VTs and the Sepam input circuits.

When voltage transformers are connected via the CCT640 connector, the four transformers for matching and isolation between the VTs and the Sepam input circuits are contained in the CCT640.

## 1 A / 5 A current transformers

058731N



ARJA1.

NELASO

ARJP3.

#### Function

Sepam may be connected to any standard 1 A or 5 A current transformer. Schneider Electric offers a range of current transformers to measure primary currents from 50 A to 2500 A. Consult us for more information.

## Sizing of current transformers

Current transformers are sized so as not to be saturated by the current values they are required to measure accurately (minimum 5 ln).

#### For overcurrent protection functions

with DT tripping curve:


the saturation current must be 1.5 times greater than the setting

with IDMT tripping curve: the saturation current must be 1.5 times greater than the highest working value on the curve.

#### Practical solution when there is no information on the settings

Rated secondary current (in)	Accuracy burden	Accuracy class	CT secondary resistance R <sub>ct</sub>	Wiring resistance R <sub>r</sub>
1 A	2.5 VA	5P 20	<3Ω	< 0.075 Ω
5A	7.5 VA	5P 20	< 0.2 Ω	< 0.075 Ω

## 1A/5A current transformers




## CCA630/CCA634 connector

#### Function

The current transformers (1 A or 5 A) are connected to the CCA630 or CCA634 connector on the rear panel of Sepam:

The CCA630 connector is used to connect 3 phase current transformers to Sepam
 The CCA634 connector is used to connect 3 phase current transformers and a residual current transformer to Sepam.

The CCA630 and CCA634 connectors contain interposing ring CTs with through primaries, which ensure impedance matching and isolation between the 1 A or 5 A circuits and Sepam when measuring phase and residual currents. The connectors can be disconnected with the power on since disconnection does not open the CT secondary circuit.



#### 

HAZARD OF ELECTRIC SHOCK, ELECTRIC ARC OR BURNS

Only qualified personnel should install this equipment. Such work should be performed only after reading this entire set of instructions and checking the technical characteristics of the device.

NEVER work alone.


Turn off all power supplying this equipment before working on or inside it.

Consider all sources of power, including the possibility of backfeeding. Always use a properly rated voltage sensing device to confirm that all power is off.

To remove current inputs to the Sepam unit, unplug the CCA630 or CCA634 connector without disconnecting the wires from it. The CCA630 and CCA634 connectors ensure continuity of the current transformer secondary circuits.
 Before disconnecting the wires connected to the CCA630 or CCA634 connector, short-circuit the current transformer secondary circuits.

Failure to follow these instructions will result in death or serious injury.

## 1A/5A current transformers



#### Connecting and assembling the CCA630 connector


1. Open the 2 side shields for access to the connection terminals. The shields can be removed, if necessary, to make wiring easier. If removed, they must be replaced after wiring.

2. If necessary, remove the bridging strap linking terminals 1, 2 and 3. This strap is supplied with the CCA630.

3. Connect the wires using 4 mm (0.16 in) ring lugs and check the tightness of the 6 screws that guarantee the continuity of the CT secondary circuits.

The connector accommodates wires with cross-sections of 1.5 to 6 mm<sup>2</sup>

- (AWG 16-10).
- 4. Close the side shields.
- 5. Plug the connector into the 9-pin inlet on the rear panel (item (B)).
- 6. Tighten the 2 CCA630 connector fastening screws on the rear panel of Sepam.



Prideira of forming to

Bridging of terminals 1, 2, 3 and 9

Bridging of terminals 1, 2 and 3

## Connecting and assembling the CCA634 connector

1. Open the 2 side shields for access to the connection terminals. The shields can be removed, if necessary, to make wiring easier. If removed, they must be replaced after wiring.

 According to the wiring required, remove or reverse the bridging strap. This is used to link either terminals 1, 2 and 3, or terminals 1, 2, 3 and 9 (see picture opposite).
 Use terminal 7 (1 A) or 8 (5 A) to measure the residual current according to the CT

secondary.

4. Connect the wires using 4 mm (0.16 in) ring lugs and check the tightness of the 6 screws that guarantee the continuity of the CT secondary circuits.

The connector accommodates wires with cross-sections of 1.5 to 6 mm<sup>2</sup> (AWG 16-10).

The wires only exit from the base.

- 5. Close the side shields.
- 6. Insert the connector pins into the slots on the base unit.

7. Flatten the connector against the unit to plug it into the 9-pin SUB-D connector (principle similar to that of the MES module).

8. Tighten the mounting screw.

#### A CAUTION HAZARD OF IMPROPER OPERATION

#### Sepam series 20, Sepam series 40

 Do not connect the connector A residual current input I0 (terminals 18 and 19) and the CCA634 residual current input (terminal 9 and 7 or 8) simultaneously.

These 2 residual current input use the same Sepam analog channel.

#### Sepam series 80

■ Do not use a CCA634 on connector B1 and residual current input I0 on connector E (terminals 14 and 15) simultaneously. Even if it is not connected to a sensor, a CCA634 on connector B1 will disturb input I0 on connector E.


■ Do not use a CCA634 on connector B2 and residual current input I'0 on connector E (terminals 17 and 18) simultaneously. Even if it is not connected to a sensor, a CCA634 on connector B2 will disturb input I'0 on connector E.

Failure to follow this instruction can causeequipment damage.

## LPCT type current sensors



CLP1 LPCT sensor

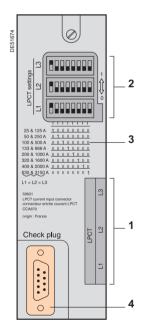

## 

#### HAZARD OF NON-OPERATION ■ Set the microswitches for the CCA670/

CCA671 connector before commissioning the device.

■ Check that only one microswitch is in position 1 for each block L1, L2, L3 and that no microswitch is in the center position.

Check that the microswitch settings on all 3 blocks are identical.

Failure to follow these instructions can cause incorrect operation.

#### **Function**

Low Power Current Transducer (LPCT) type sensors are voltage-output sensors, which are compliant with the IEC 60044-8 standard. The Merlin Gerin range of LPCTs includes the following sensors: CLP1, CLP2, CLP3, TLP160 and TLP190.

# CCA670/CCA671 connector

#### Function

The 3 LPCT sensors are connected to the CCA670 or CCA671 connector on the rear panel of Sepam.

The connection of only one or two LPCT sensors is not allowed and causes Sepam to go into fail-safe position.

The two CCA670 and CCA671 interface connectors serve the same purpose, the difference being the position of the LPCT sensor plugs:

- CCA670: lateral plugs, for Sepam series 20 and Sepam series 40
- CCA671: radial plugs, for Sepam series 80.

#### Description

- 1 3 RJ45 plugs to connect the LPCT sensors.
- 2 3 blocks of microswitches to set the CCA670/CCA671 to the rated phase current value.
- Microswitch setting/selected rated current equivalency table (2 In values per position).
- 4 9-pin sub-D connector to connect test equipment (ACE917 for direct connector or via CCA613).

#### Rating of CCA670/CCA671 connectors

The CCA670/CCA671 connector must be rated according to the rated primary current In measured by the LPCT sensors. In is the current value that corresponds to the rated secondary current of 22.5 mV. The possible settings for In are (in A): 25, 50, 100, 125, 133, 200, 250, 320, 400, 500, 630, 666, 1000, 1600, 2000, 3150. The selected In value should be:

- entered as a Sepam general setting
- configured by microswitch on the CCA670/CCA671 connector.

#### Operating mode:

1. Use a screwdriver to remove the shield located in the "LPCT settings" zone; the shield protects 3 blocks of 8 microswitches marked L1, L2, L3.

2. On the L1 block, set the microswitch for the selected rated current to "1" (2 In values per microswitch).


■ The table of equivalencies between the microswitch settings and the selected rated current In is printed on the connector

■ Leave the 7 other microswitches set to "0".

3. Set the other 2 blocks of switches L2 and L3 to the same position as the L1 block and close the shield.

## **LPCT type current sensors** Test accessories

4

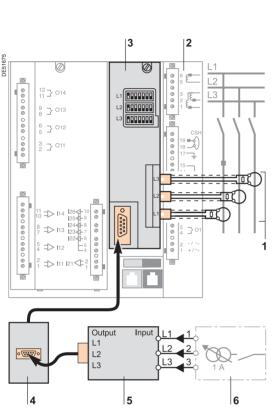

## Accessory connection principle


A DANGER

- HAZARD OF ELECTRIC SHOCK, ELECTRIC ARC OR BURNS
   Only qualified personnel should install this equipment. Such work should be
- performed only after reading this entire set of instructions.
- NEVER work alone.
- Turn off all power supplying this equipment before working on or inside it.
- Consider all sources of power, including the possibility of backfeeding.
- Always use a properly rated voltage sensing device to confirm that all power is off.

Failure to follow these instructions will result in death or serious injury.

- 1 LPCT sensor, equipped with a shielded cable fitted with a yellow RJ 45 plug which is plugged directly into the CCA670/CCA671 connector.
- 2 Sepam protection unit.
- 3 CCA670/CCA671 connector, LPCT voltage interface, with microswitch setting of rated current:
  - CCA670: lateral plugs, for Sepam series 20 and Sepam series 40
     CCA671: radial plugs, for Sepam series 80.
- 4 CCA613 remote test plug, flush-mounted on the front of the cubicle and equipped with a 3-meter (9.84 ft) cord to be plugged into the test plug of the CCA670/ CCA671 interface connector (9-pin sub-D).
- 5 ACE917 injection adapter, to test the LPCT protection chain with a standard injection box.
- 6 Standard injection box.

## LPCT type current sensors Test accessories



## ACE917 injection adapter


#### Function

The ACE917 adapter is used to test the protection chain with a standard injection box, when Sepam is connected to LPCT sensors.

- The ACE917 adapter is inserted between: The standard injection box
- The standard injects
   The LPCT test plug:
- □ integrated in the Sepam CCA670/CCA671 interface connector
- □ or transferred by means of the CCA613 accessory.
- The following are supplied with the ACE917 injection adapter:
- Power supply cord
- 3-meter (9.84 ft) cord to connect the ACE917 to the LPCT test plug on CCA670/CCA671 or CCA613.

#### Characteristics

Power supply	115/230 V AC
Protection by time-delayed fuse 5 mm x 20 mm $(0.2 \times 0.79 \text{ in })$	0.25 A rating




Accessory connection principle


## CCA613 remote test plug

#### Function


The CCA613 test plug, flush-mounted on the front of the cubicle, is equipped with a 3-meter (9.84 ft) cord to transfer data from the test plug integrated in the CCA670/CCA671 interface connector on the rear panel of Sepam.


#### Dimensions





Front view with cover lifted.

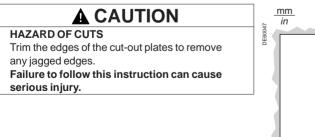



Cut-out.

## CSH120 and CSH200 Core balance CTs



CSH120 and CSH200 core balance CTs.


## **Function**

The specifically designed CSH120 and CSH200 core balance CTs are for direct residual current measurement. The only difference between them is the diameter. Due to their low voltage insulation, they can only be used on cables.

## **Characteristics**

	CSH120	CSH200
Inner diameter	120 mm (4.7 in)	200 mm (7.9 in)
Weight	0.6 kg (1.32 lb)	1.4 kg (3.09 lb)
Accuracy	±5% at 20°C (68°F)	
	±6% max. from -25°C to 70°C (-13°F to +158°F)	
Transformation ratio	1/470	
Maximum permissible current	20 kA - 1 s	
Operating temperature	-25°C to +70°C (-13°F to +158°F)	
Storage temperature	-40°C to +85°C (-40°F to +185°F)	

## **Dimensions**

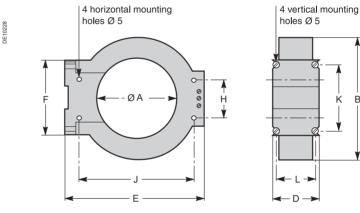

Dimensions	Α	В	D	Е	F	н	J	К	L
CSH120	120	164	44	190	76	40	166	62	35
(in)	(4.75)	(6.46)	(1.73)	(7.48)	(2.99)	(1.57)	(6.54)	(2.44)	(1.38)
CSH200	200	256	46	274	120	60	257	104	37
(in)	(7.87)	(10.1)	(1.81)	(10.8)	(4.72)	(2.36)	(10.1)	(4.09)	(1.46)



## CSH120 and CSH200 Core balance CTs

#### A DANGER

HAZARD OF ELECTRIC SHOCK, ELECTRIC ARC OR BURNS

Only qualified personnel should install this equipment. Such work should be performed only after reading this entire set of instructions and checking the technical characteristics of the device.

NEVER work alone.

■ Turn off all power supplying this equipment before working on or inside it. Consider all sources of power, including the possibility of backfeeding.

Always use a properly rated voltage sensing device to confirm that all power is off.

■ Only CSH120, CSH200 and CSH280 core balance CTs can be used for direct residual current measurement. Other residual current sensors require the use of an intermediate device, CSH30, ACE990 or CCA634.

■ Install the core balance CTs on insulated cables.

 Cables with a rated voltage of more than 1000 V must also have an earthed shielding.


Failure to follow these instructions will result in death or serious injury.

## **A** CAUTION

HAZARD OF NON-OPERATION Do not connect the secondary circuit of the CSH core balance CTs to earth.

This connection is made in Sepam.

Failure to follow this instruction can cause Sepam to operate incorrectly.



#### Assembly


Group the MV cable (or cables) in the middle of the core balance CT. Use non-conductive binding to hold the cables.

Remember to insert the 3 medium voltage cable shielding earthing cables through the core balance CT.



Assembly on MV cables





Assembly on mounting plate.

## Connection

#### Connection to Sepam series 20 and Sepam series 40

To residual current I0 input, on connector (A), terminals 19 and 18 (shielding). Connection to Sepam series 80

- To residual current I0 input, on connector (E), terminals 15 and 14 (shielding)
- To residual current I'0 input, on connector (E), terminals 18 and 17 (shielding).

#### Recommended cable

- Sheathed cable, shielded by tinned copper braid
- Minimum cable cross-section 0.93 mm<sup>2</sup> (AWG 18)
- Resistance per unit length < 100 m $\Omega$ /m (30.5 m $\Omega$ /ft)
- Minimum dielectric strength: 1000 V (700 Vrms)
- Connect the cable shielding in the shortest manner possible to Sepam

Flatten the connection cable against the metal frames of the cubicle. The connection cable shielding is grounded in Sepam. Do not ground the cable by any other means.

The maximum resistance of the Sepam connection wiring must not exceed 4  $\Omega$  (i.e. 20 m maximum for 100 m $\Omega$ /m or 66 ft maximum for 30.5 m $\Omega$ /ft).

## CSH30 Interposing ring CT



Vertical assembly of CSH30 interposing ring CT.



Horizontal assembly of CSH30 interposing ring CT.


## Function

The CSH30 interposing ring CT is used as an interface when the residual current is measured using 1 A or 5 A current transformers.

#### **Characteristics**

Weight	0.12 kg (0.265 lb)
Assembly	On symmetrical DIN rail In vertical or horizontal position

## Dimensions




## Connection

The CSH30 is adapted for the type of current transformer, 1 A or 5 A, by the number of turns of the secondary wiring through the CSH30 interposing ring CT: 5 A rating - 4 turns


1 A rating - 2 turns

#### Connection to 5 A secondary circuit

CT 1 A : 2 turns CT 5 A : 4 turns




212



1. Plug into the connector.

2. Insert the transformer secondary wire through the CSH30 interposing ring CT 4 times.

#### Connection to 1 A secondary circuit



1. Plug into the connector.

2. Insert the transformer secondary wire through the CSH30 interposing ring CT twice.

#### Connection to Sepam series 20 and Sepam series 40

To residual current I0 input, on connector (A), terminals 19 and 18 (shielding). Connection to Sepam series 80

- To residual current I0 input, on connector (E), terminals 15 and 14 (shielding)
- To residual current I'0 input, on connector (E), terminals 18 and 17 (shielding).

#### Recommended cable

- Sheathed cable, shielded by tinned copper braid
- Minimum cable cross-section 0.93 mm<sup>2</sup> (AWG 18) (max. 2.5 mm<sup>2</sup>, AWG 12)
- Resistance per unit length < 100 m $\Omega$ /m (30.5 m $\Omega$ /ft)
- Minimum dielectric strength: 1000 V (700 Vrms)
- Maximum length: 2 m (6.6 ft).

It is essential for the CSH30 interposing ring CT to be installed near Sepam (Sepam - CSH30 link less than 2 m (6.6 ft) long).

Flatten the connection cable against the metal frames of the cubicle.

The connection cable shielding is grounded in Sepam. Do not ground the cable by any other means.

## ACE990 Core balance CT interface



ACE990 core balance CT interface.

## Function

The ACE990 is used to adapt measurements between an MV core balance CT with a ratio of  $1/n (50 \le n \le 1500)$ , and the Sepam residual current input.


## **Characteristics**

Weight	0.64 kg (1.41 lb)
Assembly	Mounted on symmetrical DIN rail
Amplitude accuracy	±1%
Phase accuracy	< 2°
Maximum permissible current	20 kA - 1 s (on the primary winding of an MV core balance CT with a ratio of 1/50 that does not saturate)
Operating temperature	-5°C to +55°C (+23°F to +131°F)
Storage temperature	-25°C to +70°C (-13°F to +158°F)

## **Description and dimensions**


(E) ACE990 input terminal block, for connection of the core balance CT.

SACE990 output terminal block, for connection of the Sepam residual current.



4

## ACE990 Core balance CT interface



#### Connection

#### Connection of core balance CT

Only one core balance CT can be connected to the ACE990 interface. The secondary circuit of the MV core balance CT is connected to 2 of the 5 ACE990 interface input terminals. To define the 2 input terminals, it is necessary to know the following:

- Core balance CT ratio (1/n)
- Core balance CT power
- Close approximation of rated current In0

(In0 is a general setting in Sepam and defines the earth fault protection setting range between 0.1 In0 and 15 In0).

The table below can be used to determine:

The 2ACE990 input terminals to be connected to the MV core balance CT secondary

The type of residual current sensor to set

■ The exact value of the rated residual current In0 setting, given by the following formula: **In0 = k x number of core balance CT turns** with k the factor defined in the table below.

The core balance CT must be connected to the interface in the right direction for correct operation: the MV core balance CT secondary output terminal S1 must be connected to the terminal with the lowest index (Ex).

K value	ACE990 input terminals to be connected	Residual current sensor setting	Min. MV core balance CT power
0.00578	E1 - E5	ACE990 - range 1	0.1 VA
0.00676	E2 - E5	ACE990 - range 1	0.1 VA
0.00885	E1-E4	ACE990 - range 1	0.1 VA
0.00909	E3 - E5	ACE990 - range 1	0.1 VA
0.01136	E2 - E4	ACE990 - range 1	0.1 VA
0.01587	E1-E3	ACE990 - range 1	0.1 VA
0.01667	E4 - E5	ACE990 - range 1	0.1 VA
0.02000	E3 - E4	ACE990 - range 1	0.1 VA
0.02632	E2 - E3	ACE990 - range 1	0.1 VA
0.04000	E1-E2	ACE990 - range 1	0.2 VA
0.05780	E1 - E5	ACE990 - range 2	2.5 VA
0.06757	E2 - E5	ACE990 - range 2	2.5 VA
0.08850	E1-E4	ACE990 - range 2	3.0 VA
0.09091	E3 - E5	ACE990 - range 2	3.0 VA
0.11364	E2 - E4	ACE990 - range 2	3.0 VA
0.15873	E1-E3	ACE990 - range 2	4.5 VA
0.16667	E4 - E5	ACE990 - range 2	4.5 VA
0.20000	E3-E4	ACE990 - range 2	5.5 VA
0.26316	E2-E3	ACE990 - range 2	7.5 VA

#### Connection to Sepam series 20 and Sepam series 40

To residual current I0 input, on connector (A), terminals 19 and 18 (shielding).

**Connection to Sepam series 80** 

- To residual current I0 input, on connector (E), terminals 15 and 14 (shielding)
- To residual current I'0 input, on connector E, terminals 18 and 17 (shielding).

#### Recommended cables

Cable between core balance CT and ACE990: less than 50 m (160 ft) long
 Sheathed cable, shielded by tinned copper braid between the ACE990 and

Sepam, maximum length 2 m (6.6 ft)

- Cable cross-section between 0.93 mm<sup>2</sup> (AWG 18) and 2.5 mm<sup>2</sup> (AWG 12)
- Resistance per unit length less than 100 m $\Omega$ /m (30.5 m $\Omega$ /ft)
- Minimum dielectric strength: 100 Vrms.

Connect the connection cable shielding in the shortest manner possible (2 cm or 5.08 in maximum) to the shielding terminal on the Sepam connector. Flatten the connection cable against the metal frames of the cubicle. The connection cable shielding is grounded in Sepam. Do not ground the cable by

any other means.

#### Example:

Given a core balance CT with a ratio of 1/400 2 VA, used within a measurement range of 0.5 A to 60 A.

- How should it be connected to Sepam via the ACE990? 1. Choose a close approximation of the rated current In0, i.e. 5A.
- 2. Calculate the ratio:
- approx. In0/number of turns = 5/400 = 0.0125.
- 3. Find the closest value of k in the table opposite to k = 0.01136.
- 4. Check the mininum power required for the core balance CT: 2 VA core balance CT > 0.1 VA V OK.
- 5. Connect the core balance CT secondary to ACE990 input terminals E2 and E4.
  6. Set Separn up with:
- $ln0 = 0.01136 \times 400 = 4.5 A.$

This value of In0 can be used to monitor current between 0.45 A and 67.5 A.

- Wiring of MV core balance CT secondary circuit:
- S1 output to ACE990 E2 input terminal
- S2 output to ACE990 E4 input terminal.

# Guiding

#### merlin-gerin.com

This international site allows you to access all the Merlin Gerin products in just 2 clicks via comprehensive range data-sheets, with direct links to:

■ complete library: technical documents, catalogs, FAQs, brochures...

 selection guides from the e-catalog.
 product discovery sites and their Flash animations.

You will also find illustrated overviews, news to which you can subscribe, the list of country contacts...

	at a maintee former that from how
2 2 2 2 2 2 2 2 2 2 2 2 2 2	

## The technical guide

These technical guides help you comply with installation standards and rules i.e.: the electrical installation guide, the protection guide, the switchboard implementation guide, the technical booklets and the co-ordination tables all form genuine reference tools for the design of high performance electrical installations. For example, the LV protection co-ordination guide - discrimination and cascading - optimises choice of protection and connection devices while also increasing markedly continuity of supply in the installations.



Sepam series 20 Sepam series 40 Sepam series 80

## Order form

Introduction	7
Sepam series 20 and Sepam series 40	47
Sepam series 80	85
Additional modules and accessories	139
Order form	218
Sepam series 20	218
Sepam series 40	219
Sepam series 80	220
Sepam 100 LD	221
Sepam 100 MI	222
Sepam accessories and spare parts	223

## Sepam series 20 Ready-to-use configuration

## Number of identical Sepam configurations ordered

This order form can be used to define a complete Sepam configuration. Check the boxes  $\bowtie$  that match your choices.

Base unit, con	nectors ai	nd appli	cation		
Base unit and UMI				Application	Туре
Base unit with advanced	IUMI	S10UD	59607	Substation	S20
With lead seal acc	With lead seal accessory <sup>(1)</sup>		59639		S23
(1) Can be used only wit	UMI.		Transformer	T20	
Base unit with basic UM	I	S10UX	59603		T23
Remote advanced	UMI module	DSM303	59608	Motor	M20
Connection cord	L=0.6 m	CCA770	59660	Busbars	B21
	L = 2 m	CCA772	59661		B22
	L=4 m	CCA774	59662		
Mounting plate		AMT840	59670		
Working language					
Sepam series 20	EN/FR		59609 📃		
	EN/ES		59611		
Connectors				Note:	
Туре	Screw-type	CCA620	59668	CCA630: 3 phas CCA634: 3 phas	
	Ring-lug type	CCA622	59669	00A034. 3 prias	601 +10

Туре		Sensor			
S20	59620	СТ	СТ	LPCT	
S23	59626	СТ	СТ 📃	LPCT	
T20	59621	СТ	СТ	LPCT	
T23	59627	СТ	СТ	LPCT	
M20	59622	СТ	СТ 📃	LPCT	
B21	59624				VT
B22	59625				PT 📃
		59630	59629	59631	59632
		CCA630	CCA634	CCA670	CCA640
	S20 S23 T20 T23 M20 B21	S20         59620           S23         59626           T20         59621           T23         59627           M20         59622           B21         59624	S20         59620         CT           S23         59626         CT           T20         59621         CT           T23         59627         CT           M20         59622         CT           B21         59624         E           B22         59625         59630	S20       59620       CT       CT         S23       59626       CT       CT         T20       59621       CT       CT         T23       59627       CT       CT         M20       59622       CT       CT         B21       59624           B22       59625           S9630       59629	S20       59620       CT       CT       LPCT         S23       59626       CT       CT       LPCT         T20       59621       CT       CT       LPCT         T23       59627       CT       CT       LPCT         M20       59622       CT       CT       LPCT         B21       59624            B22       59625            Feb30       59630       59629       59631

#### Modules, communication interfaces and core balance CTs

#### Core balance CTs

Core balance CT, Ø 120 mm	CSH120	59635 📃
Core balance CT, Ø 200 mm	CSH200	59636
Interposing ring CT	CSH30	59634
Core balance CT interface	ACE990	59672

Note: only one core balance CT can be added. Warning: Using core balance CTs is incompatible with the CCA634.

Modules								
Input / output modules								
10 inputs + 4 outputs, 24-250 V	DC			MES114	59646 📃			
10 inputs + 4 outputs, 110-125	MES114E	59651						
10 inputs + 4 outputs, 220-250	MES114F	59652 📃						
Note: the Sepam base unit has 4 outputs; only one input/output module can be added.								
Remote modules				Connectio	n cord			
8 temperature sensor	MET148-2	59641	L = 0.6 m	CCA770	59660			
module			L = 2 m	CCA772	59661 📃			
			L=4 m	CCA774	59662			
Note: the MET148-2 can be use	ed only with app	olications T	and M.					
Analog output module MSA141 59647	59647	L=0.6 m	CCA770	59660 📃				
			L = 2 m	CCA772	59661			
			L=4 m	CCA774	59662 📃			
Communication interfac	es							
Modbus interfaces				Connectio	n cord			
2-wire RS 485 interface	ACE949-2	59642 📃		CCA612	59663 📃			
4-wire RS 485 interface	ACE959	59643		CCA612	59663 📃			
Fiber optic interface	ACE937	59644		CCA612	59663 📃			
Multi-protocol interfaces (M	odbus, DNP3 o	or IEC 6087	0-5-103)					
2-wire RS 485 interface	ACE969TP	59720		CCA612	59663 📃			
Fiber optic interface	ACE969FO	59721 📃		CCA612	59663 📃			
Note: only one interface per an	nlication							

Note: only one interface per application.

## Sepam series 40 Ready-to-use configuration

#### Number of identical Sepam configurations ordered

This order form can be used to define a complete Sepam configuration. Check the boxes X that match your choices.

Base unit, con	nectors ai	nd appli	cation				
Base unit and UMI				Application	Туре		Sensor
Base unit with advanced	Base unit with advanced UMI With lead seal accessory <sup>(1)</sup>		59604	Substation	S40	59680	CT
With lead seal acc			59639		S41	59681	CT
(1) Can be used only wit	th an advance	JMI.			S42	59682	CT
Base unit with basic UM	I	S10MX	59600	Transformer	T40	59683	CT
Remote advanced	d UMI module	DSM303	59608		T42	59684	CT
Connection cord	L=0.6 m	CCA770	59660	Motor	M41	59685	CT
	L=2 m	CCA772	59661	Generator	G40	59686	CT
	L=4 m	CCA774	59662				59630
Mounting plate		AMT840	59670				CCA630
Working language							
Sepam series 40	EN/FR		59615	Note:			
	EN/ES		59616	CCA630: 3 phase CCA634: 3 phase			
Connectors				007004. 3 pilase	01 +10		
Type Screw-type CCA	4620 - 59668 a	nd CCA626	- 59656 📃				
Ring-lug type CCA	A622 - 59669 a	nd CCA627	- 59657 📃				

#### Modules, communication interfaces and core balance CTs

Core balance CTs		
Core balance CT, Ø 120 mm	CSH120	59635
Core balance CT, Ø 200 mm	CSH200	59636
Interposing ring CT	CSH30	59634
Core balance CT interface	ACE990	59672

Note: only one core balance CT can be added.

Warning: Using core balance CTs is incompatible with the CCA634.

ore balance ors					
Modules					
Input / output modules					
10 inputs + 4 outputs, 24-2	50 V DC			MES114	59646 📃
10 inputs + 4 outputs, 110-	MES114E	59651 📃			
10 inputs + 4 outputs, 220-	MES114F	59652 📃			
Note: the Sepam base un	it has 4 outputs; c	nly one inpu	t/output modi	ule can be add	led.
Remote modules				Connectio	n cord
8 temperature sensor	MET148-2 5	9641	L = 0.6 m	CCA770 5	9660
module			L=2m	CCA772 5	9661
			L=4 m	CCA774 5	9662
Note: the MET148-2 can be Maximum of 2 modules per		applications	T, M and G.		
Analog output module	MSA141	59647	L=0.6 m	CCA770	59660
			L = 2 m	CCA772	59661 📃
			L=4 m	CCA774	59662
Note: the MSA141 can be	e used with all the	applications			
<b>Communication inte</b>	rfaces				
Modbus interfaces				Connection	n cord
2-wire RS 485 interface	ACE949-2	59642		CCA612	59663
4-wire RS 485 interface	ACE959	59643 📃		CCA612	59663 📃
Fiber optic interface	ACE937	59644		CCA612	59663
Multi-protocol interface	es (Modbus, DNF	P3 or IEC 608	370-5-103)		
2-wire RS 485 interface	ACE969TP	59720		CCA612	59663 📃
Fiber optic interface	ACE969FO	59721		CCA612	59663

Note: only one interface per application.

СТ 📃

CT 🔲

CT 🔲

CT

CT 📃

CT 🔲

CT 📃

59629

CCA634

LPCT

LPCT

LPCT

LPCT

LPCT

LPCT

LPCT

59631

CCA670

## Sepam series 80 Ready-to-use configuration

## Number of identical Sepam configurations ordered

This order form can be used to define a complete Sepam configuration. Check the boxes  $\bigotimes$  or indicate the required quantities in the appropriate spaces \_\_\_\_\_\_ according to your choices.

Base unit and U	MI			Application	п Туре	B1 sen	sor		B2 sens	sor		
Base unit with mimic	-based UMI	SEP888	59705 📃	Substation	S80 59729	СТ 📃	СТ 📃	LPCT				
Base unit with adva	nced UMI	SEP383	59704 📃		S81 59730	CT 📃	CT 📃	LPCT 📃				
With lead sea	accessory (1)	AMT852	59639 📃		S82 59731 📃	CT 📃	СТ 📃	LPCT				
Base unit without ba	isic UMI	SEP080	59703		S84 59732	CT 📃	CT 📃	LPCT				
Remote adva	nced	DSM303	59608 📃	Transformer	T81 59733	CT 📃	СТ 📃	LPCT				
UMI module (	compulsory wit	h SEP080)			T82 59734 📃	CT 📃	CT 📃	LPCT				
Connection co	ord L = 0.6 m	CCA770	59660		T87 59735	CT 📃	CT 📃		CT 📃	CT 📃		
	L=2 m	CCA772	59661 📃	Motor	M81 59736	CT 📃	СТ 📃	LPCT				
	L=4 m	CCA774	59662 📃		M87 59737	CT 📃	СТ 📃	LPCT	CT 📃	СТ 📃	LPCT	
Mounting plat	e	AMT880	59706		M88 59738	CT 📃	CT 📃		CT 📃	CT 📃		
Note: 8 mounting cl	ips included			Generator	G82 59739 📃	CT 📃	СТ 📃	LPCT				
Memory cartride	ge				G87 <b>59741</b>	CT 📃	CT 📃	LPCT	CT 📃	CT 📃	LPCT 📃	
Memory cartridge		MMS020	59707 📃		G88 <b>59742</b>	CT 📃	CT 📃		CT 📃	CT 📃		
Logipam option		SFT080	59711 📃	Busbar	B80 59743	CT 📃	СТ 📃	LPCT				
Note: option require	ed to use Logip	am program.			B83 59744 📃	CT 📃	CT 📃					VT 📃
Working langua	ge			Capacitor	C86 59745	CT 📃	CT 📃	LPCT	CT 📃	CT 📃		
Sepam series 80	EN/FR		59709 📃			59630	59629	59702	59630	59629	59702	59632
	EN/ES		59710 📃			CCA630	CCA634	4 CCA671	CCA630	CCA634	CCA671	CCT640
Connectors												
Туре	Screw-type	CCA620	59668	Note:								
		001000		CCA630: 3 pl	hase CT							

type (1) Can be used only with an advance UMI

Ring-lug

Modules, communication interfaces and core bala	ance CTs
---	----------

CCA622

Core balance CTs			
Core balance CT, Ø 120 mm	CSH120	59635	
Core balance CT, Ø 200 mm	CSH200	59636	
Interposing ring CT	CSH30	59634	
Core balance CT interface	ACE990	59672	

**Note:** the total number of core balance CTs cannot exceed 2. **Warning:** Using core balance CTs is incompatible with the CCA634.

# 59668 Note: 59669 CCA630: 3 phase CT CCA634: 3 phase CT + IO

re balance CTs							
Modules							
Input / output modules							
14 inputs (24-250 V DC) +	6 outputs				MES120	59715	
14 inputs (220-250 V DC) + 6 outputs				MES120G	59716		
14 inputs (110-125 V DC)	+ 6 outputs				MES120H	59722	
Note: the Sepam base un	it comes with 5	outputs	s; 3 inpl	t/output mod	dules can be	added.	
Remote modules					Connection cord		
8 temperature sensor	MET148-2	MET148-2 59641		L=0.6 m	CCA770	59660	
module				L = 2 m	CCA772	59661	
				L=4 m	CCA774	59662	
Note: the MET148-2 can Maximum of 2 MET 148-2				T, M, G and	C.		
Analog output module	MSA141	59647	647 📃	L=0.6 m	CCA770	59660	
				L = 2 m	CCA772	59661	
				L=4 m	CCA774	59662	2
Note: the MSA141 can be	e used with all t	the appl	ications				
Synchro-check module					MCS025	59712	2
Mounting plate					AMT840	59670	)
<b>Note:</b> the MET148-2 can Comes with connection co							
Communication inter	rfaces						
Modbus interfaces	bus interfaces			Connection cord			
2-wire RS 485 interface	ACE949-2	59642			CCA612	59663	
4-wire RS 485 interface	ACE959	59643			CCA612	59663	
Fiber optic interface	ACE937	59644			CCA612	59663	
Multi-protocol interface	s (Modbus, DN	NP3 or I	EC 608	70-5-103)			
2-wire RS 485 interface	ACE969TP	59720			CCA612	59663	
	//OL00011						

Note: the total number of communication interfaces cannot exceed 2.

## Sepam 100 LD

When ordering Sepam 100 LD, stabilization plate and/or surge limiters, please enclose a photocopy of this page with your order, filling in the requested quantities in the spaces provided  $\square$  and ticking off the boxes  $\aleph$  to indicate your choices.

Quantity		
Rated frequency	50 Hz	
	60 Hz	
Version	Single-phase	
	Three-phase	
Auxiliary power supply	24 to 30 V DC	[
	48 to 125 V DC	
	220 to 250 V DC	
	100 to 127 VAC	[
	220 to 240 V AC	
<b>Stabilization plate</b>	•	
Resistance	68 W - 280 W	
	150 W - 280 W	
	270 W - 280 W	
	470 W - 180 W	
	680 W - 180 W	
Surge limiters		
Single unit		
Triple unit		

## Sepam 100 MI

Orange box  $\bigotimes$  corresponds to none priced functions.

Sepam 100 MI	
Туре	Quantity
Sepam 100M I-X00	
Sepam 100M I-X01	
Sepam 100M I-X02	
Sepam 100M I-X03	
Sepam 100M I-X10	
Sepam 100M I-X11	
Sepam 100M I-X12	
Sepam 100M I-X13	
Sepam 100M I-X14	
Sepam 100M I-X15	
Sepam 100M I-X16	
Sepam 100M I-X17	
Sepam 100M I-X18	
Sepam 100M I-X22	
Supply voltage	
24/30 V AC/DC	
48/127 V AC/DC	

## Sepam accessories and spare parts

Check the boxes  $\bigotimes$  or indicate the required quantities in the appropriate spaces  $\hfill \hfill \h$ 

Mounting accessories			
Sepam series 20, Sepam series 40 or MCS025	:		
Mounting plate	AMT840	59670	
Sepam series 20 and Sepam series 40 with adv	vanced UMI		
Mead seal accessory	AMT852	59639	
Sepam series 80			
Mounting plate	AMT880	59706	
Blanking plate	AMT820	59699	
Software tools			
Sepam PC software: SFT2841 and SFT2826 (1 CD-ROM without connection cord CCA783)	SFT2841 CD	59679	
PC connection cord	CCA783	59664	
USB/RS232 interface (CCA783 cord must be ordered sep	arately)	TSXCUSB232	
Logipam SFT2885 programming software	CD SFT2885	59727	
IEC 61850 configuration software	CD SFT850	59726	
Input / output modules			
Sepam series 20 and series 40	1150111	50040	
10 inputs + 4 outputs, 24-250 V DC	MES114	59646	
10 inputs + 4 outputs, 110-125 V DC / VAC	MES114E	59651	
10 inputs + 4 outputs, 220-250 V DC / V AC	MES114F	59652	
Sepam series 80			
14 inputs + 6 outputs, 24-250 V DC	MES120	59715	
14 inputs + 6 outputs, 110-125 V DC	MES120H	59722	
14 inputs + 6 outputs, 220-250 V DC	MES120G	59716	
Remote modules and cords			
8 temperature sensor module	MET148-2	59641	
Analog output module	MSA141	59647	
Remote advanced UMI module	DSM303	59608	
Synchro-check module (including connection cord	MCS025	59712	
CCA785)			
Remote module connection cord L = 0.6 m	CCA770	59660	
Remote module connection cord L = 2 m	CCA772	59661	
Remote module connection cord L = 4 m	CCA774	59662	
Synchro-check module connection cord	CCA785	59665	
L = 2 m (spare parts)			
Communication accessories			
Sepam communication interfaces			
2-wire RS 485 Modbus interface (without CCA612)	ACE949-2	59642	
4-wire RS 485 Modbus interface (without CCA612)	ACE959	59643	
Fiber optic Modbus interface (without CCA612)	ACE937	59644	
RS 485 multi-protocol 2-wire interface (without CCA612)	ACE969TP	59720	
Fiber optic multi-protocol interface (without CCA612)	ACE969FO	59721	<u> </u>
Connection cord, L = 3 m	CCA612	59663	<u> </u>
Converters			
RS 232 / RS 485 converter	ACE909-2	59648	
RS 485 / RS 485 interface (AC)	ACE919CA	59649	
RS 485 / RS 485 interface (DC)	ACE919CC	59650	
Ethernet gateway (Merlin Gerin)	EGX100	EGX100MG	<u> </u>
Ethernet webserver (Merlin Gerin)	EGX100	EGX400MG	
		59638	
Sepam IEC 61850 server (with one ECI850 cat. no. 59653 and two surge arresters cat. no. 16595)	ECI850	09030	
Ethernet configuration kit for ECI850		TCSEAK0100	
5			
Core balance CTs	0011400	E0625	
Core balance CT, Ø 120 mm	CSH120	59635	
Core balance CT, Ø 200 mm	CSH200	59636	
Interposing ring CT	CSH30	59634	
Core balance CT interface	ACE990	59672	
Accessories for phase-current sense	ors (LPCT	)	
LPCT injection adapter	ACE917	59667	
Remote LPCT test plug	CCA613	59666	

# Sepam accessories and spare parts

Check the boxes 🔀 or indicate the required quantities in the appropriate spaces according to your choices.

Manuals							
Sepam series 2	0						
User's manual	•		PCRED	301005	EN 🗖	FR 🔲	
Sepam series 4	0		TORED	501000			
User's manual	0		PCRED	301006	EN 🗖	FR	
Sepam series 8	0		TORED	501000			
Metering, protection		onitoring user'	s SEPED3	03001	EN 🗌	FR 📃	
manual				00001			
Modbus communica	tion user's ma	nual	SEPEDS	803002	EN 📃	FR	
Installation and oper	ation manual		SEPEDS	803003	EN 🗌	FR 📕	
Communication	n protocol						
DNP3 protocol	•		SEPEDS	805001	EN 🗖	FR	
IEC 60870-5-103 pro	otocol		SEPEDS	805002		FR 🔲	
Note: the technical i	manuals must	be ordered sep	arately form	the CDI c	entre i	n Evreux.	
Spare conne		,	,				
Sepam							
20-pin screw-type co	onnector		CC	A620		59668	
20-pin ring lug conne				CCA620 CCA622			
6-pin screw-type cor				-		59669 59656	
				CCA626			
	S-pin ring lug connector			CCA627			
				CCA630			
1 A / 5 A CT + IO curr			CCA634 CCA670			59629 59631	
	CT lateral current connector			CCA670			
	Tradial current connector			CCA671			
VT voltage connecto	и			1040		59632	
MES modules Connectors for 2 ME	C114 and 2 M	E 6 1 2 0	1/:+	2640		59676	
				2040		290/0	
Spare Separ		0 base un					
With mimic-based U	MI		-	P888		59705 59704	
With advanced UMI	Ivanced UMI			SEP383			
Without UMI	nout UMI			P080		59703	
12 spring clips						3TZ3002	
Note: the base units	are supplied v	without connec	tors and with	out memo	ry car	tridges.	
Spare Separ	n series 8	0 memory	cartridg	je			
Memory cartridges				MMS02	0	59707	
Note: memory cartri	idges cannot b	e sold without a	application.				
Application	Туре		Working la	nguage		Logipam	
			59709	597	10	59711	
Substation	S80	59729	EN/FR	EN/SP			
	S81	59730	EN/FR	EN/SP			
	S82	59731	EN/FR	EN/SP			
	S84	59732	EN/FR	EN/SP			
Transformer	T81	59733	EN/FR	EN/SP			
	T82	59734	EN/FR	EN/SP			
	T87	59735	EN/FR	EN/SP			
Motor	M81	59736	EN/FR	EN/SP			
	M87	59737	EN/FR	EN/SP			
	M88	59738	EN/FR	EN/SP			
Generator	G82	59739	EN/FR	EN/SP			
Contrator		00700					

59741 EN/FR

59742 EN/FR

59743 EN/FR

59744 EN/FR

59745 EN/FR

EN/SP

EN/SP

EN/SP

EN/SP

EN/SP

Busbar

Capacitor

G87

G88

B80

B83

C86

## Schneider Electric Industries SAS

89, boulevard Franklin Roosevelt F - 92500 Rueil-Malmaison (France) Tel : +33 (0)1 41 29 85 00 http://www.schneider-electric.com http://www.sepamrelay.merlin-gerin.com As standards, specifications and designs change from time to time, please ask for confirmation of the information given in this publication.

Ð Printed on recycled paper.

Design: Ameg Publication: Schneider Electric Printed: